


## FIRE ALARM FLOOR PLAN

SCALE: 1/4" = 1'-0"

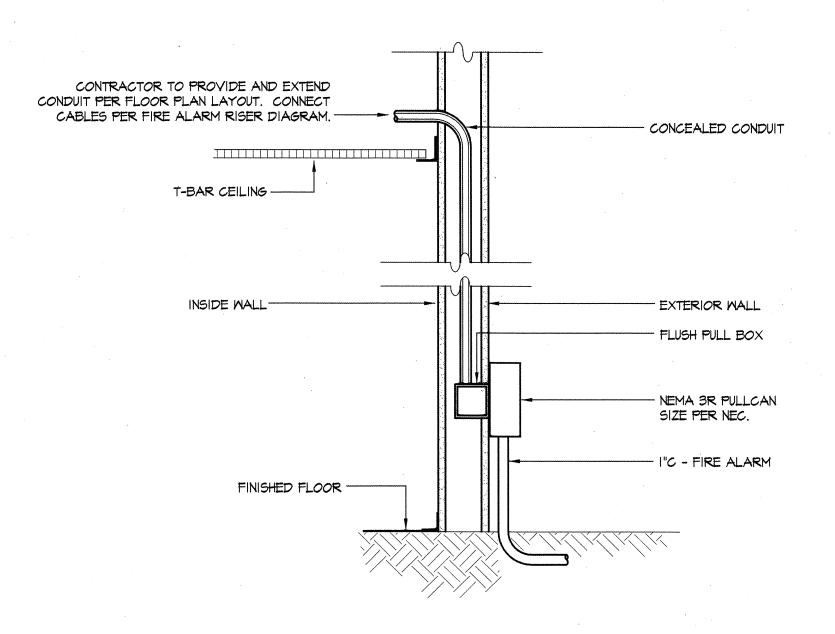

# CONDUIT/PULLCAN DETAIL

FA2.1 NOT TO SCALE

#### **GENERAL NOTES**

- I. SEE RISER DIAGRAM FOR ADDITIONAL REQUIREMENTS.
- 2. ALL CABLES AND CONDUITS/SURFACE RACEWAYS SHALL BE NEW UNLESS OTHERWISE NOTED.
- 3. PROVIDE SMOKE DETECTOR GUARDS. SEE FIRE ALARM SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
- 4. FIRE ALARM CONDUIT SHALL BE PAINTED RED.

### SHEET NOTES.

- NEW 'N9' IN-GRADE FIRE ALARM PULLBOX TO BE PROVIDED AND INSTALLED BY CONTRACTOR. LABEL LID "FIRE ALARM".
- 2 NEW PULLCAN. CONTRACTOR SHALL SIZE PER NEC.

#### CONDUIT SCHEDULE

(N) (I) I"C - FIRE ALARM


### FA CABLE SCHEDULE

A - (2) #12 FOR NOTIFICATION APPLIANCE CIRCUITS (NAC) B - (I) #14 SHEILDED TWISTED PAIR FOR SIGNALING LINE CIRCUITS (SLC)



LANDSCAPE ARCHITECTURE CIVIL ENGINEERING SPORT PLANNING & DESIGN


2455 The Alameda Santa Clara, CA 95050 tel: 408.985.7200 fax: 408.985.7260 www.VerdeDesignInc.com



CONSULTANT



American Consulting Engineers Electrical, inc. 1590 The Alameda, Suite 200 San Jose, CA 95126 Ph: 408/236-2312 Fax: 408/236-2316 JOB #E12249.00



FIRE ALARM **FLOOR PLAN** 

PROJECT NAME

CANADA COLLEGE TENNIS FACILITY **IMPROVEMENTS** 

PROJECT ADDRESS

4200 FARM HILL BLVD REDWOOD CITY, CA 94061

·		
SUBMITTAL		DATE
90%		07/30/12
BID SUBMITTAL		08/21/12
ADDENDUM ONE		08/31/12
CONFORM SET		09/24/12
NO. REVISIONS		DATE
	,	,
$\triangle$		
		,
$\triangle$		
$\triangle$		
DRAWN BY	CHECKED BY	
MM	SF	
DATE ISSUED	SCALE	
08/21/12	AS NOTED	
DDOL NO		

1207300-1281

FA2.1 37 OF 39 SHEETS