

(+) (+)

 \sim

ζЭ

,¹⁴ 1. J.


(a

KEYNOTES **1** DRAIN TO CONDENSATE RECEPTOR. INCLUDE ALL WELLS, TAPS, AND DEVICES REQUIRED FOR THE COMPLETE AND FUNCTIONAL 2 POC TO (E) CHS & CHR INSTALLATION OF THE CONTROL SYSTEM, REFER TO SHEET M6.1 AND COORDINATE WITH CONTROLS CONTRACTOR. COMPLETE SHOP DRAWINGS SHALL BE SUBMITTED PRIOR TO COMMENCEMENT OF WORK BY CONTRACTOR. 3 FLOW SWITCH. 4 BALANCE/ SERVICE VALVE & CHECK VALVE, OR TRIPLE DUTY VALVE. 5 MANUAL AIR VENT AT ALL HIGH POINTS. 6 KEEP CLOSED AFTER FINAL FILL. 7 (E) PIPING & EQUIPMENT SHOWN FOR REFERENCE. 8 REPLACE & TRIM IMPELLER AS REQUIRED FOR NEW GPM. 6 -3/4" 6 __(E) 2−1/2" ድ ት ዋ 2-1/2" ─(E) 2-1/2" <u>AH-2</u> cooling coil 54 gpm 3/4"----<u>(E) AH-1</u> -101KC COOLING COIL 110 GPM 3/4"---- \ominus \ominus 2-1/2" -K+Ш



DIV. OFFIC	IDENTIFICATION STAMP OF THE STATE ARCHITECT E OF REGULATION SERVICES
	APPL 01-103735
	FLS THE SS D

NTS

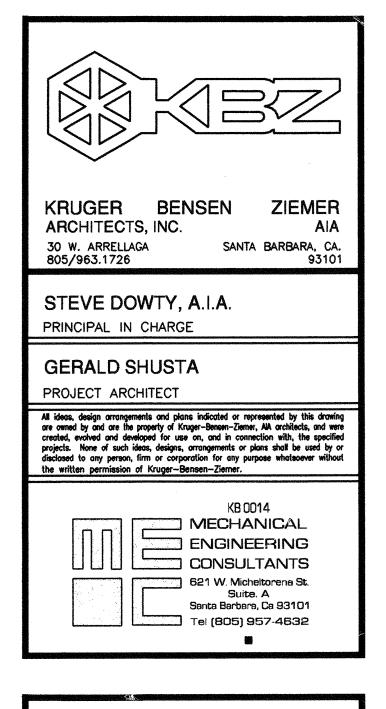

CENTER FOR ADVANCED LEARNING TECHNOLOGY SKYLINE COLLEGE	SAN MATEO COUNTY COMMUNITY COLLEGE DISTRICT 3300 COLLEGE DRIVE SAN BRUNO, CALIFORNIA 94066		
NO. DESCRIPTION DATE BY			
DRAWN J. SIERRA, T. RAUTIO CHECKED AVR DATE 03-21-2001 JOB NO. 98-03 SHEET TITLE			

CHILLED WATER PIPING SCHEMATIC

M 4.1

SHEET