

1 CARPETS - ALL MODULES SHALL BE CARPETED WITH DIRECT GLUE DOWN TYPE PER STATE OF CALIFORNIA SPECIFICATION 1220-2IK-OI, GROUP I, TYPE "A", CLASS 24. THE CARPET DENSITY SHALL BE 4600 MIN. PILE YARN SHALL BE BRANDED NYLON. NO CROSS SEAMS SHALL BE ALLOWED. COLOR TO BE SELECTED BY OWNER.

2 RESILIENT BASE COVE - BEST QUALITY, MOULDED RUBBER, 1/8" THICK, 4" HIGH, MOULDED TOP SET COVE. PROVIDE PREFORMED BASE FOR SQUARE EXTERNAL CORNERS AND PREFORMED END STOPS WHERE BASE DOES NOT ABUT. SOLID COLORS AS MANUFACTURED BY "BURKE RUBBER CO." OR EQUAL.

3 ADHESIVES SHALL BE WATER BASE, SOLVENT BASE NOT ACCEPTABLE. FURNISH AND APPLY PER MANUFACTURER'S WRITTEN INSTRUCTIONS.

4 SEALANT - ROOF & MODULE LINE - POLYURETHANE SIDING & TRIM - ACRYLIC LATEX

5 PAINT - (EXTERIOR WOOD) PRIMER-----ACRYLIC UNDERCOAT FINISH-----ACRYLIC ENAMEL (METALS)-----PRIMER-----RED OXIDE ALKYD FINISH-----ACRYLIC ENAMEL

6 BUILDING, DOOR, & WINDOW TRIM - MASONITE FACED MDO TRIM. TRIM SHALL BE SEALED AT ALL EDGES. SEALANT PAINTED TO MATCH TRIM OR SIDING.

EXTERIOR SIDING - 8" O.C., GROOVED M.D.O. PLYWOOD OR STUCCO PATTERN MASONITE FACED EXTERIOR SIDING. (MINIMUM NET THICKNESS 3/8")

7 HOLLOW METAL DOORS AND FRAMES- 3'0" x 7'0" x 1-3/4" 18 GA. FULL FLUSH METAL DOOR IN 18 GA. METAL FRAME.

EXIT DOOR SHALL BE OPENABLE FROM THE INTERIOR WITHOUT A KEY OR SPECIAL KNOWLEDGE OR EFFORT.

CLOSERS FOR EXTERIOR DOORS SHALL BE SET FOR A MAXIMUM OPENING PRESSURE OF 8.5 LBS & 5 LBS FOR INTERIOR CLOSERS

DEADBOLTS NOT PERMITTED UNLESS OPERABLE WITH A SINGLE EFFORT USING LEVER HANDLE.

DOOR SWINGS CAN BE RIGHT OR LEFT HAND HINGE.

HARDWARE SHALL BE CENTERED BETWEEN 30" AND 44" ABOVE FINISHED FLOOR.

LOCKSET (LEVER MODEL) (UNLESS OTHERWISE NOTED) (WHERE SPECIFIED ONLY) SCHLAGE DTOPDRHO (RHODES) OR EQUAL

LOCKSET (PANIC DEVICE) (WHERE SPECIFIED ONLY) (UNLESS OTHERWISE NOTED) (WHERE SPECIFIED ONLY) INTERIOR: PRECISION #108 626 OR EQUAL EXTERIOR: PRECISION # 9L OR EQUAL CYLINDER: SCHLAGE, YALE, SARGENT OR EQUAL

HINGES ----- HAGER BB279 N.R.P. 4-1/2" x 4-1/2" OR EQUAL

CLOSER----- NORTON 8501BF OR EQUAL

THRESHOLD----- PEMKO 21A OR EQUAL

DOOR BOTTOM----- PEMKO 216AV OR EQUAL

WEATHERSTRIP----- PEMKO 306A OR EQUAL

ROOFING

METAL ROOF:

PREFINISHED, UNPENETRATED INTERLOCKING, 26 GAGE MIN. GALVANIZED STEEL ROOF PANELS, MECHANICALLY CRIMPED STANDING SEAM OVER 30 LB. FELT OVER 15/32" APA RATED, EXTERIOR GRADE PLYWOOD. (CLASS 1B FIRE RATING)

INSULATION

1. ALL INSULATION (INCLUDING PIPE INSULATION) SHALL COMPLY WITH CALIFORNIA QUALITY STANDARDS, CALIFORNIA BUILDING STANDARDS, T012, T013, & 2606 FOR FOAM. MAX FLAME SPREAD: 25, MAX SMOKE DENSITY: 450

2. CEILING: 6" R-19 FIBERGLASS

3. WALL: 3-1/2" R-II FIBERGLASS

4. FLOOR: 1-1/4" RIGID CELLULAR BOARD (TOTAL FLOOR INSULATION R-II).

IDENTIFICATION

NOTE: THE MANUFACTURER SHALL PLACE A PERMANENT METAL IDENTIFICATION TAG ON EACH MODULAR BUILDING MECHANICALLY FASTENED TO THE END WALL. THE TAG SHALL SHOW D.S.A. APPLICATION NUMBER, MANUFACTURER'S SERIAL NUMBER, PLANT INSPECTOR'S IDENTIFICATION MARK AND DESIGN FLOOR AND ROOF LIVE LOAD. PLACE ONE TAG ON EXTERIOR AND, ONE ON THE INTERIOR ABOVE CEILING LINE

7 MATERIAL SPECIFICATIONS & NOTES

1 SAW LUMBER GRADED PER WEST COAST LUMBER INSPECTION BUREAU, RULE 17.

2 ALL FRAMING LUMBER SHALL BE DOUGLAS FIR #2 OR BETTER (24c), 2x4 AND 2x6 BLOCKING SHALL BE DOUGLAS FIR #2 OR BETTER (23 c).

3 LAG SCREWS AND SCREWS SHALL BE SCREWED AND NOT DRIVEN INTO PLACE.

4 LUMBER MAY BE REJECTED FOR BOXED HEART, EXCESSIVE WARP, TWIST, SPLIT, CHECK, FUNGUS, MOLD, OR ANY REASON PROVIDED BY GRADING RULES.

8 LUMBER NOTES

ALL MODULES MAY BE BUILT OPPOSITE HAND FROM THE WAY THEY ARE SHOWN

2 SIDEWALL & ENDWALL ELEVATIONS SHOWN ON SHEET A1 ARE MODULAR NON-BEARING WALLS NOT REQUIRED FOR THE RESISTANCE OF VERTICAL OR LATERAL LOADS.

9 BUILDING AND WALL PANEL OPTIONS



DESIGN CRITERIA

ROOF: DEAD LOAD - 8.0 PSF
ROOF: LIVE LOAD - 20.0 PSF (SNOW)

FLOOR: DEAD LOAD - 8.0 PSF
FLOOR: LIVE LOAD - 50.0 PSF
(OPTIONAL) FLOOR: LIVE LOAD - 70.0 PSF
(OPTIONAL) FLOOR: LIVE LOAD - 125.0 PSF

WALLS: DEAD LOAD - 8.0 PSF
WIND: 80 MPH; EXPOSURE: C
qs=16.4 PSF; Ce=1.06; Cq AS REQ.
SDSM: ZONE 4R=4.5D=23.N=1.5.Cs=0.44.Ns=2.0.Cs=0.64N.

CONFIDENTIAL MATERIAL--THESE DOCUMENTS ARE THE PROPERTY OF AND ARE NOT TO BE REPRODUCED OR DISTRIBUTED WITHOUT FULL KNOWLEDGE AND WRITTEN CONSENT FROM ENVIROPLEX INC.
© COPYRIGHT 2001 ENVIROPLEX INC. (DRAWINGS PREPARED BY ENVIROPLEX, INC.)

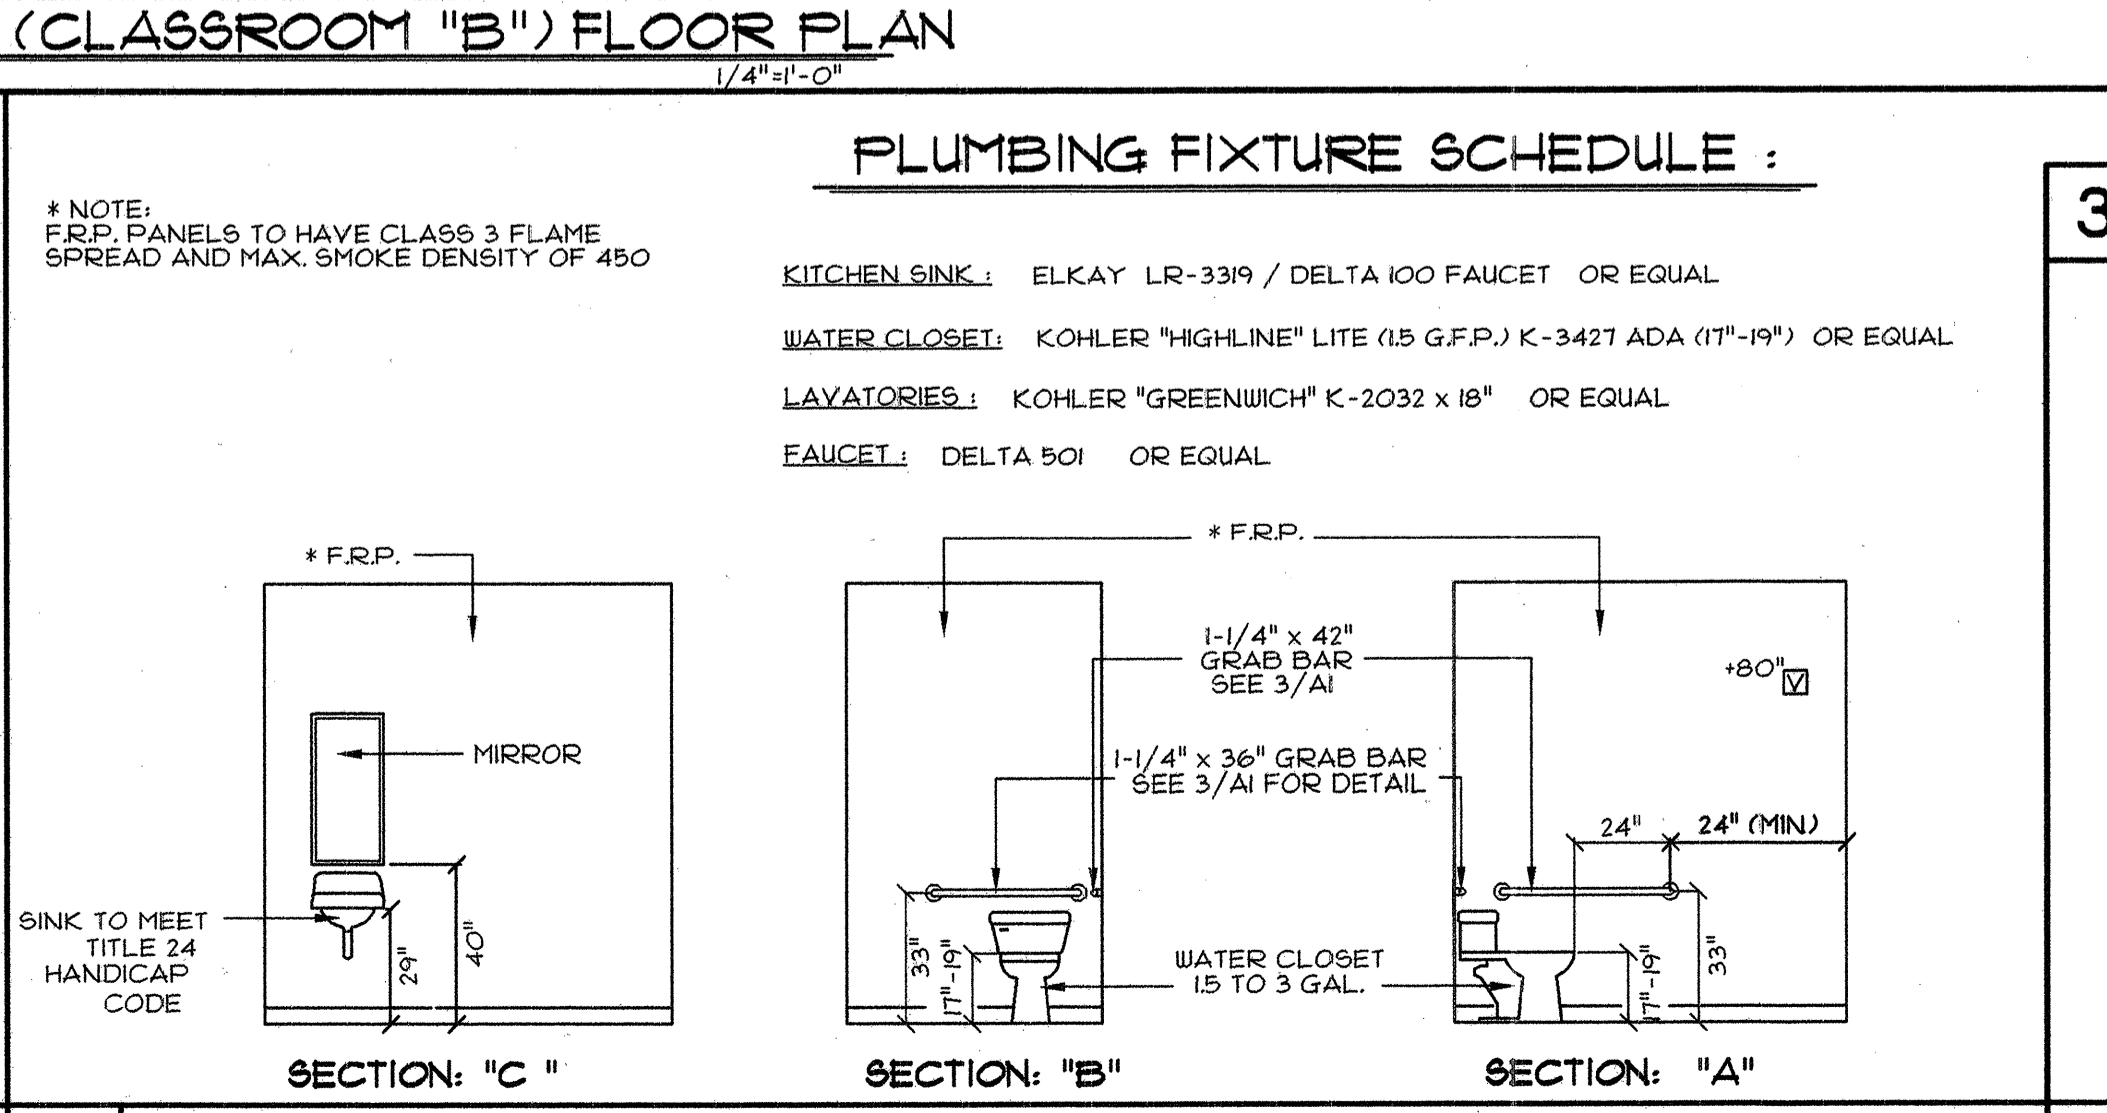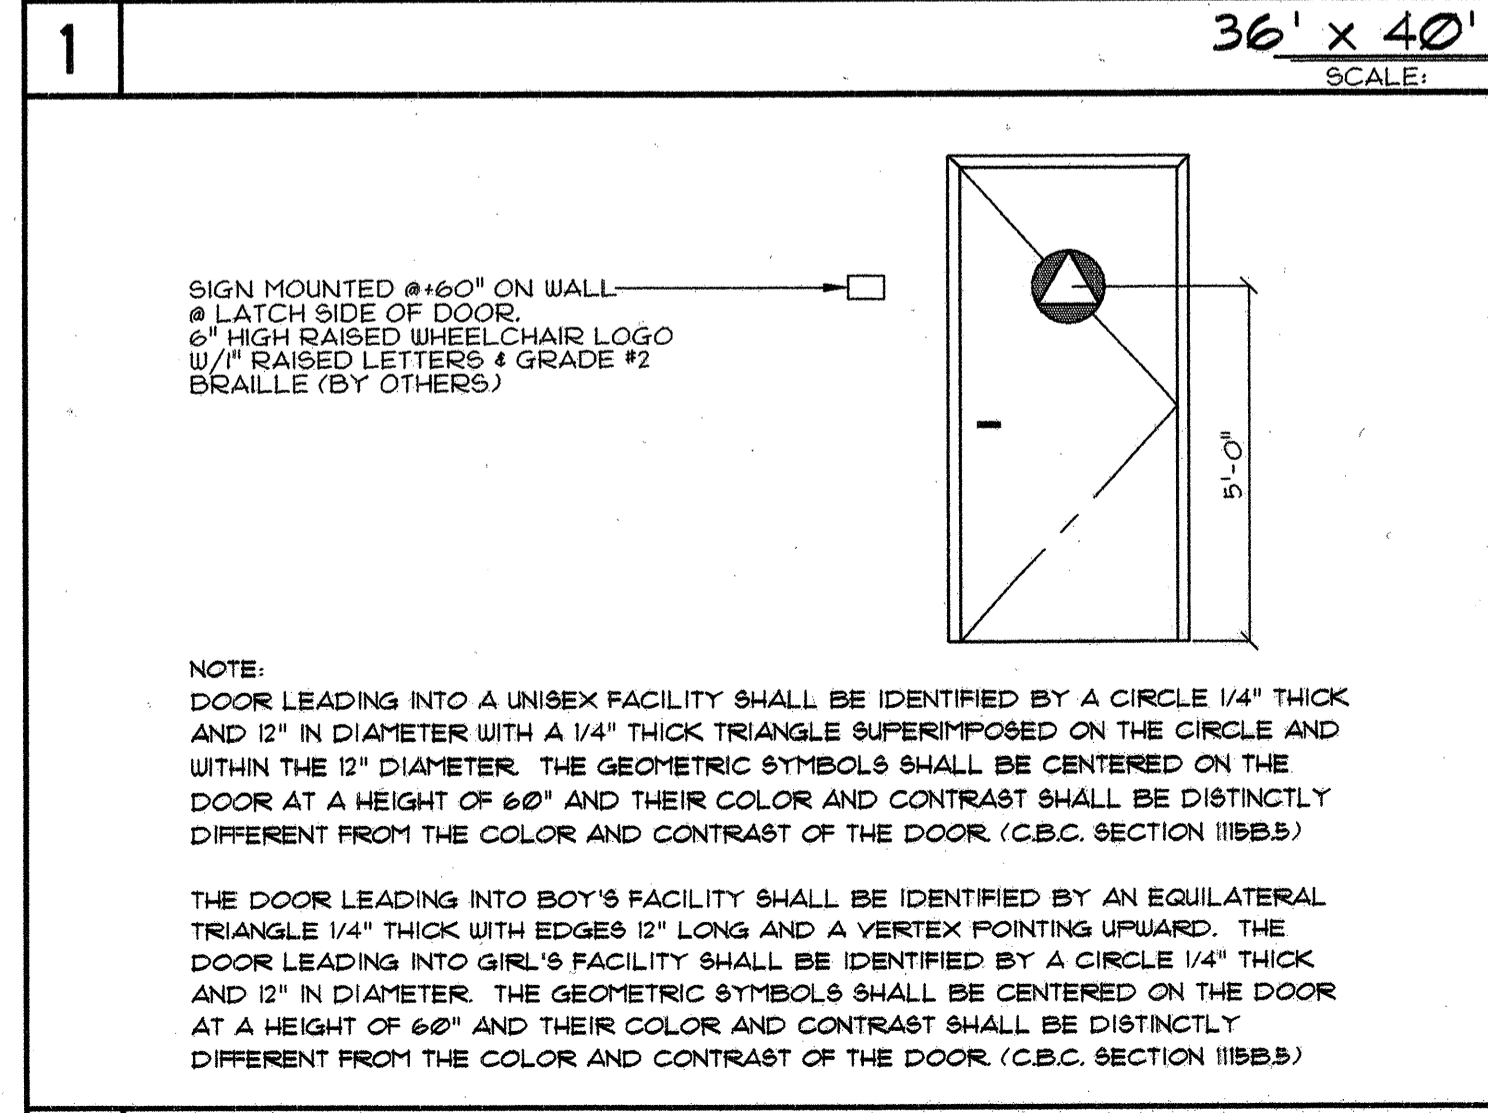

10 APPROVALS

JH Lawder, Inc.
Structural Engineers
717 16th Street, Modesto, CA 95354
(209) 521-1143

ENVIROPLEX, INC.
4777 E. CARPENTER ROAD STOCKTON, CA. 95215
SAN MATEO COMMUNITY COLLEGE
(1) 36' x 40' CLASSROOM

FLOOR PLAN - INTERIOR & EXTERIOR ELEVATIONS - MATERIAL SPECIFICATIONS - NOTES

REVISION DATE: BY:

DATE:

THIS MODULAR BLDG. HAS BEEN ENGINEERED BY A REGISTERED STRUCTURAL ENGINEER AND PREVIOUSLY REVIEWED & APPROVED BY THE DIVISION OF THE STATE ARCHITECT, FIRE & LIFE SAFETY AND ACCESS COMPLIANCE SECTION