


NO.	REVISIONS	DATE
1	10% SCHEDULE DESIGN SUBMITTAL	04/20/16
2	50% DESIGN DEVELOPMENT SUBMITTAL	06/10/16
3	100% DESIGN DEVELOPMENT SUBMITTAL	07/20/16
4	10% DESIGN DEVELOPMENT SUBMITTAL	07/20/16
5	SITE DESIGNATION ESCALATION	08/20/16
6	ROOF SHEDDING UTILITIES	08/20/16
7	DATA WORKMENT R2 80% REVIEW	10/06/16
8	DATA WORKMENT R2 80% REVIEW	11/10/16
9	DATA WORKMENT R2 80% REVIEW	11/10/16
10	DATA WORKMENT R2 80% REVIEW	11/10/16
11	DATA WORKMENT R2 80% REVIEW	11/10/16
12	DATA WORKMENT R2 80% REVIEW	11/10/16
13	DATA WORKMENT R2 80% REVIEW	11/10/16
14	DATA WORKMENT R2 80% REVIEW	11/10/16

DIVISION 4
 THE SKYLINE PROJECT
 APPL # 01-110117
 FILE # 41-C1
 NO. _____ R/S _____
 S/S _____ DATE _____
IDENTIFICATION STAMP
Increment 3


SKYLINE COLLEGE
 SAN MATEO COUNTY
 DISTRICT COLLEGE
CIP2 DESIGN-BUILD
PROJECT
BUILDING 4
INCREMENT 3

PROJECT NO.: 010552.00 DRAWN BY: CN
 DATE: 02/07/17 CHECKED BY: CM
 SCALE: 3/32"=1'-0"
 SHEET TITLE:
LEVEL 3 OVERALL FIRE PROTECTION FLOOR PLAN

SHEET NO.: **FP-103**

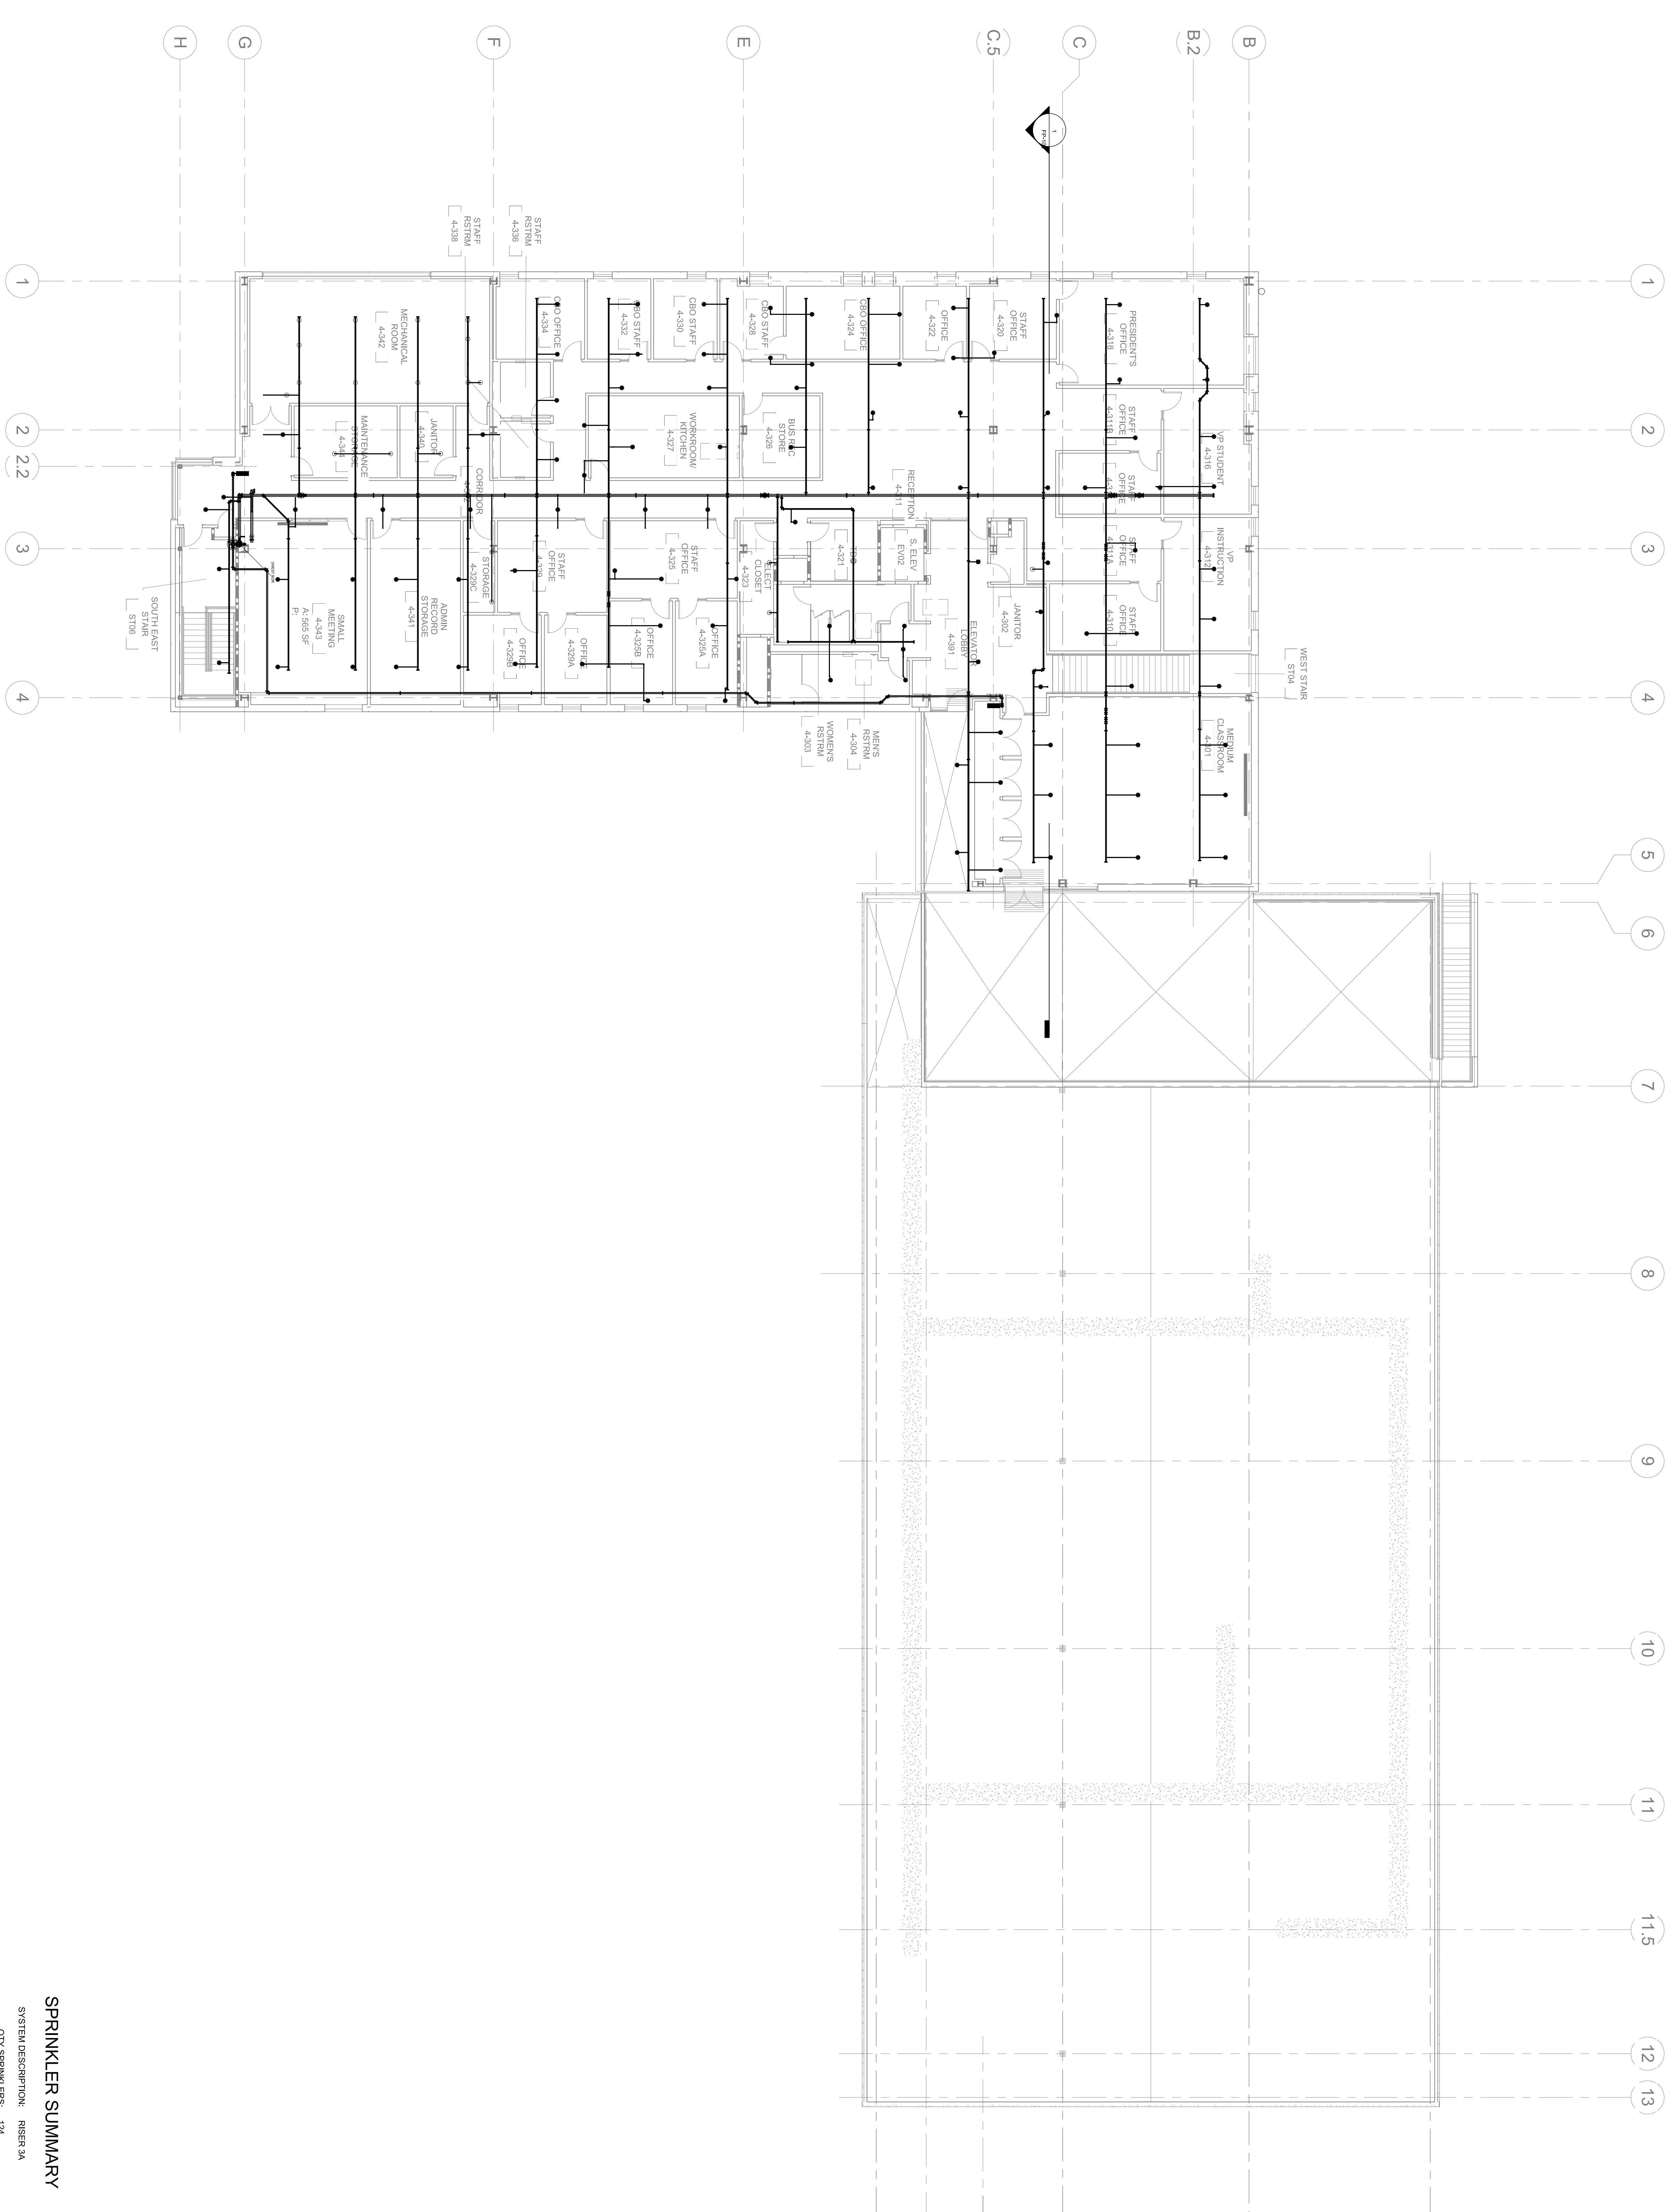

SPRINKLER SUMMARY
 SYSTEM DESCRIPTION: RISER 3A
 QTY SPRINKLERS: 124
 FLOOR AREA: 13,480 FT²
 COVERED AREA: 10,924 FT²

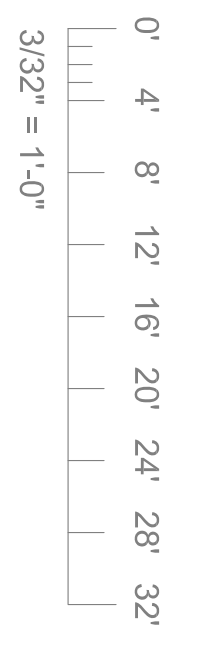

1 LEVEL 3 OVERALL FIRE PROTECTION FLOOR PLAN
 3/32" = 1'-0"

All drawings and designs are the property of the Architect/Engineer and may not be duplicated, used or revised without consent of the Architect/Engineer.
 This drawing is not to scale. The dimensions shown are based on the original data. Minor scales must be indicated. This drawing shall be read in conjunction with the original data.