



*DSB*

IDENTIFICATION STAMP  
DIVISION OF THE STATE ARCHITECT  
APPLICATION NUMBER: 111618  
AC: *DSB* PLS: *RS/DE/KAB*  
DATE: 2/9/11

CALIFORNIA STATE FIRE MARSHAL  
APPROVED

APPROVAL OF THIS PLAN DOES NOT AUTHORIZE OR APPROVE ANY  
CORRECTION OR DEVIATION FROM APPLICABLE REGULATIONS. FINAL  
APPROVAL IS SUBJECT TO FIELD INSPECTION. ONE SET OF APPROVED  
PLANS SHALL BE AVAILABLE ON THE PROJECT SITE AT ALL TIMES.

REVIEWED BY: \_\_\_\_\_ DATE: \_\_\_\_\_

**CAÑADA COLLEGE**

Electrical  
Infrastructure  
Replacement  
Project

4200 Farm Hill Blvd  
Redwood City, CA 94061

BID SET


SHEET TITLE  
**DATA, FIRE ALARM,  
AND COMMUNICATIONS  
ROUTING PLAN**

REVISIONS  
NO. DATE DESCRIPTION

NO.	DATE	DESCRIPTION

DATE January 14, 2011  
DRAWN ESS  
CHECKED RCS  
SCALE 1" = 100'  
JOB NO. 2921.01

SHEET NUMBER  
**C2.02**


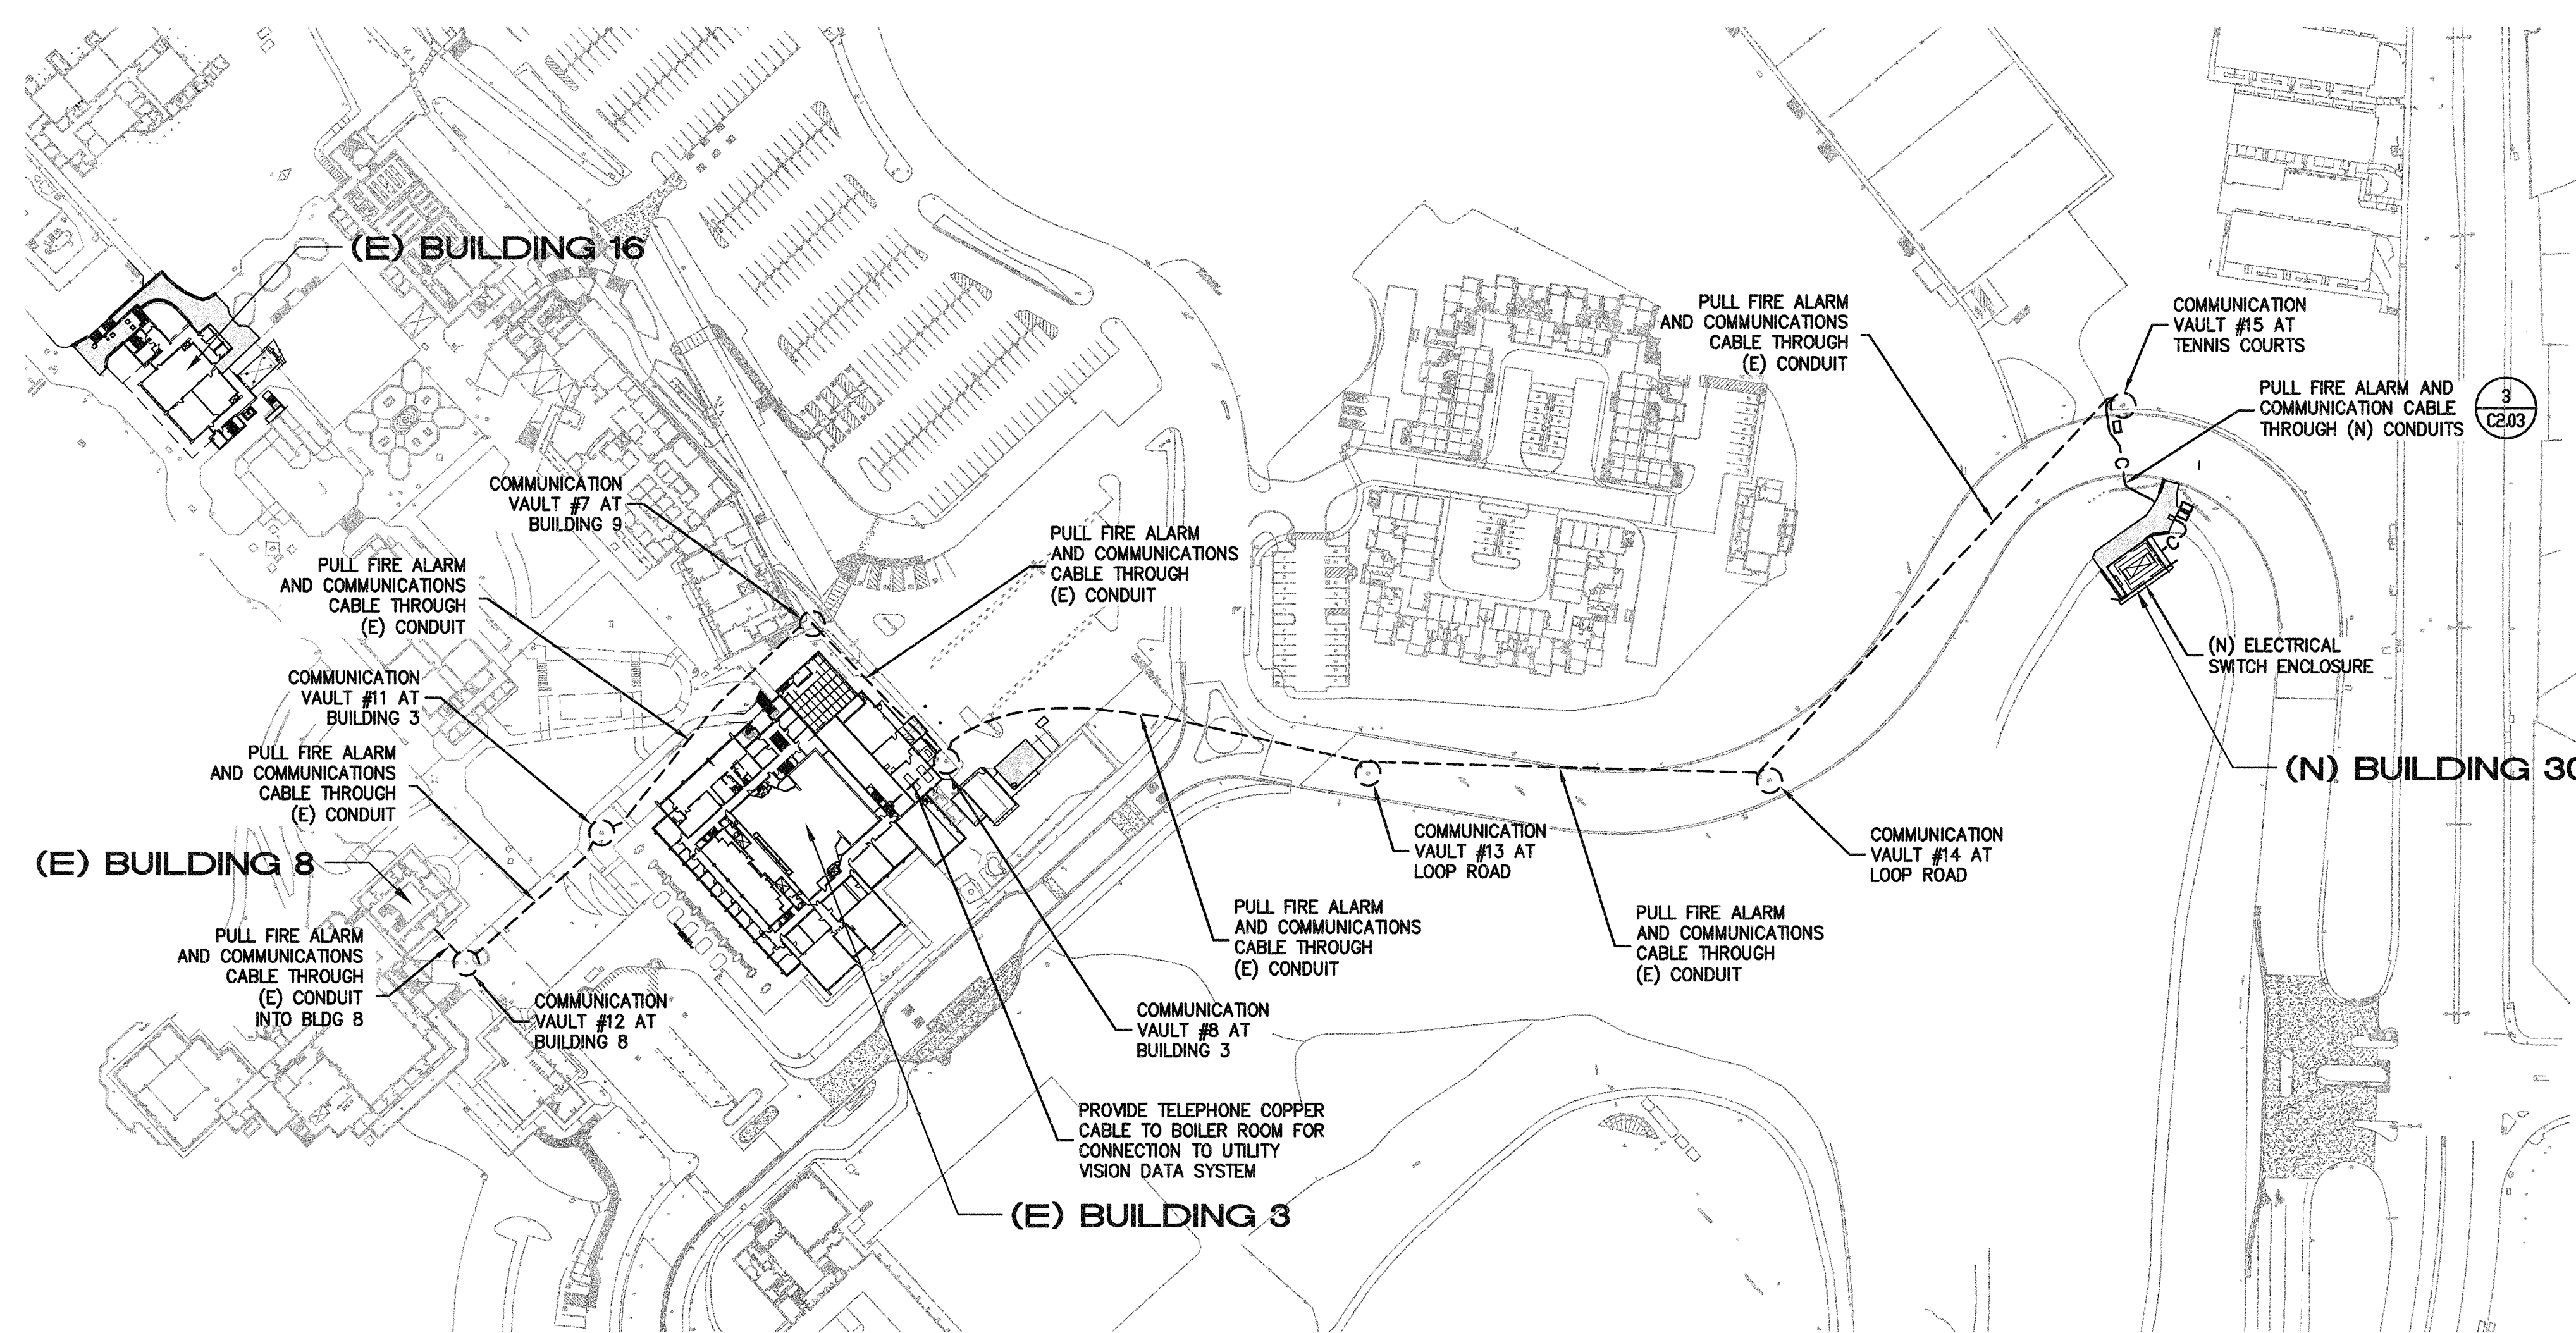


**NOTES**

- SEE SHEET C2.03 FOR DETAILED INFORMATION IN OPEN TRENCH CONSTRUCTION
- CONTRACTOR SHALL BE RESPONSIBLE FOR CONFIRMING DIMENSIONS OF CONDUIT RUNS. SEE GENERAL NOTE #2 SHEET E1.1

**LEGEND**

- PULL THROUGH EXISTING CONDUIT
- C- (N) COMM TRENCH
- (N) FULL TRAFFIC ELECTRICAL VAULT
- (N) 3' X 5' TRAFFIC RATED ELECTRICAL VAULT
- (E) VAULT TO BE PULLED THROUGH

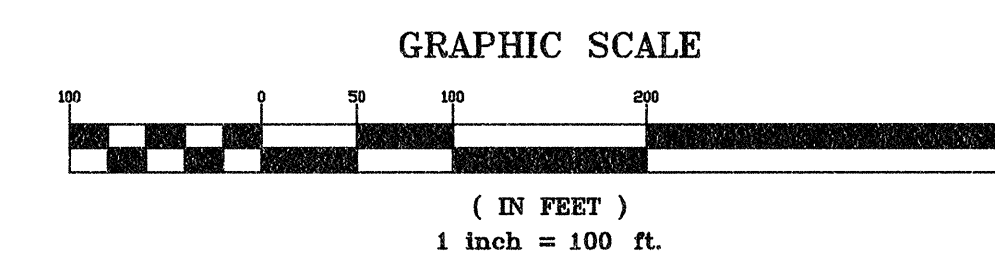

**DATA, FIRE ALARM, AND COMMUNICATIONS CONDUIT ROUTING**

SCALE: 1" = 100'