




ELECTRICAL SYMBOL LIST

NOTE: This is a standard symbol list and not all items listed may be used.






Abbreviations

(E)	EXISTING
A	AMPERES, AMPER
AIC	AVAILABLE INTERRUPTING CAPACITY
AWG	AMERICAN WIRE GAUGE
C	CONDUIT, CLOSE, CONTROL
CB	CIRCUIT BREAKER
CLG	CEILING
COORD	COORDINATE
CU	COPPER
DIM	DIMENSION
DWG	DRAWING
EA	EACH
EL	ELEVATION
FT	FOOT, FEET
G, GND	GROUND
GFCI	GROUND FAULT CIRCUIT INTERRUPTER
GFI	GROUND FAULT INTERRUPTER
HT	HEIGHT
IN	INCH, INCHES
KVA	KILOVOLT AMPERES
KW	KILOWATT
LED	LIGHT EMITTING DIODE
MIN	MINIMUM
MT, MTD	MOUNT, MOUNTED
N/A	NOT APPLICABLE
NEC	NATIONAL ELECTRIC CODE
NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
NTS	NOT TO SCALE
OC	ON CENTER
REQD	REQUIRED
RM	ROOM
S	SWITCH
SHT	SHEET
TYP	TYPICAL
UL	UNDERWRITERS LABORATORIES
UON	UNLESS OTHERWISE NOTED
V	VOLTS, VOLTAGE
W	WITH
W/O	WITHOUT





Connections / Equipment

	OR		JUNCTION BOX
			WALL-MOUNTED JUNCTION BOX





General

	DEMOLISH
	EXISTING WORK
	NEW WORK
	DETAIL NUMBER AND SHEET LOCATION
	KEYED NOTE


Miscellaneous

	#10 B-27, 29, 31.	BRANCH CIRCUIT WIRING. ARROW INDICATES HOME RUN TO PANEL WITH CIRCUITS AS NOTED. WIRE SIZE IS #12 AWG MINIMUM UNLESS NOTED OTHERWISE. SHORT TICK MARKS INDICATE PHASE CONDUCTORS. LONG TICK MARKS INDICATE NEUTRAL CONDUCTORS. A SINGLE CURVED TICK MARK INDICATES INSULATED GREEN GROUND CONDUCTOR. SECOND CURVED TICK MARK INDICATES "ISOLATED GROUND" (GREEN INSULATION WITH YELLOW STRIPE) CONDUCTOR.
		BRANCH PANEL
		FLUSH WALL MOUNTED BRANCH PANEL
		GROUNDING POINT

Raceways

	CONDUIT CONCEALED IN WALL OR CEILING SPACE
	CONDUIT ROUTED BELOW FLOOR / GRADE
	CONDUIT/WIRING CONTINUATION
	CONDUIT/WIRING STUBBED OUT WITH END CAP OR INSULATED PLASTIC BUSHING

Switches and Receptacles

	SPECIAL PURPOSE RECEPTACLE. LETTER CODE DENOTES RECEPTACLE CONFIGURATION LX-XXR = NEMA CONFIGURATION TWIST-LOCK RECEPTACLE X-XXR = NEMA CONFIGURATION STRAIGHT BLADE RECEPTACLE P = PENDANT MOUNT WITH CORD GRIPS. VERIFY PENDANT LENGTH X = COORDINATE RECEPTACLE CONFIGURATION WITH EQUIPMENT BEING SUPPLIED
---	--

GENERAL ELECTRICAL NOTES

- A. DO NOT COMMENCE INSTALLATION OF ELECTRICAL SYSTEMS AND EQUIPMENT WITHOUT RELATED SHOP DRAWING APPROVALS.
- B. ELECTRICAL CIRCUITS SHALL BE INTERRUPTED ONLY WITH PRIOR WRITTEN CONSENT. SUCH INTERRUPTIONS SHALL BE PRECEDED BY ALL POSSIBLE PREPARATIONS BY THE CONTRACTOR WHICH ARE NECESSARY TO KEEP THE ELECTRICAL CIRCUITS OFF FOR A MINIMUM PERIOD IN AN EXPEDITIOUS MANNER PURSUANT WITH GOOD WORKMANSHIP. THIS INCLUDES CIRCUIT TRACING TO IDENTIFY THE ELECTRICAL LOAD BEING SERVED AND THE ORIGIN OF THE CIRCUIT.
- C. COORDINATE WITH OWNER SO THAT WORK CAN BE SCHEDULED NOT TO INTERRUPT OPERATIONS, NORMAL ACTIVITIES, BUILDING ACCESS, ACCESS TO DIFFERENT AREAS. THE OWNER WILL COOPERATE TO THE BEST OF THEIR ABILITY TO ASSIST IN A COORDINATED SCHEDULE, BUT WILL REMAIN THE FINAL AUTHORITY AS TO TIME OF WORK PERMITTED.
- D. COORDINATE THE EXACT LOCATION OF EXISTING UTILITIES AND EQUIPMENT PRIOR TO COMMENCEMENT OF WORK. COMPENSATE THE OWNER FOR DAMAGES CAUSED BY THE FAILURE TO LOCATE AND PRESERVE UTILITIES. REPLACE DAMAGED ITEMS WITH NEW MATERIAL TO MATCH EXISTING.
- E. REMOVE EXISTING LUMINAIRES, SWITCHES, RECEPTACLES, AND OTHER ELECTRICAL EQUIPMENT AND DEVICES AND ASSOCIATED WIRING FROM WALLS, CEILINGS, FLOORS, AND OTHER SURFACES SCHEDULED FOR REMODELING, RELOCATION, OR DEMOLITION UNLESS SHOWN AS RETAINED OR RELOCATED ON DRAWINGS.
- F. MAINTAIN ELECTRICAL CONTINUITY OF EXISTING SYSTEMS. REMOVE OR RELOCATE ELECTRICAL BOXES, CONDUIT, WIRING, EQUIPMENT, LUMINAIRES, AND THE LIKE, AS REQUIRED IN REMOVED OR REMODELED AREAS IN THE EXISTING CONSTRUCTION AFFECTED BY THIS WORK.
- G. REMOVE AND RESTORE WIRING WHICH SERVES USABLE EXISTING OUTLETS CLEAR OF THE CONSTRUCTION OR DEMOLITION.
- H. IF EXISTING JUNCTION BOXES WILL BE MADE INACCESSIBLE, OR IF ABANDONED OUTLETS SERVE AS FEED THROUGH BOXES FOR OTHER EXISTING ELECTRICAL EQUIPMENT WHICH IS BEING RETAINED, PROVIDE NEW CONDUIT AND WIRE TO BYPASS THE ABANDONED OUTLETS.
- I. IF EXISTING CONDUITS PASS THROUGH PARTITIONS OR CEILING WHICH ARE BEING REMOVED OR REMODELED, PROVIDE NEW CONDUIT AND WIRE TO REROUTE CLEAR OF THE CONSTRUCTION OR DEMOLITION AND MAINTAIN SERVICE TO THE EXISTING LOAD.
- J. CONCEALED CONDUIT LOCATED IN CONCRETE WALLS OR HARDBOARD CEILING SPACES MAY BE ABANDONED IN PLACE, REMOVE CONDUCTORS AND TAG ABANDONED CONDUITS WITH CORRESPONDING SYSTEM AND TERMINATION POINT. CUT AND CAP ABANDONED CONDUIT. DO NOT EXTEND STUBS ABOVE FINISHED FLOOR.
- K. EXTEND CIRCUITING AND DEVICES IN EXISTING WALLS TO BE FURRED OUT.
- L. PROVIDE TEMPORARY SUPPORT FOR ELECTRICAL SYSTEMS THAT REMAIN IN PLACE.
- M. VERIFY EXACT LOCATION AND NUMBER OF EXISTING ELECTRICAL OUTLETS AND LUMINAIRES IN THE FIELD. LOCATIONS OF ITEMS SHOWN ON DRAWINGS AS EXISTING ARE PARTIALLY BASED ON RECORD AND OTHER DRAWINGS WHICH MAY CONTAIN ERRORS. VERIFY THE ACCURACY OF THE INFORMATION SHOWN PRIOR TO BIDDING AND PROVIDE SUCH LABOR AND MATERIAL AS IS NECESSARY TO ACCOMPLISH THE INTENT OF THE CONTRACT DOCUMENTS.
- N. REMOVE ABANDONED WIRING TO LEAVE SITE CLEAN.
- O. EXISTING LIGHTING WHICH IS TO REMAIN OR BE RELOCATED IS TO BE RELAMPED, REBALLASTED, AND CLEANED. LEAVE ALL LUMINAIRES IN PROPER WORKING ORDER. REPLACE DAMAGED OR BROKEN LENS AND/OR COMPONENTS.
- P. MAINTAIN ACCESS TO EXISTING ELECTRICAL INSTALLATIONS WHICH REMAIN ACTIVE. MODIFY INSTALLATION OR PROVIDE ACCESS PANEL AS APPROPRIATE.
- Q. WHERE DRAWINGS INDICATE EXISTING ELECTRICAL EQUIPMENT OR DEVICES TO BE RELOCATED AND/OR REUSED, REFURBISH THEM. THOROUGHLY CLEAN SUCH ITEMS. NOTIFY ARCHITECT OF ANY DEFECTS IN SUCH INSTALLATIONS. REPAIR ANY DAMAGE CAUSED BY DEMOLITION OR CONSTRUCTION PERFORMED UNDER THIS CONTRACT.
- R. PROVIDE UPDATED PANEL SCHEDULES AND DIRECTORIES THAT IDENTIFY EXISTING CIRCUITS AND NUMBER OF SPARE CIRCUITS AVAILABLE UPON COMPLETION OF DEMOLITION WORK.
- S. OFFER REMOVED LUMINAIRES, WIRING DEVICES, PANELBOARDS AND EQUIPMENT TO THE OWNER. IF OWNER CHOOSES TO RETAIN THESE ITEMS, RETURN SUCH ITEMS TO OWNER. CAREFULLY REMOVE AND DISPOSE OF ITEMS REJECTED BY OWNER FROM PROJECT SITE AND IN A LEGAL MANNER.
- T. RECONNECT EXISTING LUMINAIRES NOT SHOWN ON DRAWINGS AND AFFECTED DUE TO DEMOLITION TO NEAREST AVAILABLE EXISTING LIGHTING CIRCUIT ABLE TO TAKE THE ADDITIONAL LOAD.
- U. REFER TO SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
- V. DRAWINGS AND SPECIFICATIONS COMPLIMENT EACH OTHER. REQUIREMENT BY EITHER INFERS REQUIREMENT BY BOTH.
- W. CONNECT EQUIPMENT AND DEVICES FURNISHED UNDER OTHER DIVISIONS OF THIS CONTRACT, BY OWNER OR BY OTHER CONTRACTS.
- X. UNLESS OTHERWISE NOTED, PROVIDE CONCEALED AND FLUSH MOUNTED INSTALLATION OF DEVICES AND EQUIPMENT IN AREAS.
- Y. PROVIDE SEPARATE EQUIPMENT GROUNDING CONDUCTOR IN 120 VOLT, MULTI-WIRE CIRCUITS.
- Z. FOR 120 VOLT, 20 AMP CIRCUITS, WHERE CIRCUIT DISTANCE FROM PANELBOARD TO FARTHEST DEVICE/FIXTURE EXCEEDS 75 FEET, PROVIDE #10 SIZE CONDUCTOR.
- AA. RUN ELECTRICAL CONDUIT CONCEALED AND PARALLEL TO BUILDING LINES. VERIFY WITH ARCHITECT.
- AB. RECEPTACLE OUTLETS SHALL COMPLY WITH CEC SECTION 210.7.
- AC. LIGHTS, SWITCHES AND CONTROL MECHANISMS SHALL COMPLY WITH CEC SECTION 404.
- AD. BRACE ELECTRICAL EQUIPMENT TO RESIST A HORIZONTAL FORCE THAT ACT IN ANY DIRECTION. COMPLY WITH TITLE 24 REQUIREMENTS.
- AE. INSTALL COMPLETE SYSTEM OF CONDUCTORS IN RACEWAY SYSTEM THROUGHOUT BUILDING FOR FEEDERS, BRANCH CIRCUITS, ETC.

SHEET INDEX

E0.1	SYMBOL LIST AND GENERAL NOTES - ELECTRICAL
E2.1	FLOOR PLAN - LIGHTING
E2.2	LIGHTING CONTROL FLOOR PLANS



Date Signed: 9/9/14

PROJECT CONTRACT
2014.0330
Jason Lau

717 Market Street
Suite 500
Berkeley, CA 94710
Tel: 415.888.7240
Fax: 415.888.7289
www.interfaceengineering.com

LANDRY & BOGANS
THEATRE CONSULTANTS
733 W. Evelyn Ave. Mountain View, CA 94041
(650) 969-5195 Fax 650-4965
heather@landb.com


SAN MATEO COUNTY COMMUNITY COLLEGE DISTRICT
CAÑADA/COLLEGE OF SAN MATEO
THEATER HOUSE LIGHTING RETROFIT
CAÑADA COLLEGE - BUILDING 3
4200 FARM HILL BOULEVARD, REDWOOD CITY, CA 94061

REVISIONS
.
.
.
.
.

SHEET TITLE
THEATER HOUSE
LIGHTING RETROFIT
SYMBOL LIST AND
GENERAL NOTES
- ELECTRICAL

SCALE: NO SCALE
DATE: Sept. 9, 2014

E0.1

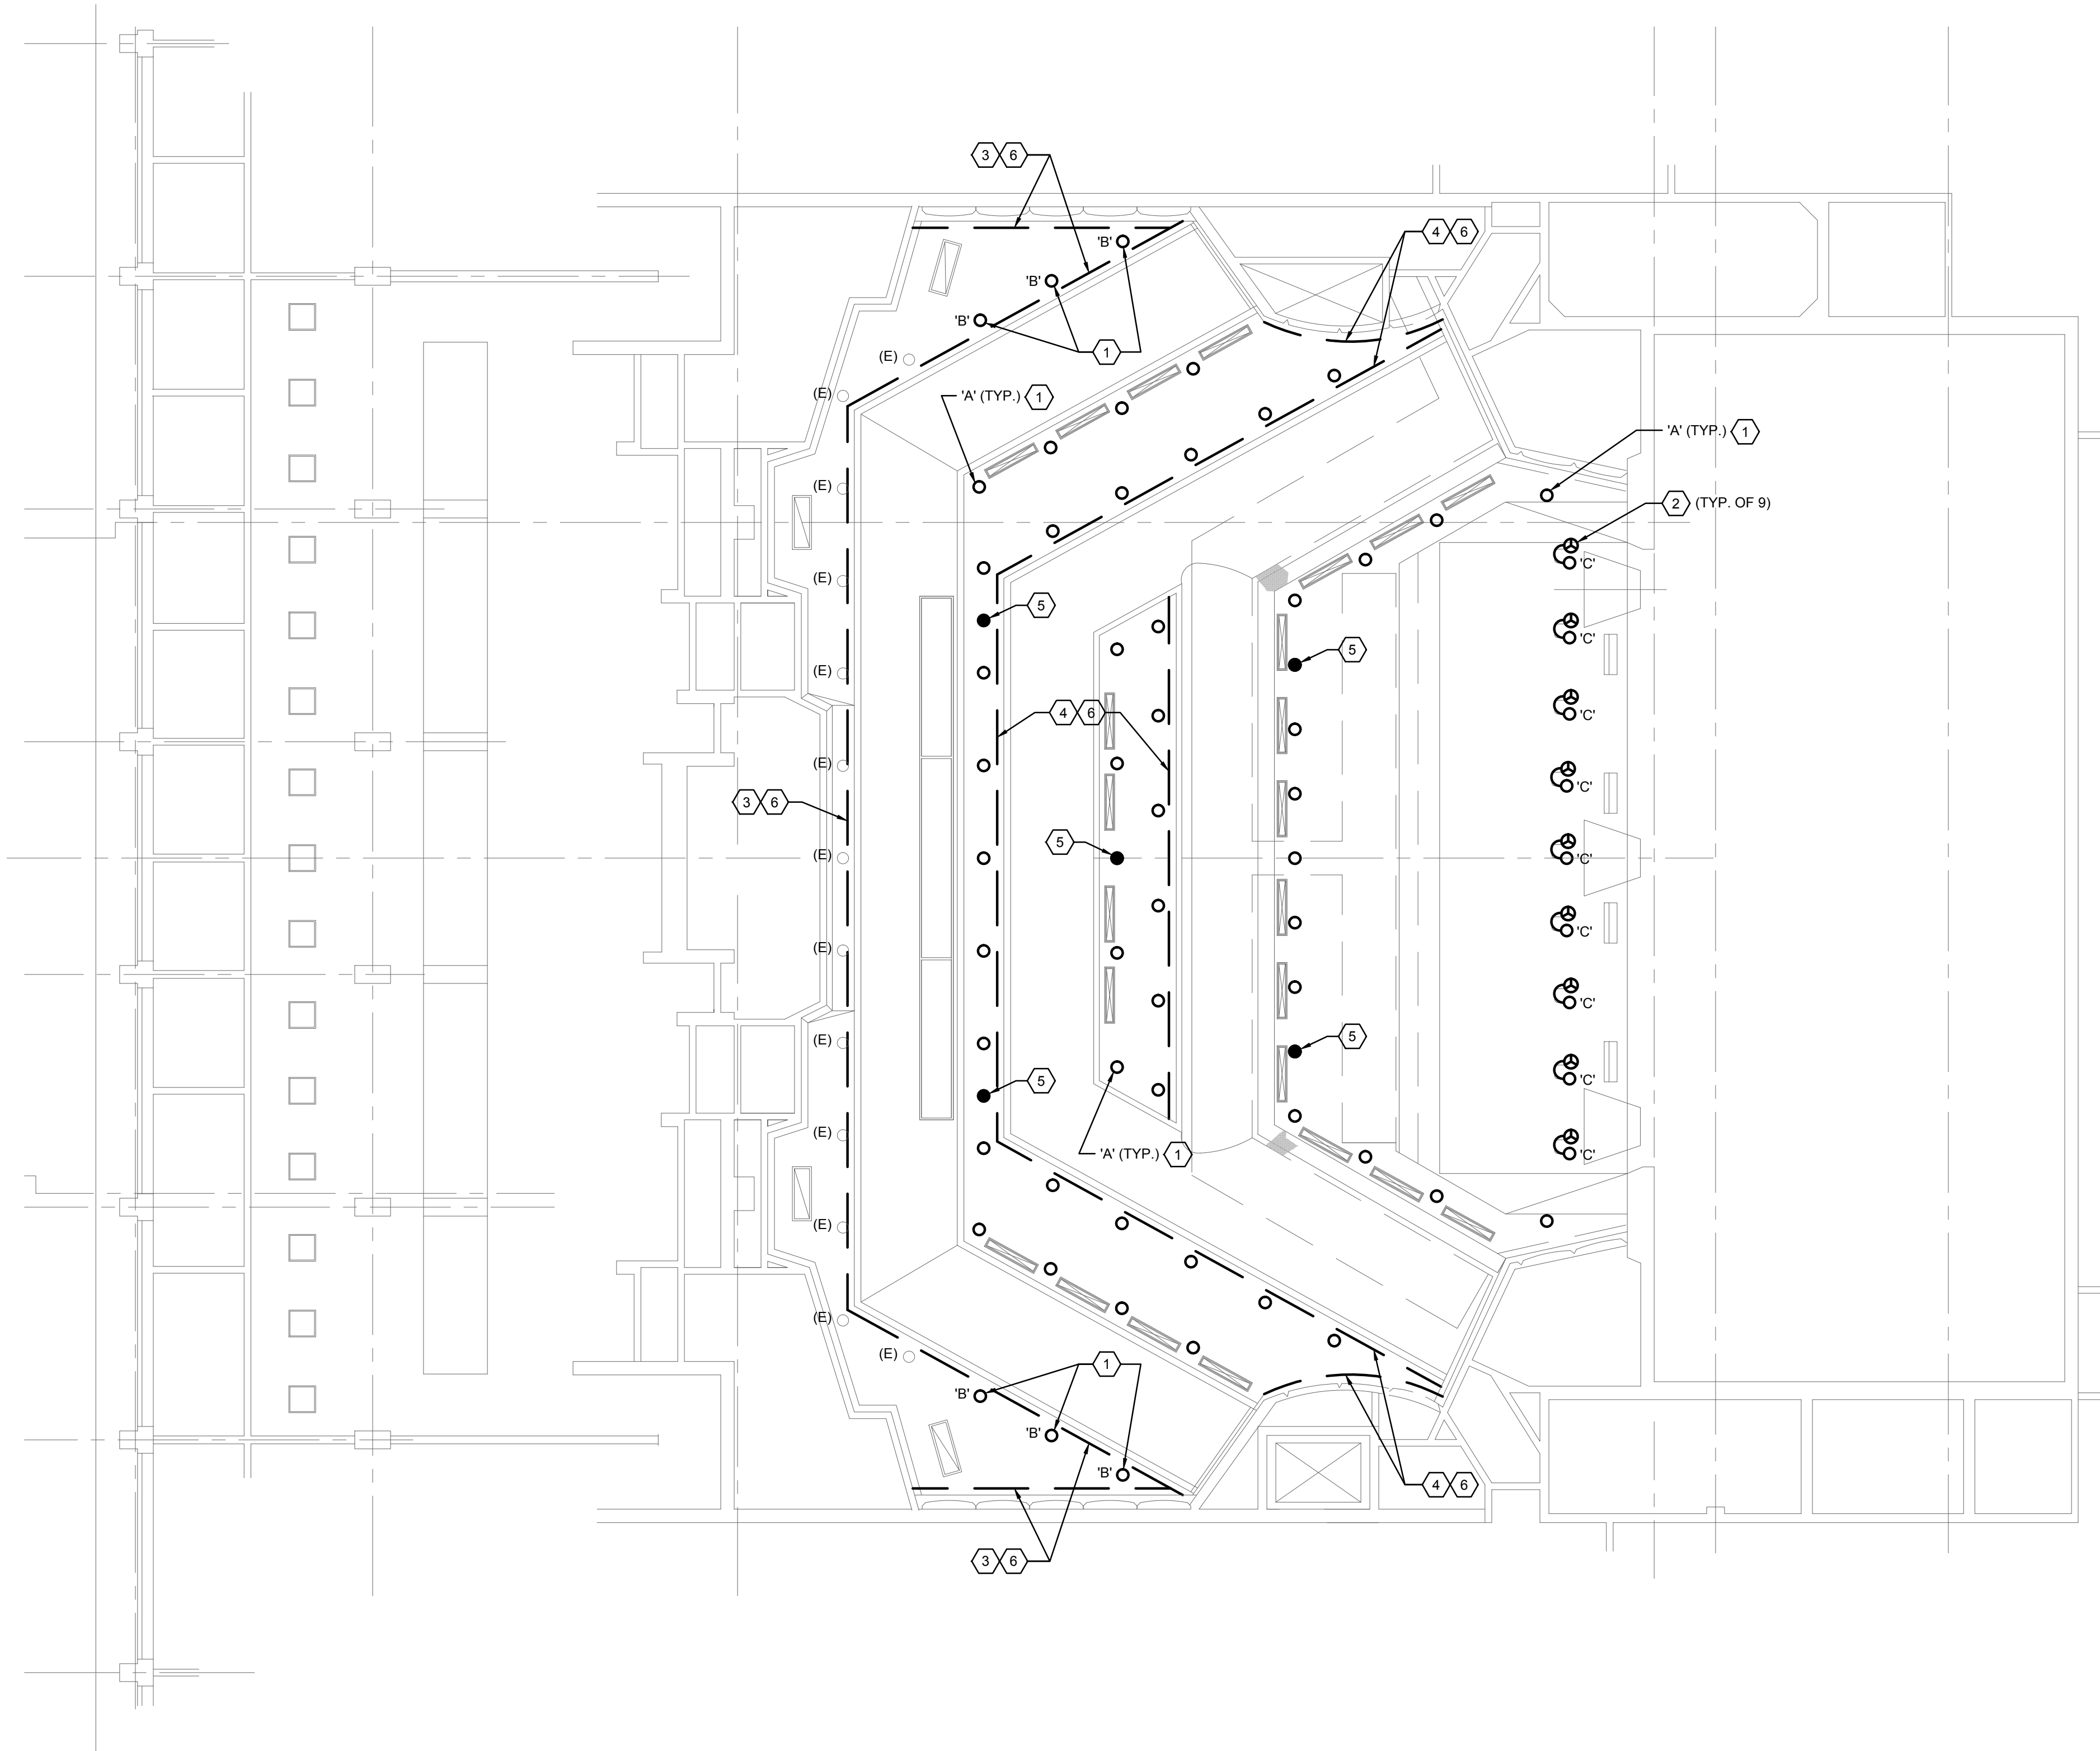

1 FLOOR PLAN - LIGHTING
 0 4' 8' 16'
 SCALE: 1/8"=1'-0"

GENERAL SHEET NOTES

- A. COORDINATE EXACT LOCATION AND MOUNTING HEIGHT OF LUMINAIRES AND LIGHTING CONTROLS WITH THEATRICAL LIGHTING CONSULTANT PRIOR TO INSTALLATION.
- B. REFER TO THEATRICAL LIGHTING CONSULTANT DRAWINGS FOR ADDITIONAL INFORMATION AND LIGHTING CONTROL REQUIREMENTS.
- C. REFER TO THEATRICAL LIGHTING CONSULTANT DRAWINGS FOR LUMINAIRE SCHEDULE AND SYMBOLS.
- D. EXISTING LUMINAIRES AND LIGHTING CONTROLS NOT SHOWN ON PLAN SHALL REMAIN, U.O.N.

SHEET KEYNOTES

- 1 DISCONNECT AND REUSE EXISTING LIGHTING CIRCUIT AS PART OF LED LUMINAIRE REPLACEMENT. LUMINAIRES TO BE RECONNECTED BACK TO EXISTING DIMMER RACK.
- 2 DISCONNECT AND REMOVE EXISTING LUMINAIRES AND PROVIDE NEMA L5-20R RECEPTACLE FOR CONNECTION TO NEW REPLACEMENT TYPE 'C' LUMINAIRES. REUSE EXISTING JUNCTION BOX AND CIRCUIT FOR NEW RECEPTACLE.
- 3 RELAMP/REPAIR EXISTING FLUORESCENT LUMINAIRES TO REMAIN.
- 4 REMOVE EXISTING LAMPS AND ABANDON FLUORESCENT LUMINAIRES IN PLACE.
- 5 REPLACE EXISTING INCANDESCENT LAMP WITH LED RETROFIT LAMP IN EXISTING DOWNLIGHT.
- 6 ADD ALTERNATE: DISCONNECT AND REMOVE EXISTING FLUORESCENT LUMINAIRES WITH NEW TYPE 'D' LUMINAIRES. RECONNECT COMPLETE TO EXISTING LIGHTING CIRCUIT AS REQUIRED TO PLACE BACK INTO SERVICE.

PROJECT CONTACT
 2014.0330
 Jason Lau

717 Market Street
 Suite 500
 San Francisco, CA 94103
 TEL: 415.488.7240
 FAX: 415.488.7289
 www.interfaceengineering.com


LANDRY & BOGANS
 THEATRE CONSULTANTS
 733 W. Evelyn Ave. Mountain View, CA 94041
 (650) 969-5195 Fax 650-4965
 theaterlandb.com

SAN MATEO COUNTY COMMUNITY COLLEGE DISTRICT
 CAÑADA/COLLEGE OF SAN MATEO
 THEATER HOUSE LIGHTING RETROFIT
 CAÑADA COLLEGE - BUILDING 3
 4200 FARM HILL BOULEVARD, REDWOOD CITY, CA 94061

REVISIONS


SHEET TITLE
 THEATER HOUSE
 LIGHTING RETROFIT
 FLOOR PLAN -
 LIGHTING

SCALE: 1/8" = 1'-0"
 DATE: Sept. 9, 2014


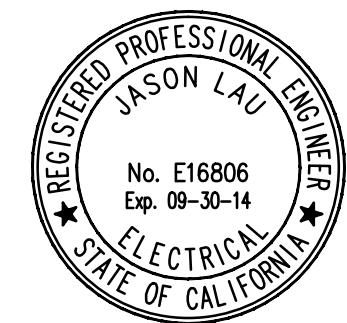


Date Signed: 9/9/14


E2.1

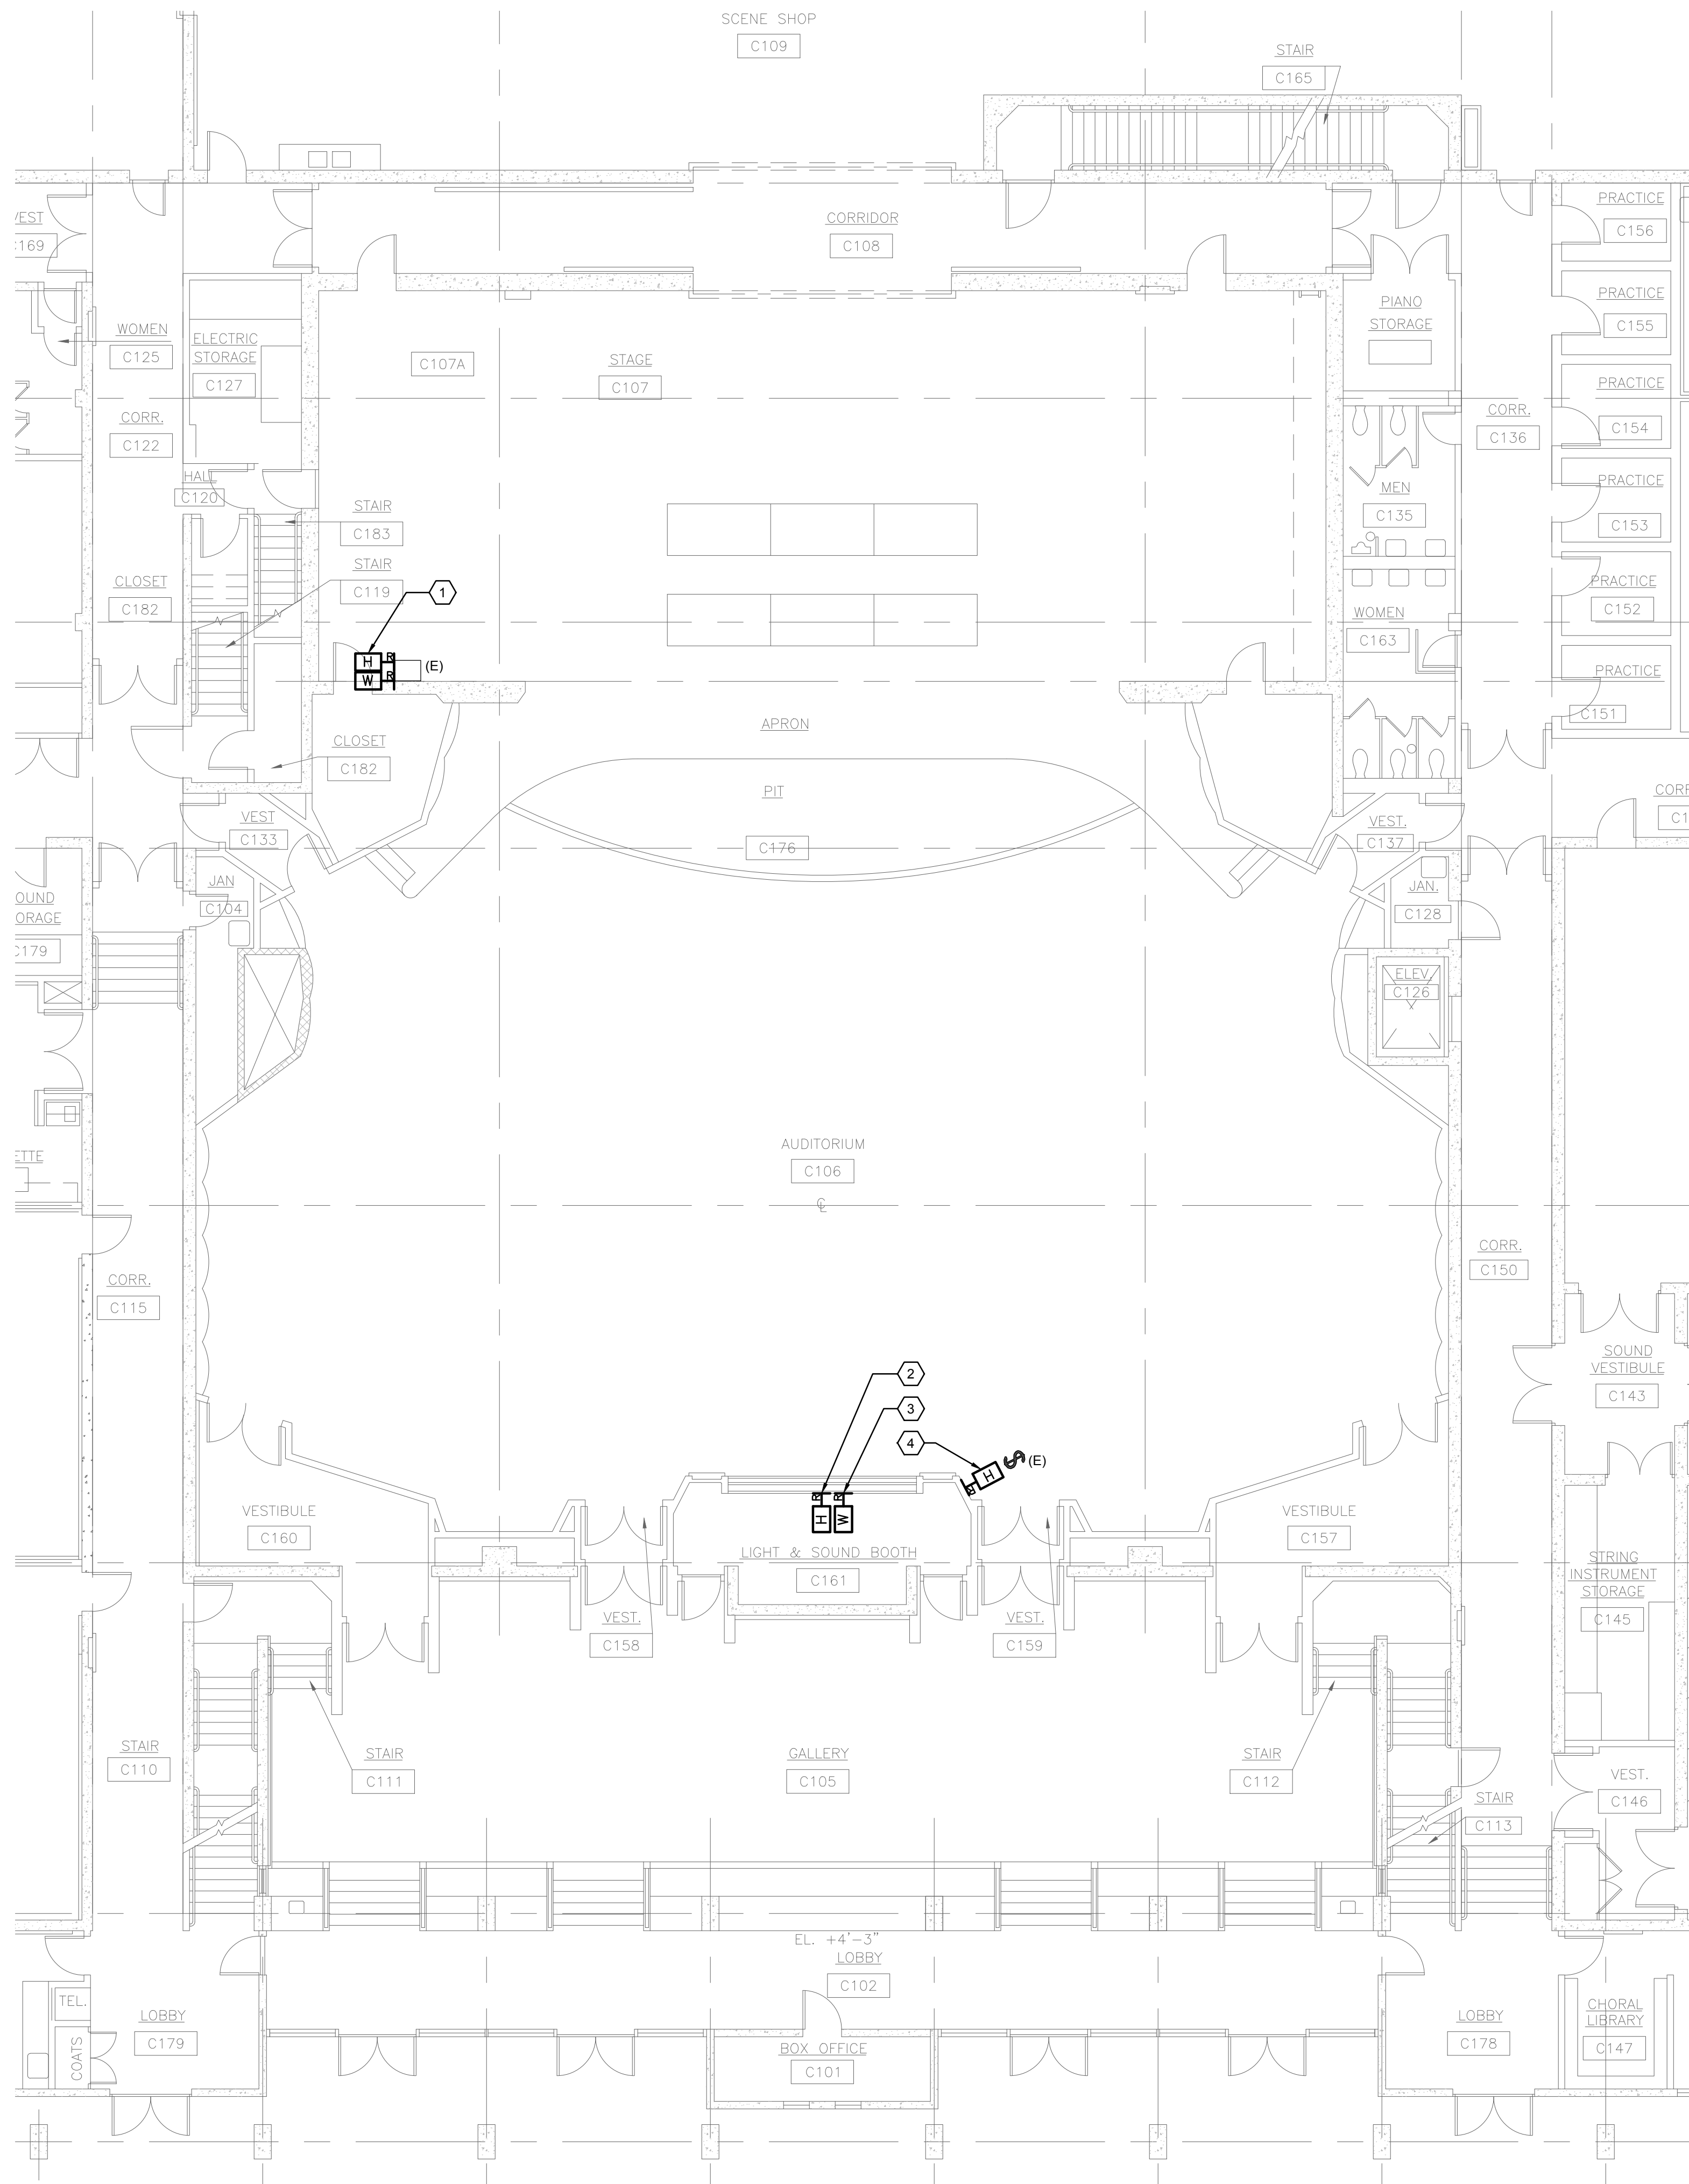

1 LIGHTING CONTROL PLAN - MAIN LEVEL

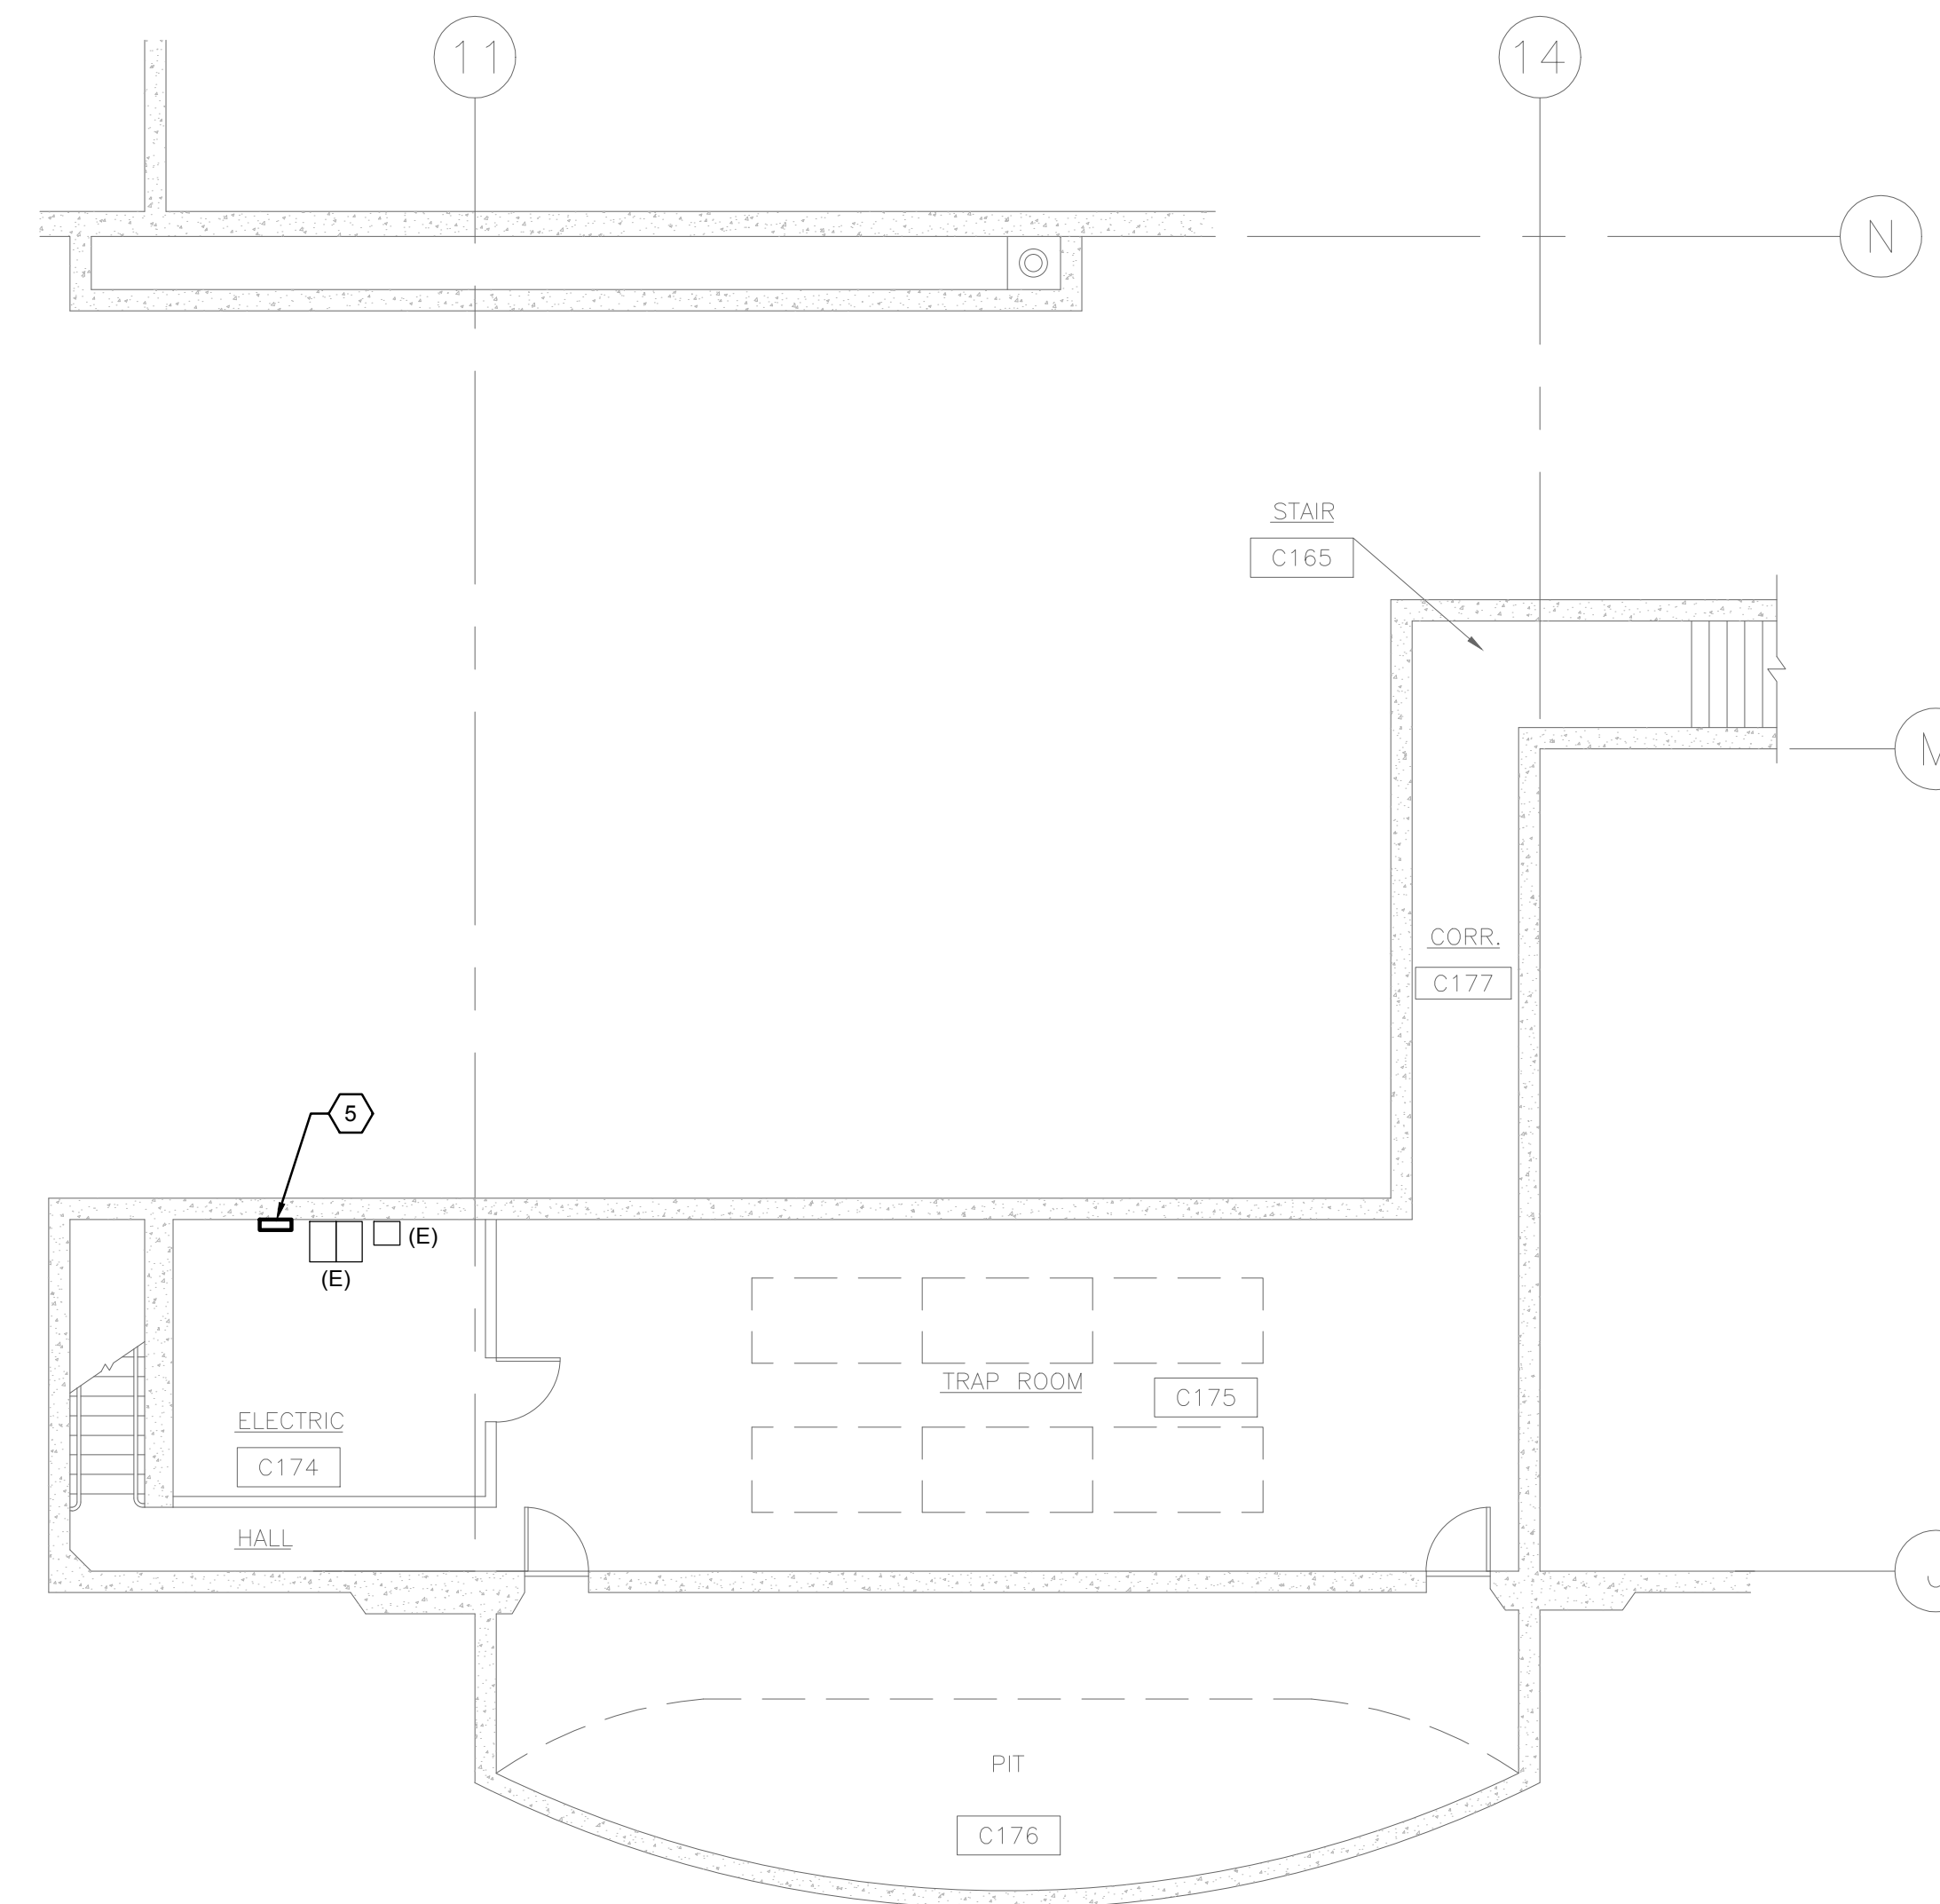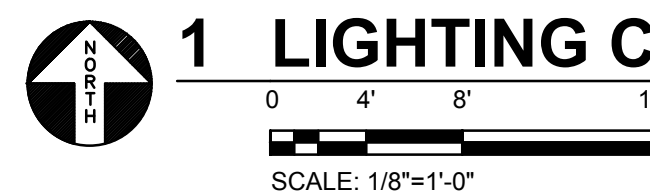

2 LIGHTING CONTROL PLAN - ELECTRICAL ROOM

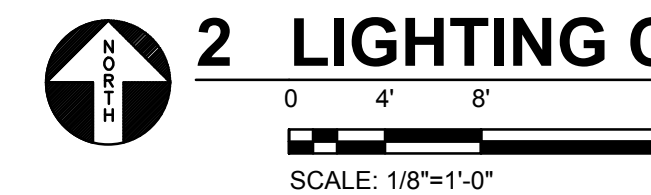

GENERAL SHEET NOTES

- A. COORDINATE EXACT LOCATION AND MOUNTING HEIGHT OF LIGHTING CONTROLS WITH THEATRICAL LIGHTING CONSULTANT PRIOR TO INSTALLATION.
- B. REFER TO THEATRICAL LIGHTING CONSULTANT DRAWINGS FOR ADDITIONAL INFORMATION AND LIGHTING CONTROL REQUIREMENTS.

SHEET KEYNOTES

- 1. DISCONNECT AND REMOVE EXISTING RACK-MOUNTED HOUSE LIGHT CONTROL STATION AND WORKLIGHT CONTROL STATION AND REPLACE WITH NEW STAGE MANAGER'S PANEL WORKLIGHT/HOUSE LIGHT CONTROL PANEL. RECONNECT COMPLETE BACK TO EXISTING CIRCUIT TO PLACE BACK INTO SERVICE.
- 2. DISCONNECT AND REMOVE EXISTING HOUSE LIGHT SLIDER CONTROL STATION AND REPLACE WITH NEW HOUSE LIGHT MASTER STATION 'HLM'. PROVIDE NEW SURFACE BACK BOX AS REQUIRED. RECONNECT COMPLETE BACK TO EXISTING CIRCUIT TO PLACE BACK INTO SERVICE.
- 3. DISCONNECT AND REMOVE EXISTING WORK LIGHT CONTROL STATION AND REPLACE WITH NEW WORKLIGHT CONTROL STATION 'WL'. REUSE EXISTING BACK BOX. RECONNECT COMPLETE BACK TO EXISTING CIRCUIT TO PLACE BACK INTO SERVICE.
- 4. DISCONNECT AND REMOVE EXISTING HOUSE LIGHT CONTROL STATION AND REPLACE WITH NEW HOUSE LIGHT CONTROL STATION 'HL'. REUSE EXISTING BACK BOX AND LOCKING COVER. RECONNECT COMPLETE BACK TO EXISTING CIRCUIT TO PLACE BACK INTO SERVICE.
- 5. DISCONNECT AND REMOVE EXISTING ETC UNISON ER-4 EXTERNAL PROCESSING RACK AND REPLACE WITH NEW ETC UNISON ER2 EXTERNAL PROCESSING RACK WITH 4-PORT NETWORK SWITCH. RECONNECT COMPLETE BACK TO EXISTING CIRCUIT TO PLACE BACK INTO SERVICE.

2014.0330
PROJECT CONTACT
Jason Lau

INTERFACE ENGINEERING

717 Market Street
Suite 500
Berkeley, CA 94710
Tel: 415.888.7240
Fax: 415.888.7289
www.interfaceengineering.com

LANDRY & BOGANS
THEATRE CONSULTANTS


733 W. Evelyn Ave. Mountain View, CA 94041
(650) 969-5195 Fax 650-4965
theatre@landb.com

SAN MATEO COUNTY COMMUNITY COLLEGE DISTRICT
CAÑADA/COLLEGE OF SAN MATEO
THEATER HOUSE LIGHTING RETROFIT
CAÑADA COLLEGE - BUILDING 3
4200 FARM HILL BOULEVARD, REDWOOD CITY, CA 94061

REVISIONS

SHEET TITLE:
THEATER HOUSE
LIGHTING RETROFIT
LIGHTING CONTROL
FLOOR PLAN

SCALE: 1/8" = 1'-0"
DATE: Sept. 9, 2014

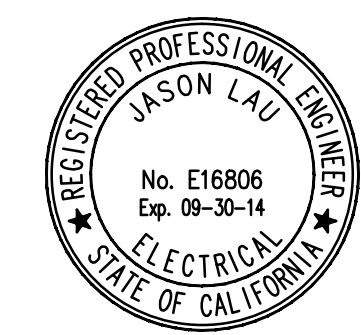

Date Signed: 9/9/14

E2.2

SHEET NOTES


- ① PROVIDE DMX JUMPERS TO DAISY CHAIN DMX SIGNAL FROM FIXTURE TO FIXTURE FOR FIXTURES TYPE A, B & D. SEE ALTERNATES.
- ② DISCONNECT AND REMOVE EXISTING INCANDESCENT DOWNLIGHT FIXTURES AND DISPOSE OF AS DIRECTED BY OWNER. EXISTING APERTURES TO BE REUSED FOR INSTALLATION OF NEW TYPE A & B FIXTURES WITH ADAPTER RINGS. RECONNECT EXISTING WIRE HOME-RUNS (TO EXISTING SENSOR SR24 DIMMER RACK, CIRCUITS 218-232,) TO POWER SUPPLIES OF NEW TYPE A & B FIXTURES.
- ③ REMOVE EXISTING CENTURY LEKOLITE LUMINAIRES AND TURN OVER TO OWNER. MOUNT NEW TYPE 'C' FIXTURES TO EXISTING MOUNTING BRACKETS AND PLUG INTO NEW NEMA L5-20 (TWISTLOCK) RECEPTACLE.
- ④ INSTALL NEW 2-GANG FACEPLATE ON EXISTING 2-GANG JUNCTION BOX WITH NEW NEMA L5-20 (TWISTLOCK) RECEPTACLE. TYPICAL OF 9. VERIFY DIMENSIONS OF EXISTING BACK BOXES IN THE FIELD PRIOR TO MANUFACTURER OF NEW FACEPLATES.
- ⑤ BASE BUILDING CONTRACT. RELAMP/REPAIR ALL EXISTING FLUORESCENT COVE FIXTURES ISO THAT ALL ARE FULLY OPERABLE.
- ⑥ NOT USED
- ⑦ ADD ALTERNATE #1: REMOVE ALL EXISTING FLUORESCENT COVE FIXTURES AND REPLACE WITH FIXTURE TYPE D.
- ⑧ AT EXISTING NORMALLY OFF EMERGENCY LIGHTING FIXTURES: REPLACE INCANDESCENT LAMP WITH LED RETROFIT LAMP (TYPICAL OF 5 EMERGENCY FIXTURES.)

SYMBOL	DESCRIPTION
	Fixture type (see schedule for details)
	Down light luminaire, ceiling mounted in existing opening.
	Indicates fixture on an emergency circuit
	Fluorescent fixture
	Speciality outlet - Single NEMA L5-20 receptacle. Mount on existing 4x4 back box
	Junction box 4-11/16" sq. x 2-1/8" D. U.N.O.
	Toggle switch - SPST
	Existing Worklight Control Station
	Existing House Light Control Station

SCHEDULE OF LIGHTING FIXTURES

REFER TO ARCHITECTURAL DETAILS TO DETERMINE NECESSARY FIXTURE MOUNTING ACCESSORIES AND TO APPLICABLE BUILDING CODES FOR REQUIRED FIXTURE SUPPORTS, AND FOR MAINTAINING CEILING FIRE RATINGS.

TYPE	FIXTURE DESCRIPTION	MFR'S CATALOG NO.	MOUNTING	VOLTAGE	LAMPS/WATTAGE
A	RECESSED LED DOWNLIGHT, 2700 KELVIN, 2500 LUMENS, 45 DEGREE BEAM ANGLE, DMX-RDM CONTROLLED, WITH CEILING OPENING ADAPTER RING	GOTHAM ICO 27/25 6AR 45 120 DMXR, NPP16D, GRA-610JZ (VERIFY OPENING DIMENSIONS)	RECESSED HT. AS NOTED	120	2700K WHITE LED 35 WATTS
B	RECESSED LED DOWNLIGHT, 2700 KELVIN, 2000 LUMENS, 70 DEGREE BEAM ANGLE, DMX-RDM CONTROLLED, WITH CEILING OPENING ADAPTER RING	GOTHAM ICO 27/20 6AR 70 120 DMXR, NPP16D, GRA-610JZ (VERIFY OPENING DIMENSIONS)	RECESSED HT. AS NOTED	120	2700K WHITE LED 35 WATTS
C	THEATRICAL ELLIPSOIDAL REFLECTOR SPOTLIGHT WITH ROTATING LENS BARREL, 36 DEGREE BEAM SPREAD, AND NEMA L5-20 MALE CONNECTOR (NOTE: NO C-CLAMP REQUIRED)	ELECTRONIC THEATER CONTROLS 436	BOLT AT PIVOT POINT TO EXISTING BRACKET	120	HPL 750/115X 1500 HOUR AVG. RATED LIFE, 3050K
D SEE ALTERNATES	DMX CONTROLLED COLOR CHANGING LINEAR LED FIXTURE W/DIE-CAST ALUMINUM HOUSING, POLYCARONATE LENS, RED/GREEN/BLUE LED CHANNELS, 968 LUMEN OUTPUT, 50 DEGREE X 70 DEGREE BEAM SPREAD. PROVIDE FIXTURE QUANTITIES PER PLANS - VERIFY LENGTH IN FIELD. PROVIDE ACCESSORIES FOR A COMPLETE AND FULL FUNCTION LIGHTING SYSTEM INCLUDING POWER SUPPLY/CONTROLS (DATA-ENABLERS), LEAD JUMPERS (FIELD VERIFY LENGTH) AND JUMPER CABLES (FIELD VERIFY LENGTH)	COLOR KINETICS iCOLOR COVE MX POWERCORE #123-000004-08 #106-000004-00 #108-0000045-00 #108-00049-01	SURFACE	120	LED R/G/B

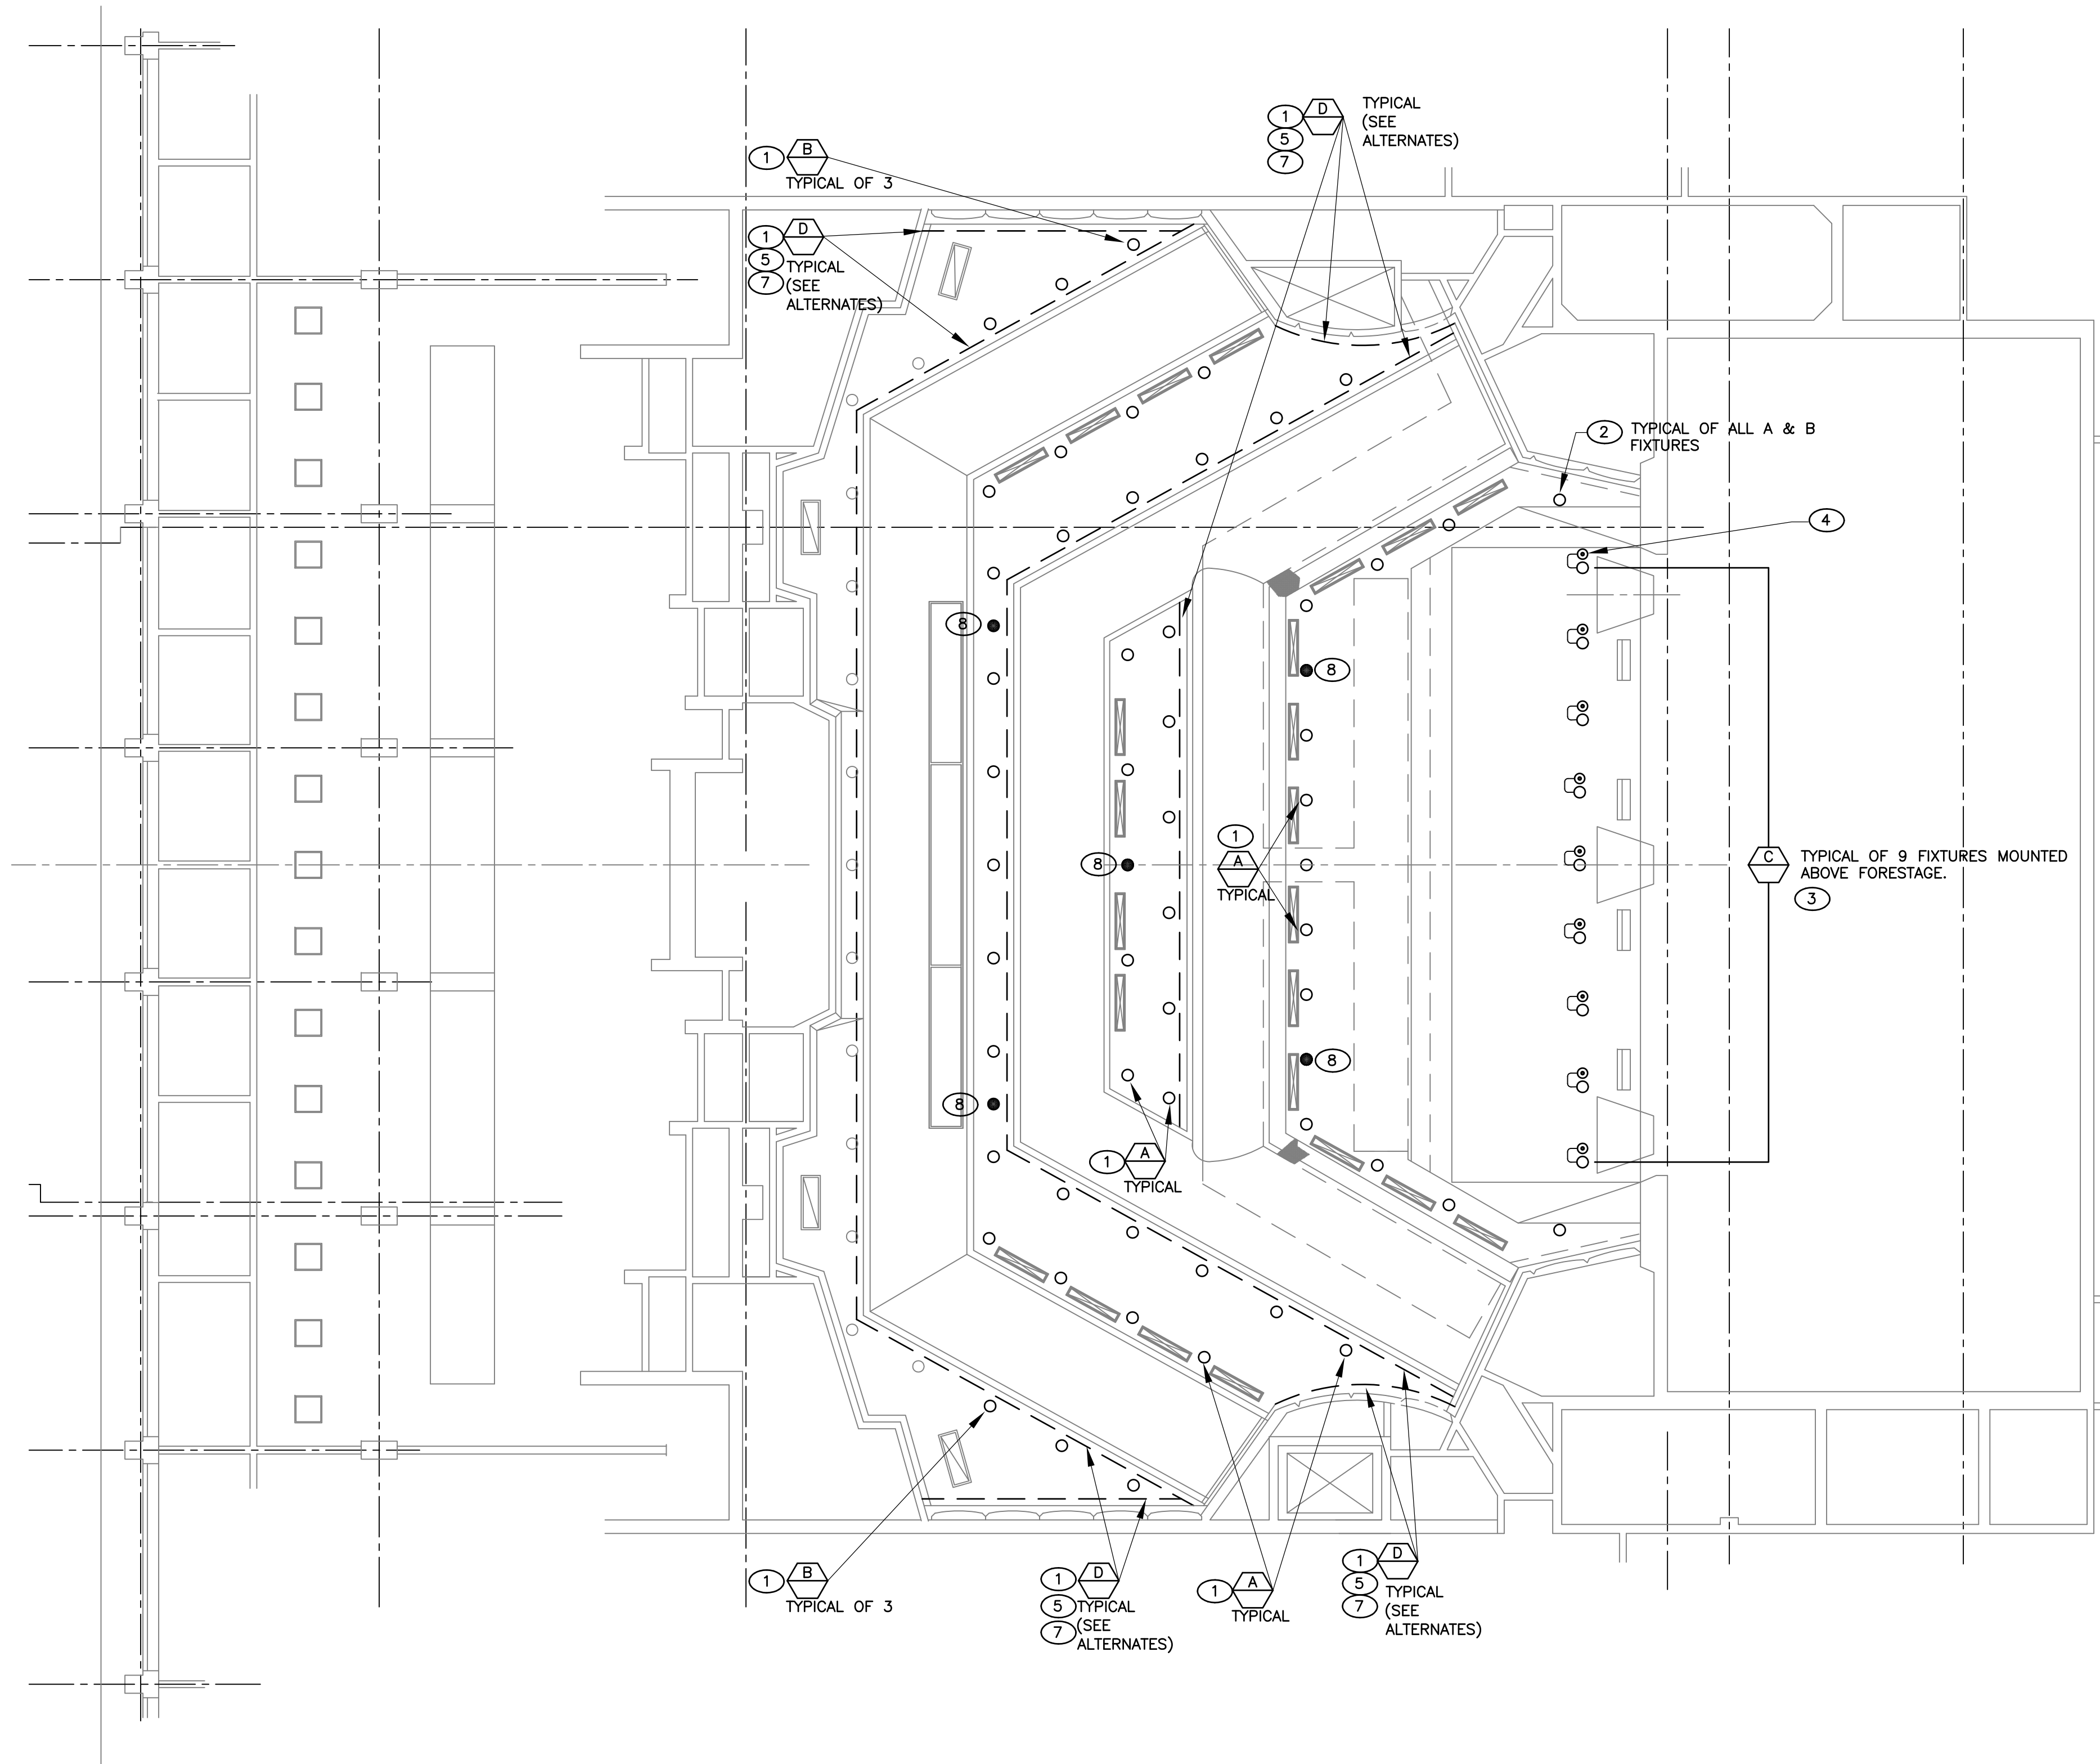

1 REFLECTED CEILING PLAN
1/8" = 1'-0"

LANDRY & BOGAN
THEATRE CONSULTANTS
733 W Evelyn Ave, Mountain View, CA 94041
(650) 969-5195 Fax 969-4965
theatre@landb.com


SAN MATEO COUNTY COMMUNITY COLLEGE DISTRICT
CAÑADA/COLLEGE OF SAN MATEO
THEATER HOUSE LIGHTING RETROFIT
CAÑADA COLLEGE - BUILDING 3
4200 FARM HILL BOULEVARD, REDWOOD CITY, CA 94061

REVISIONS
.....
.....
.....
.....
.....
.....


SHEET TITLE
THEATER HOUSE LIGHTING RETROFIT REFLECTED CEILING PLAN

SCALE: AS NOTED
DATE: September 16, 2014

TL2.1

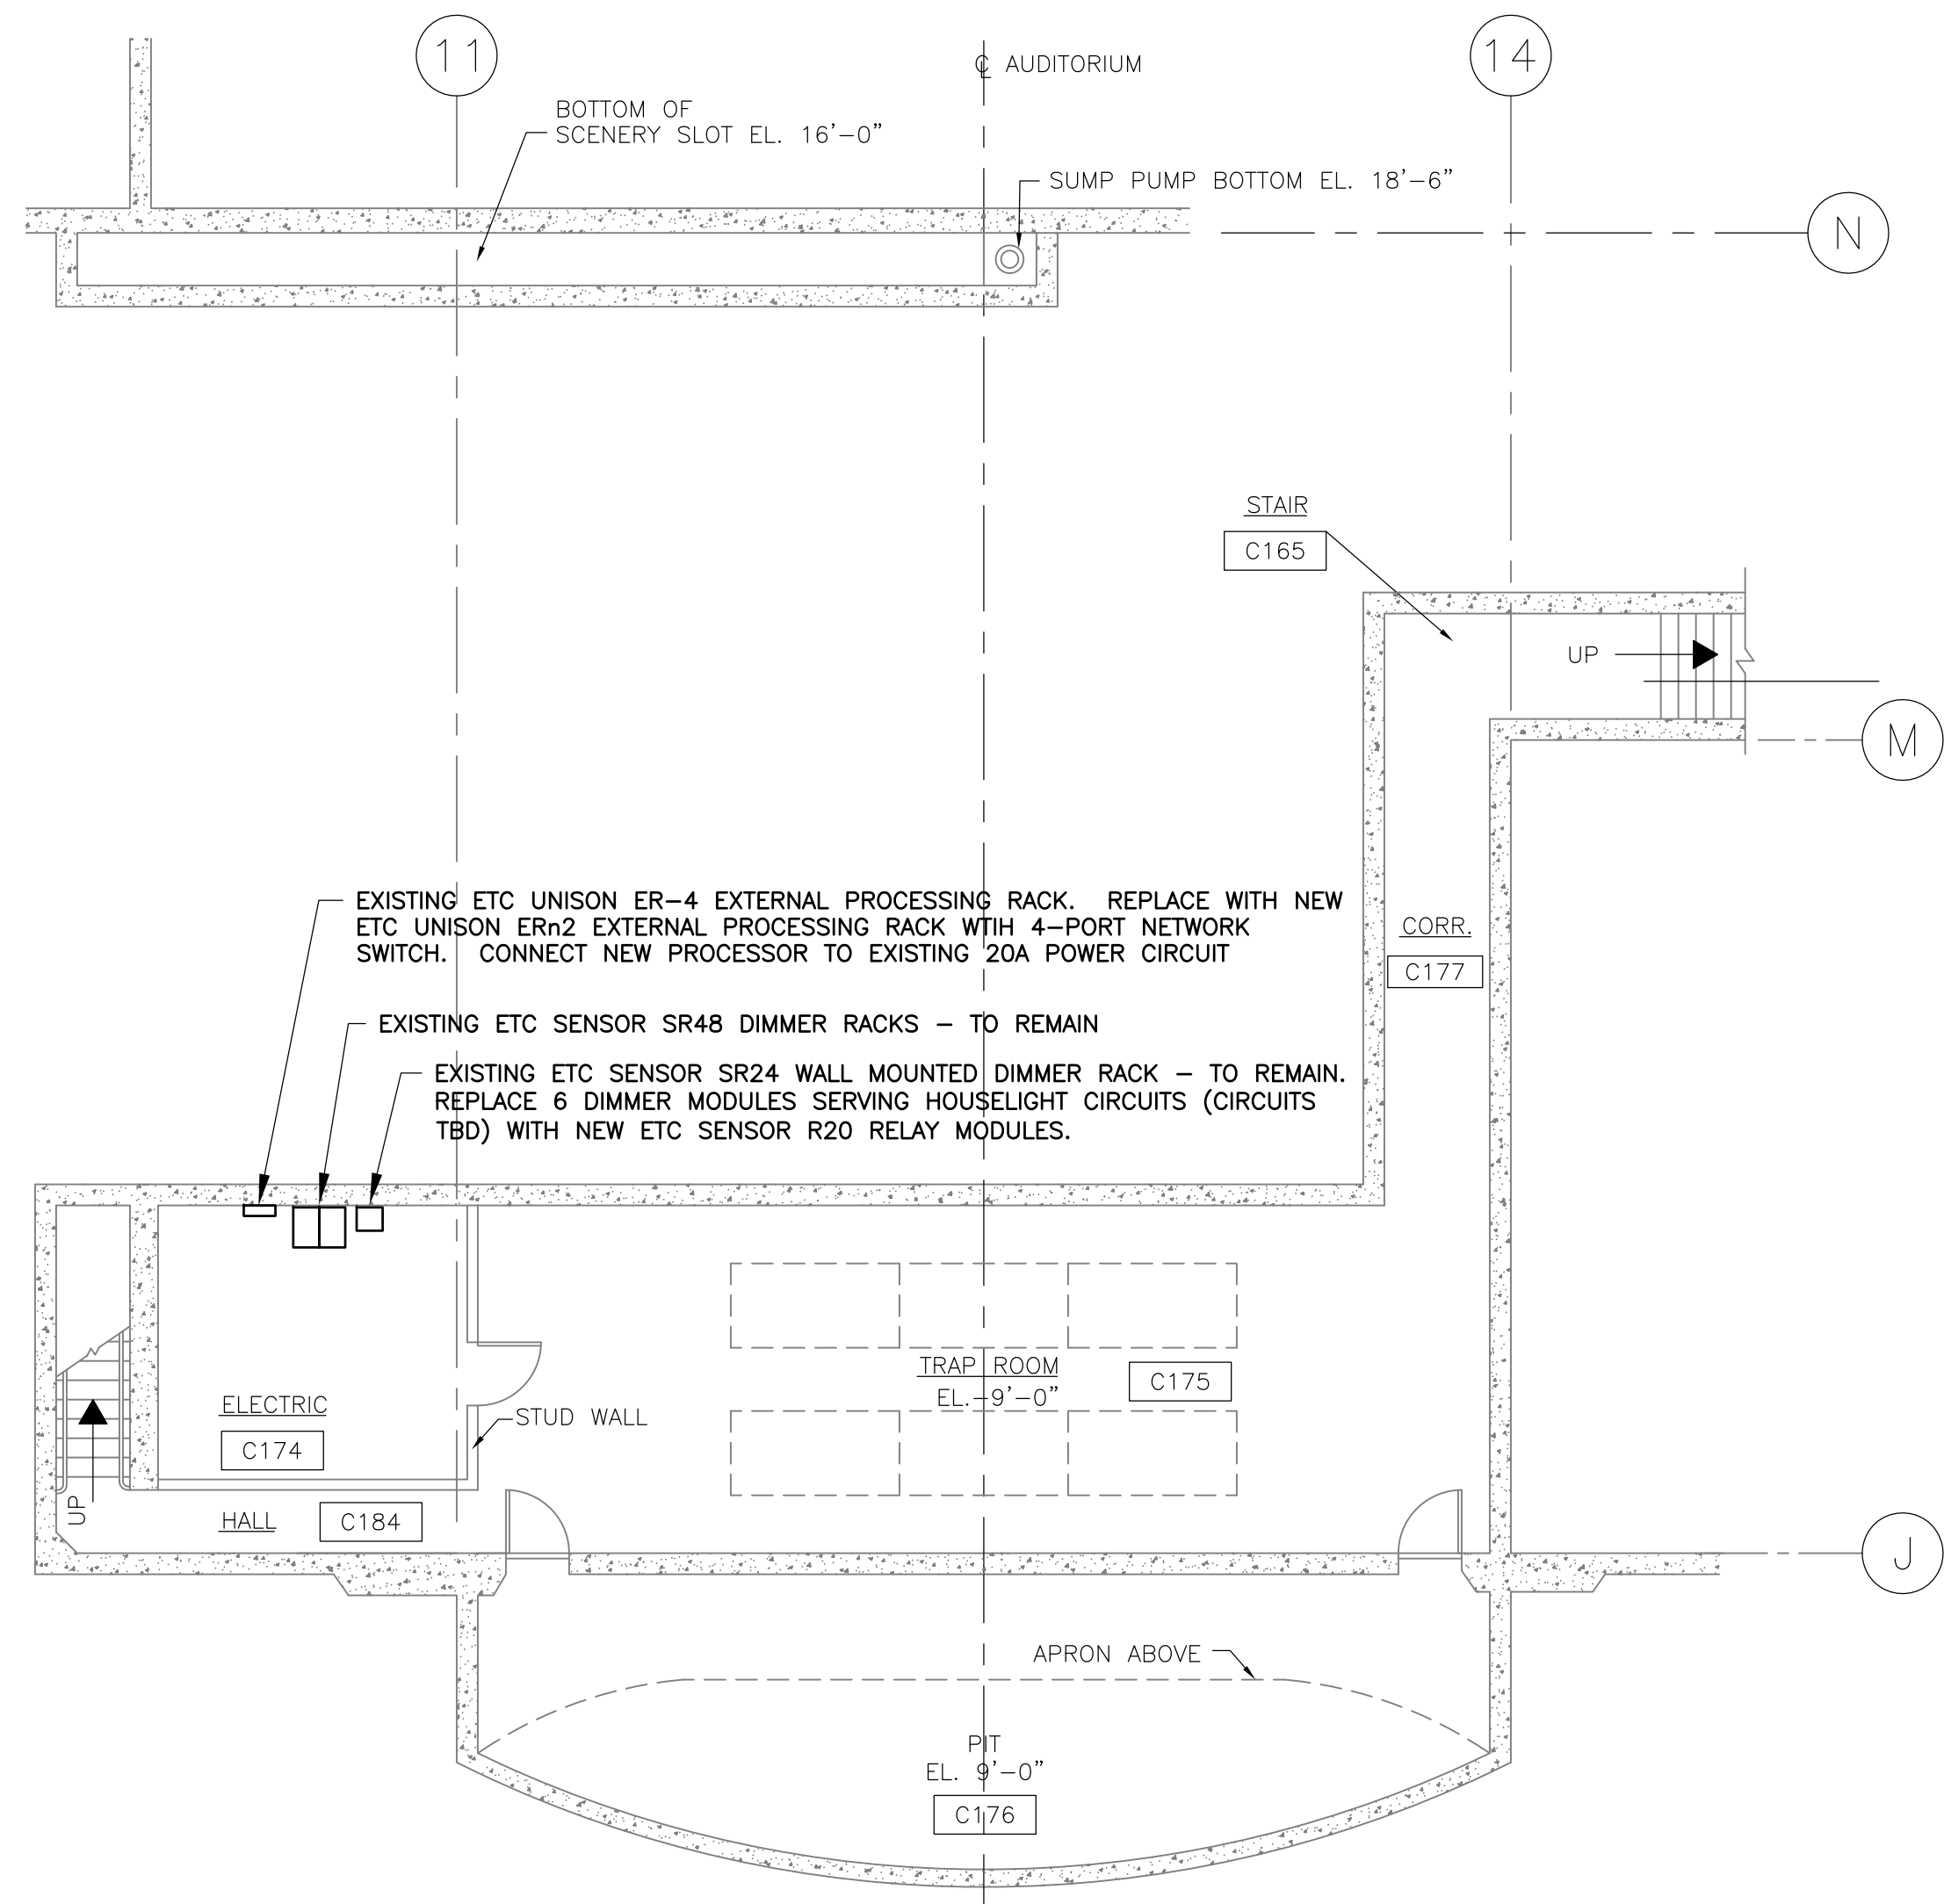

1 LIGHTING CONTROL PLAN - MAIN LEVEL
1/8" = 1'-0"

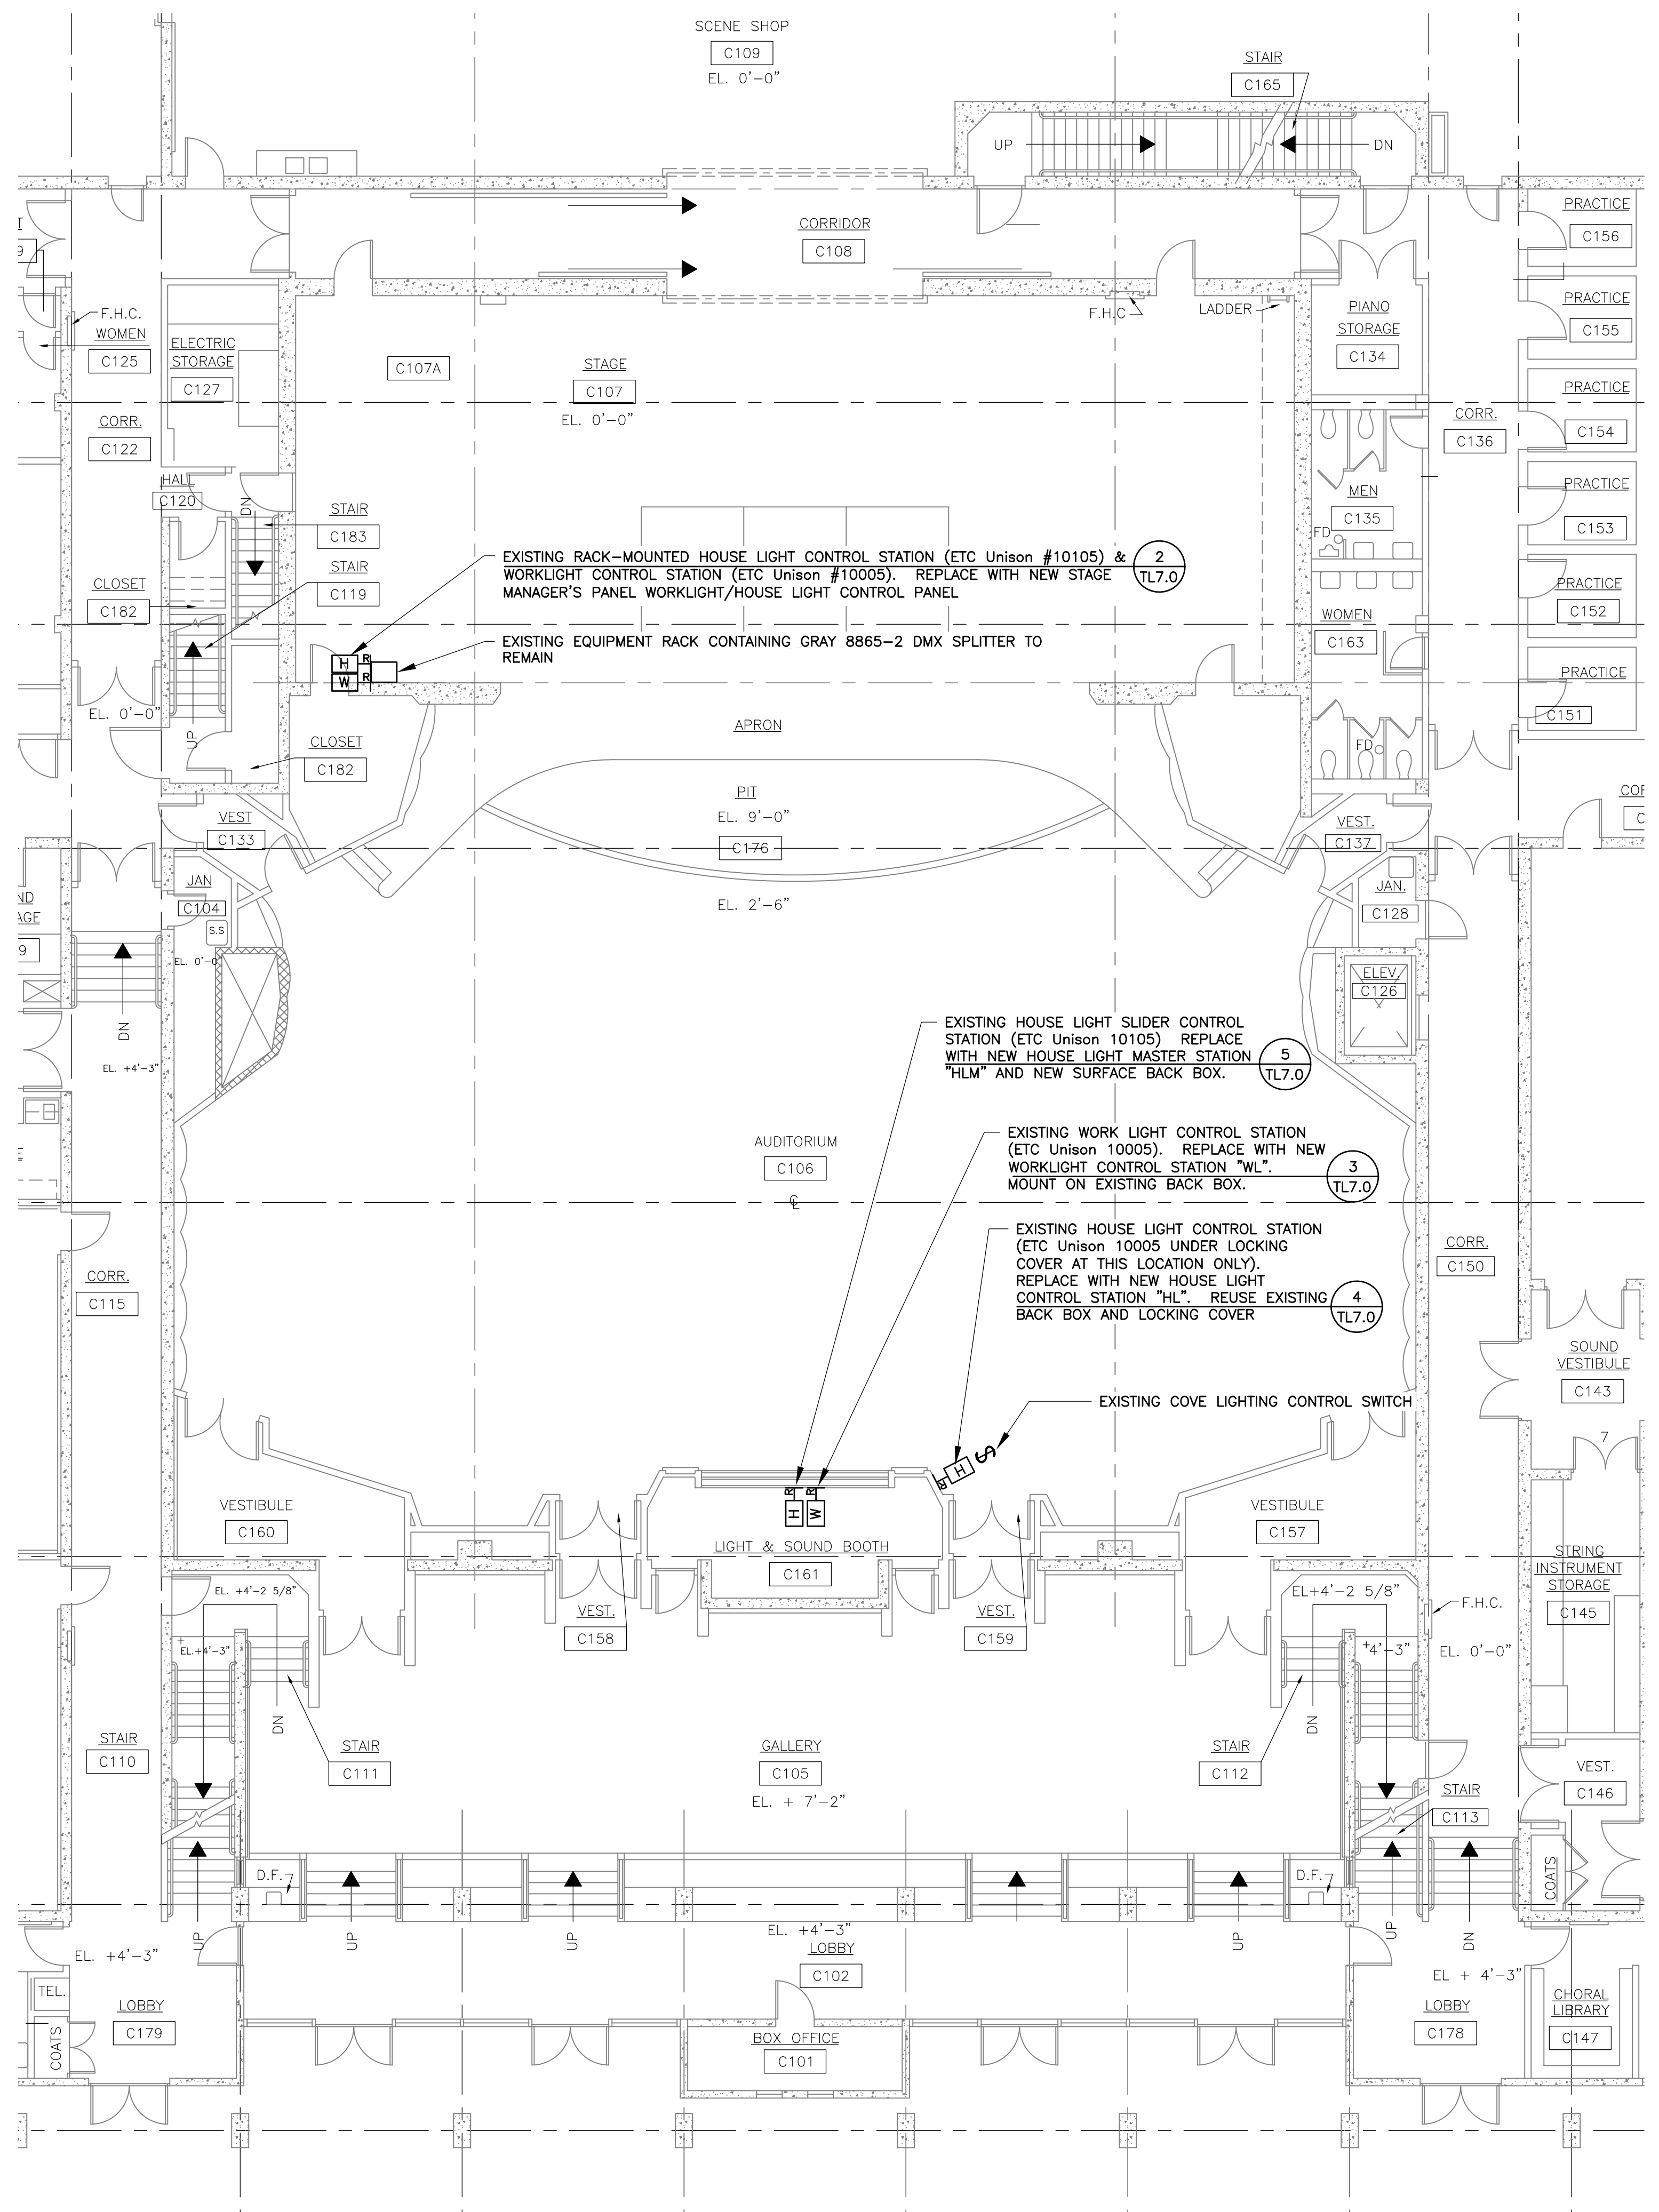

1 LIGHTING CONTROL PLAN - MAIN LEVEL
1/8" = 1'-0"

LANDRY & BOGAN
THEATRE CONSULTANTS
783 W Evelyn Ave. Mountain View, CA 94041
(650) 969-5195 Fax 969-4965
heather@landb.com


SAN MATEO COUNTY COMMUNITY COLLEGE DISTRICT
CAÑADA/COLLEGE OF SAN MATEO
THEATER HOUSE LIGHTING RETROFIT
CAÑADA COLLEGE - BUILDING 3
4200 FARM HILL BOULEVARD, REDWOOD CITY, CA 94061

REVISIONS

SHEET TITLE
THEATER HOUSE LIGHTING RETROFIT
MAIN FLOOR PLAN

SCALE: AS NOTED
DATE: September 16, 2014

TL2.2

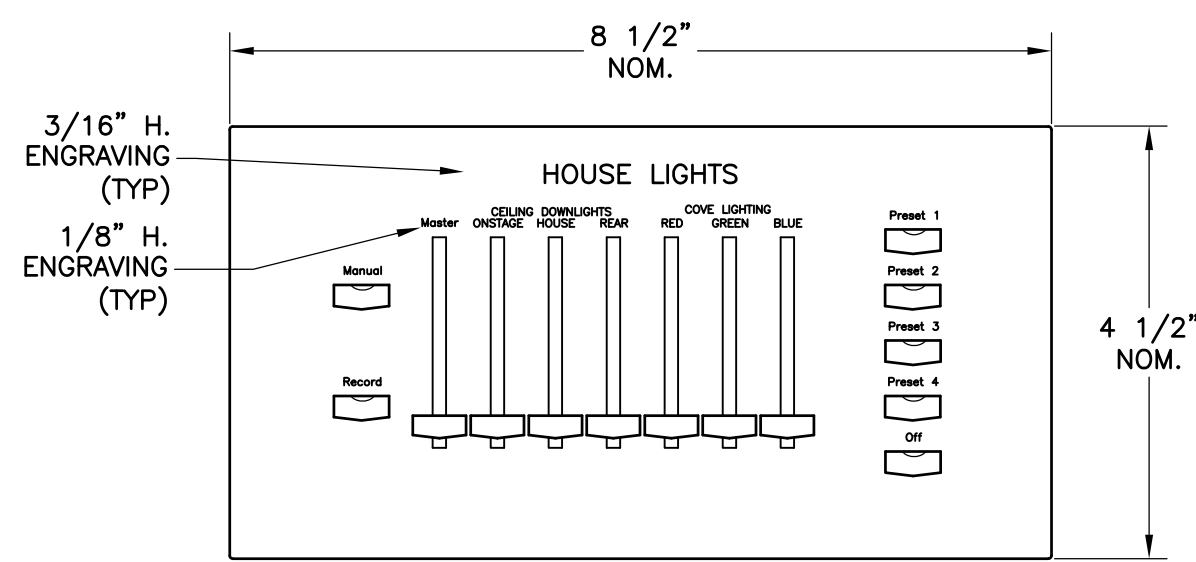

BUTTON	PROGRAM
--HOUSE LIGHTS--	
PRESET 1	USER
PRESET 2	USER
PRESET 3	USER
PRESET 4	USER
OFF	BLACKOUT
SLIDERS	
DOWNLIGHTS ONSTAGE	TBD
DOWNLIGHTS HOUSE	TBD
DOWNLIGHTS REAR	TBD
COVE RED*	TBD
COVE GREEN*	TBD
COVE BLUE*	TBD


STEEL OR ALUMINUM FACEPLATE W/BLACK SEMI-GLOSS FINISH AND WHITE DESIGNATIONS. FACE PLATE REMOVABLE FOR ACCESS.

*IF ALTERNATE NOT TAKEN, THESE SLIDERS ENGRAVING TBD

CODE GAUGE, 4-GANG, 2.5" DEEP SURFACE BACK BOX.

5 HOUSELIGHT MASTER STATION "HLM"

6" - 1'-0"

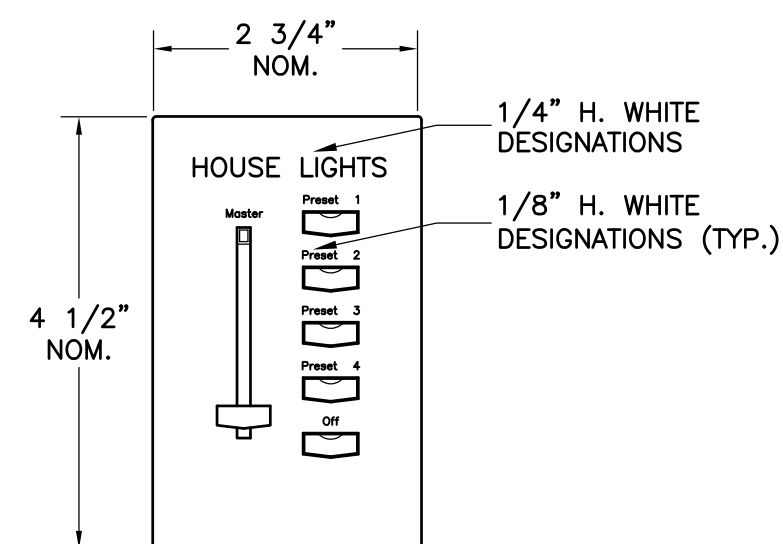


STEEL OR ALUMINUM FACEPLATE W/BLACK SEMI-GLOSS FINISH AND WHITE DESIGNATIONS. FACE PLATE REMOVABLE FOR ACCESS.

IN REAR OF AUDIENCE MOUNT ON EXISTING SINGLE GANG BACK BOX WITH LOCKING COVER (REUSE EXISTING LOCKING COVER AND BACK BOX.) FIELD VERIFY BACK BOX DIMENSIONS

4 HOUSELIGHT STATION "HL"

6" - 1'-0"

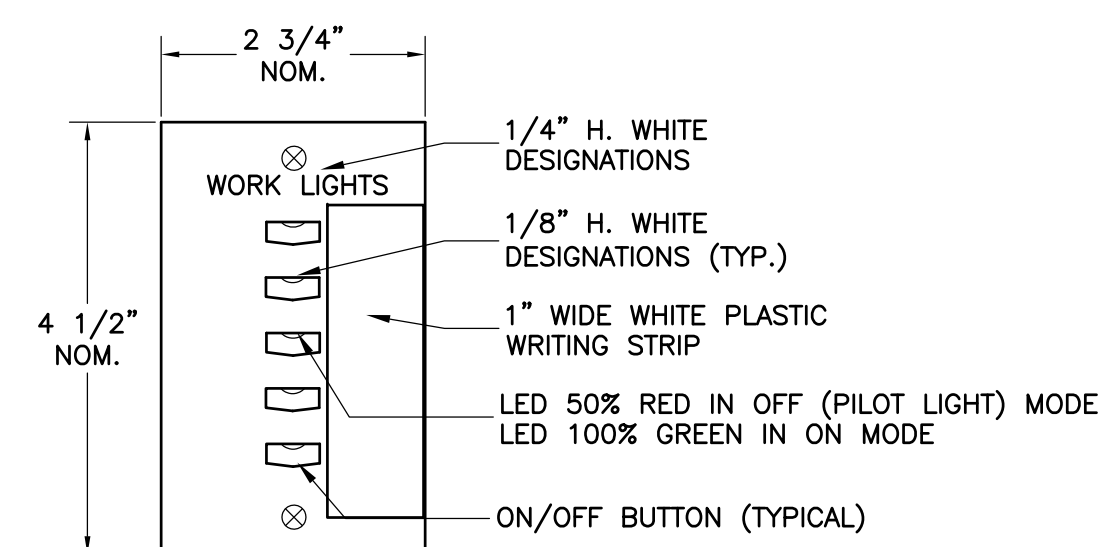


STEEL OR ALUMINUM FACEPLATE W/BLACK SEMI-GLOSS FINISH AND WHITE DESIGNATIONS. FACE PLATE REMOVABLE FOR ACCESS.

IN CONTROL ROOM MOUNT ON EXISTING SINGLE GANG BACK BOX. FIELD VERIFY BACK BOX DIMENSIONS.

3 WORKLIGHT STATION "WL"

6" - 1'-0"

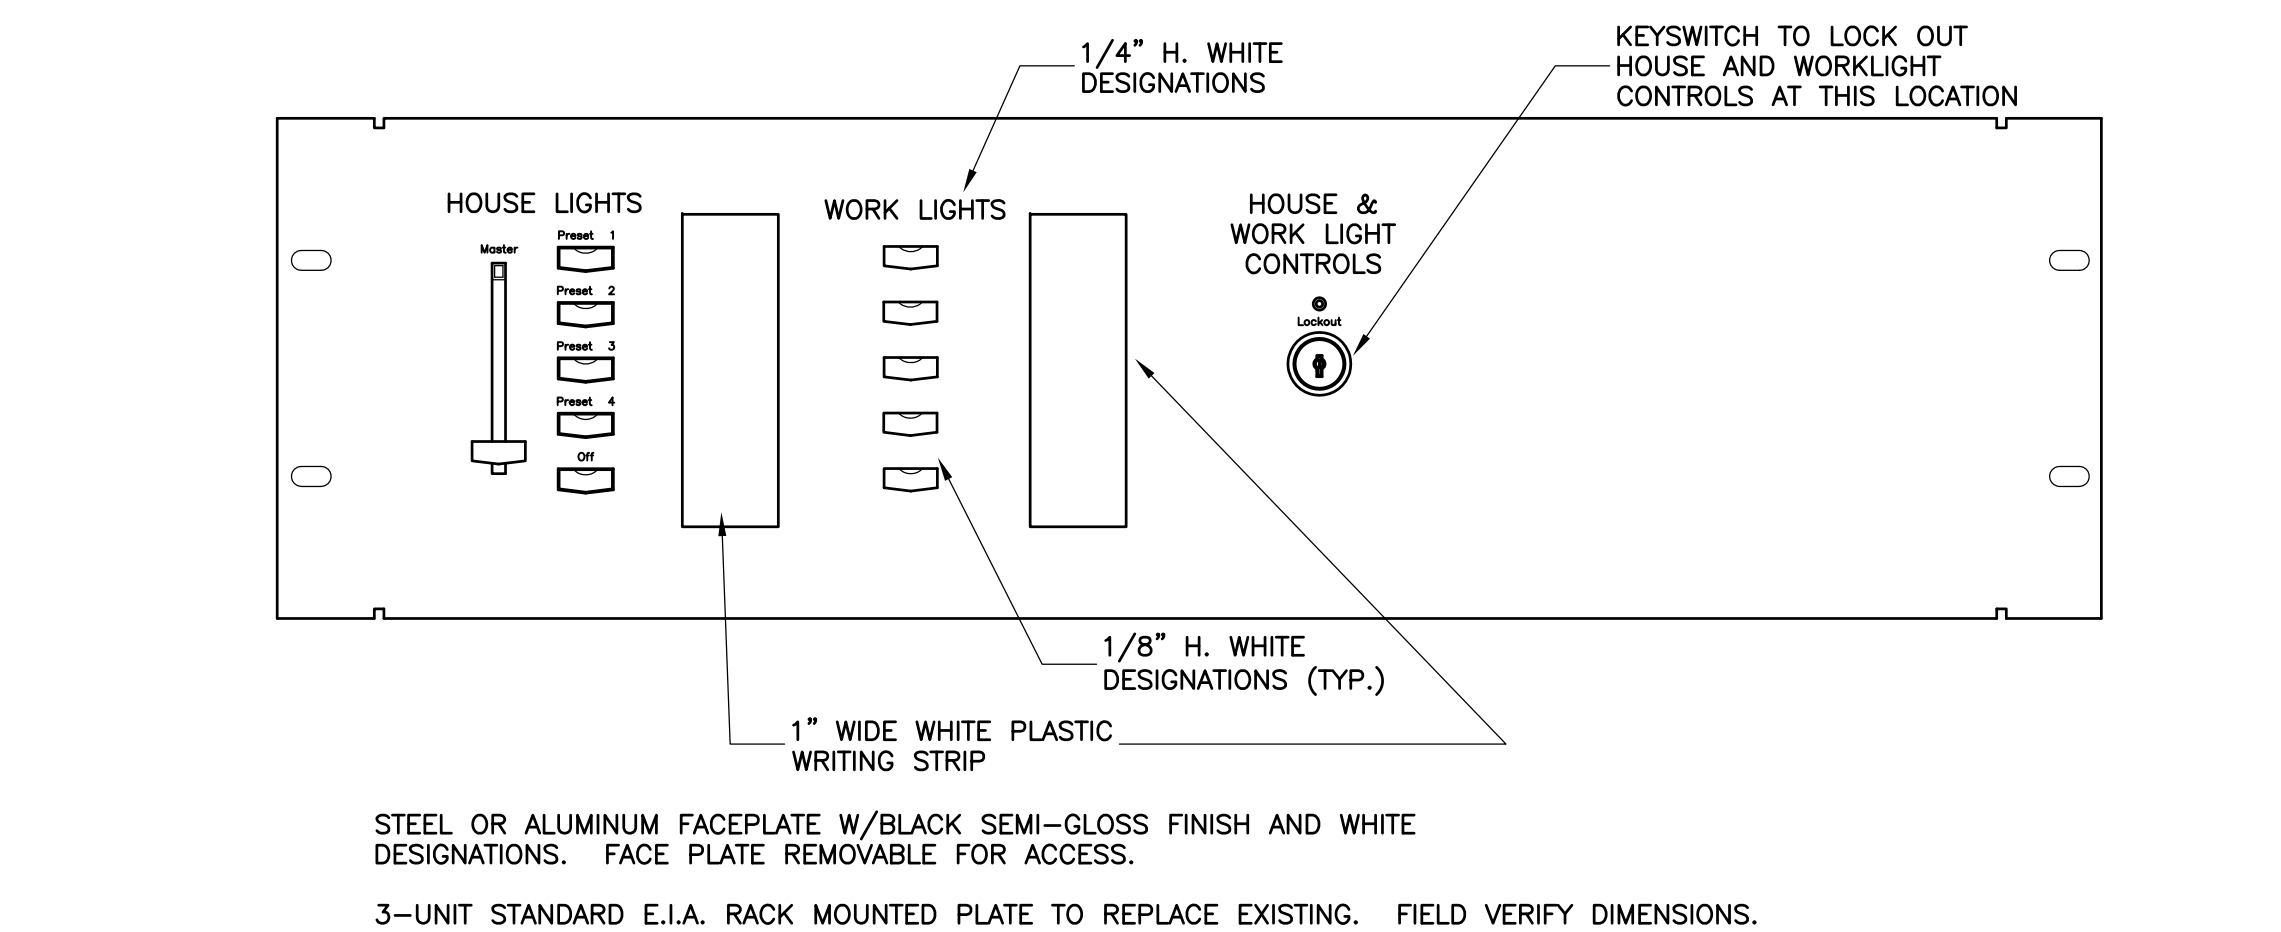

STEEL OR ALUMINUM FACEPLATE W/BLACK SEMI-GLOSS FINISH AND WHITE DESIGNATIONS. FACE PLATE REMOVABLE FOR ACCESS.

3-UNIT STANDARD E.I.A. RACK MOUNTED PLATE TO REPLACE EXISTING. FIELD VERIFY DIMENSIONS.


2 HOUSE LIGHT/WORKLIGHT PANEL AT STAGE MANAGER'S PANEL

6" - 1'-0"

SCHEDULE OF SIGNAL AND CONTROL CONDUCTORS

Cond. Group	Wire Count	Cable type (or equal)	Conductor Use(s)
(D)	2PR#24	(1) Belden 9729	DMX (EXISTING - REUSE)
(H)	1PR#16 1#14	(1) Belden 8471 THHN	UNISON STATIONS (EXISTING - REUSE)
(N) X#	4PR#24	(1) Belden 1583A	NETWORK (NEW)

= Number of type in conduit

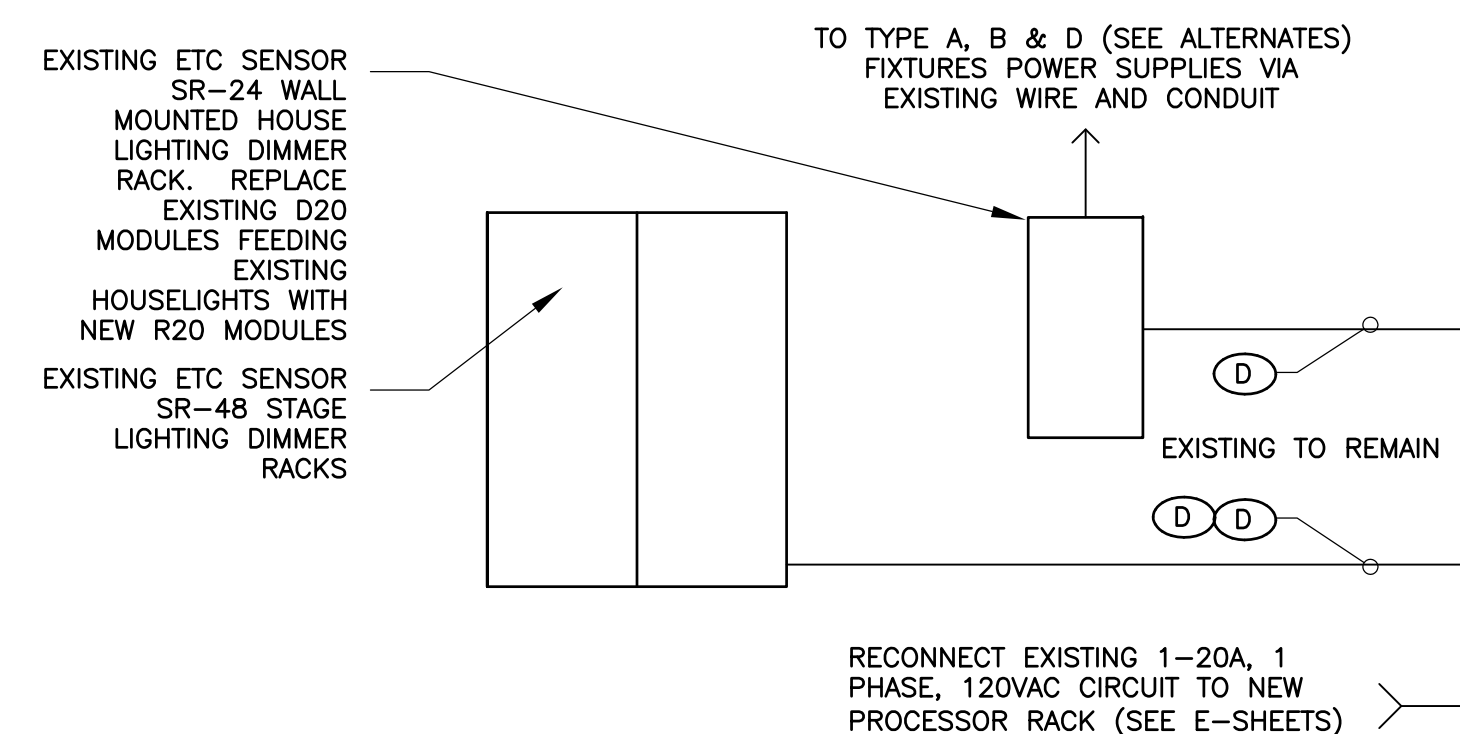


ELECTRICAL ROOM C174

RECONNECT EXISTING 1-20A, 1 PHASE, 120VAC CIRCUIT TO NEW PROCESSOR RACK (SEE E-SHEETS)

1 THEATRE SYSTEM SIGNAL AND CONTROL RISER DIAGRAM

NTS

- NOTES:
1. ALL NEW SIGNAL & CONTROL CONDUIT TO BE 3/4" U.N.O.
 2. TYPES AND QUANTITIES OF SIGNAL & CONTROL CONDUCTORS ARE APPROXIMATE. ACTUAL TYPES & QUANTITIES TO BE AS RECOMMENDED BY STAGE LIGHTING EQUIPMENT MANUFACTURER.

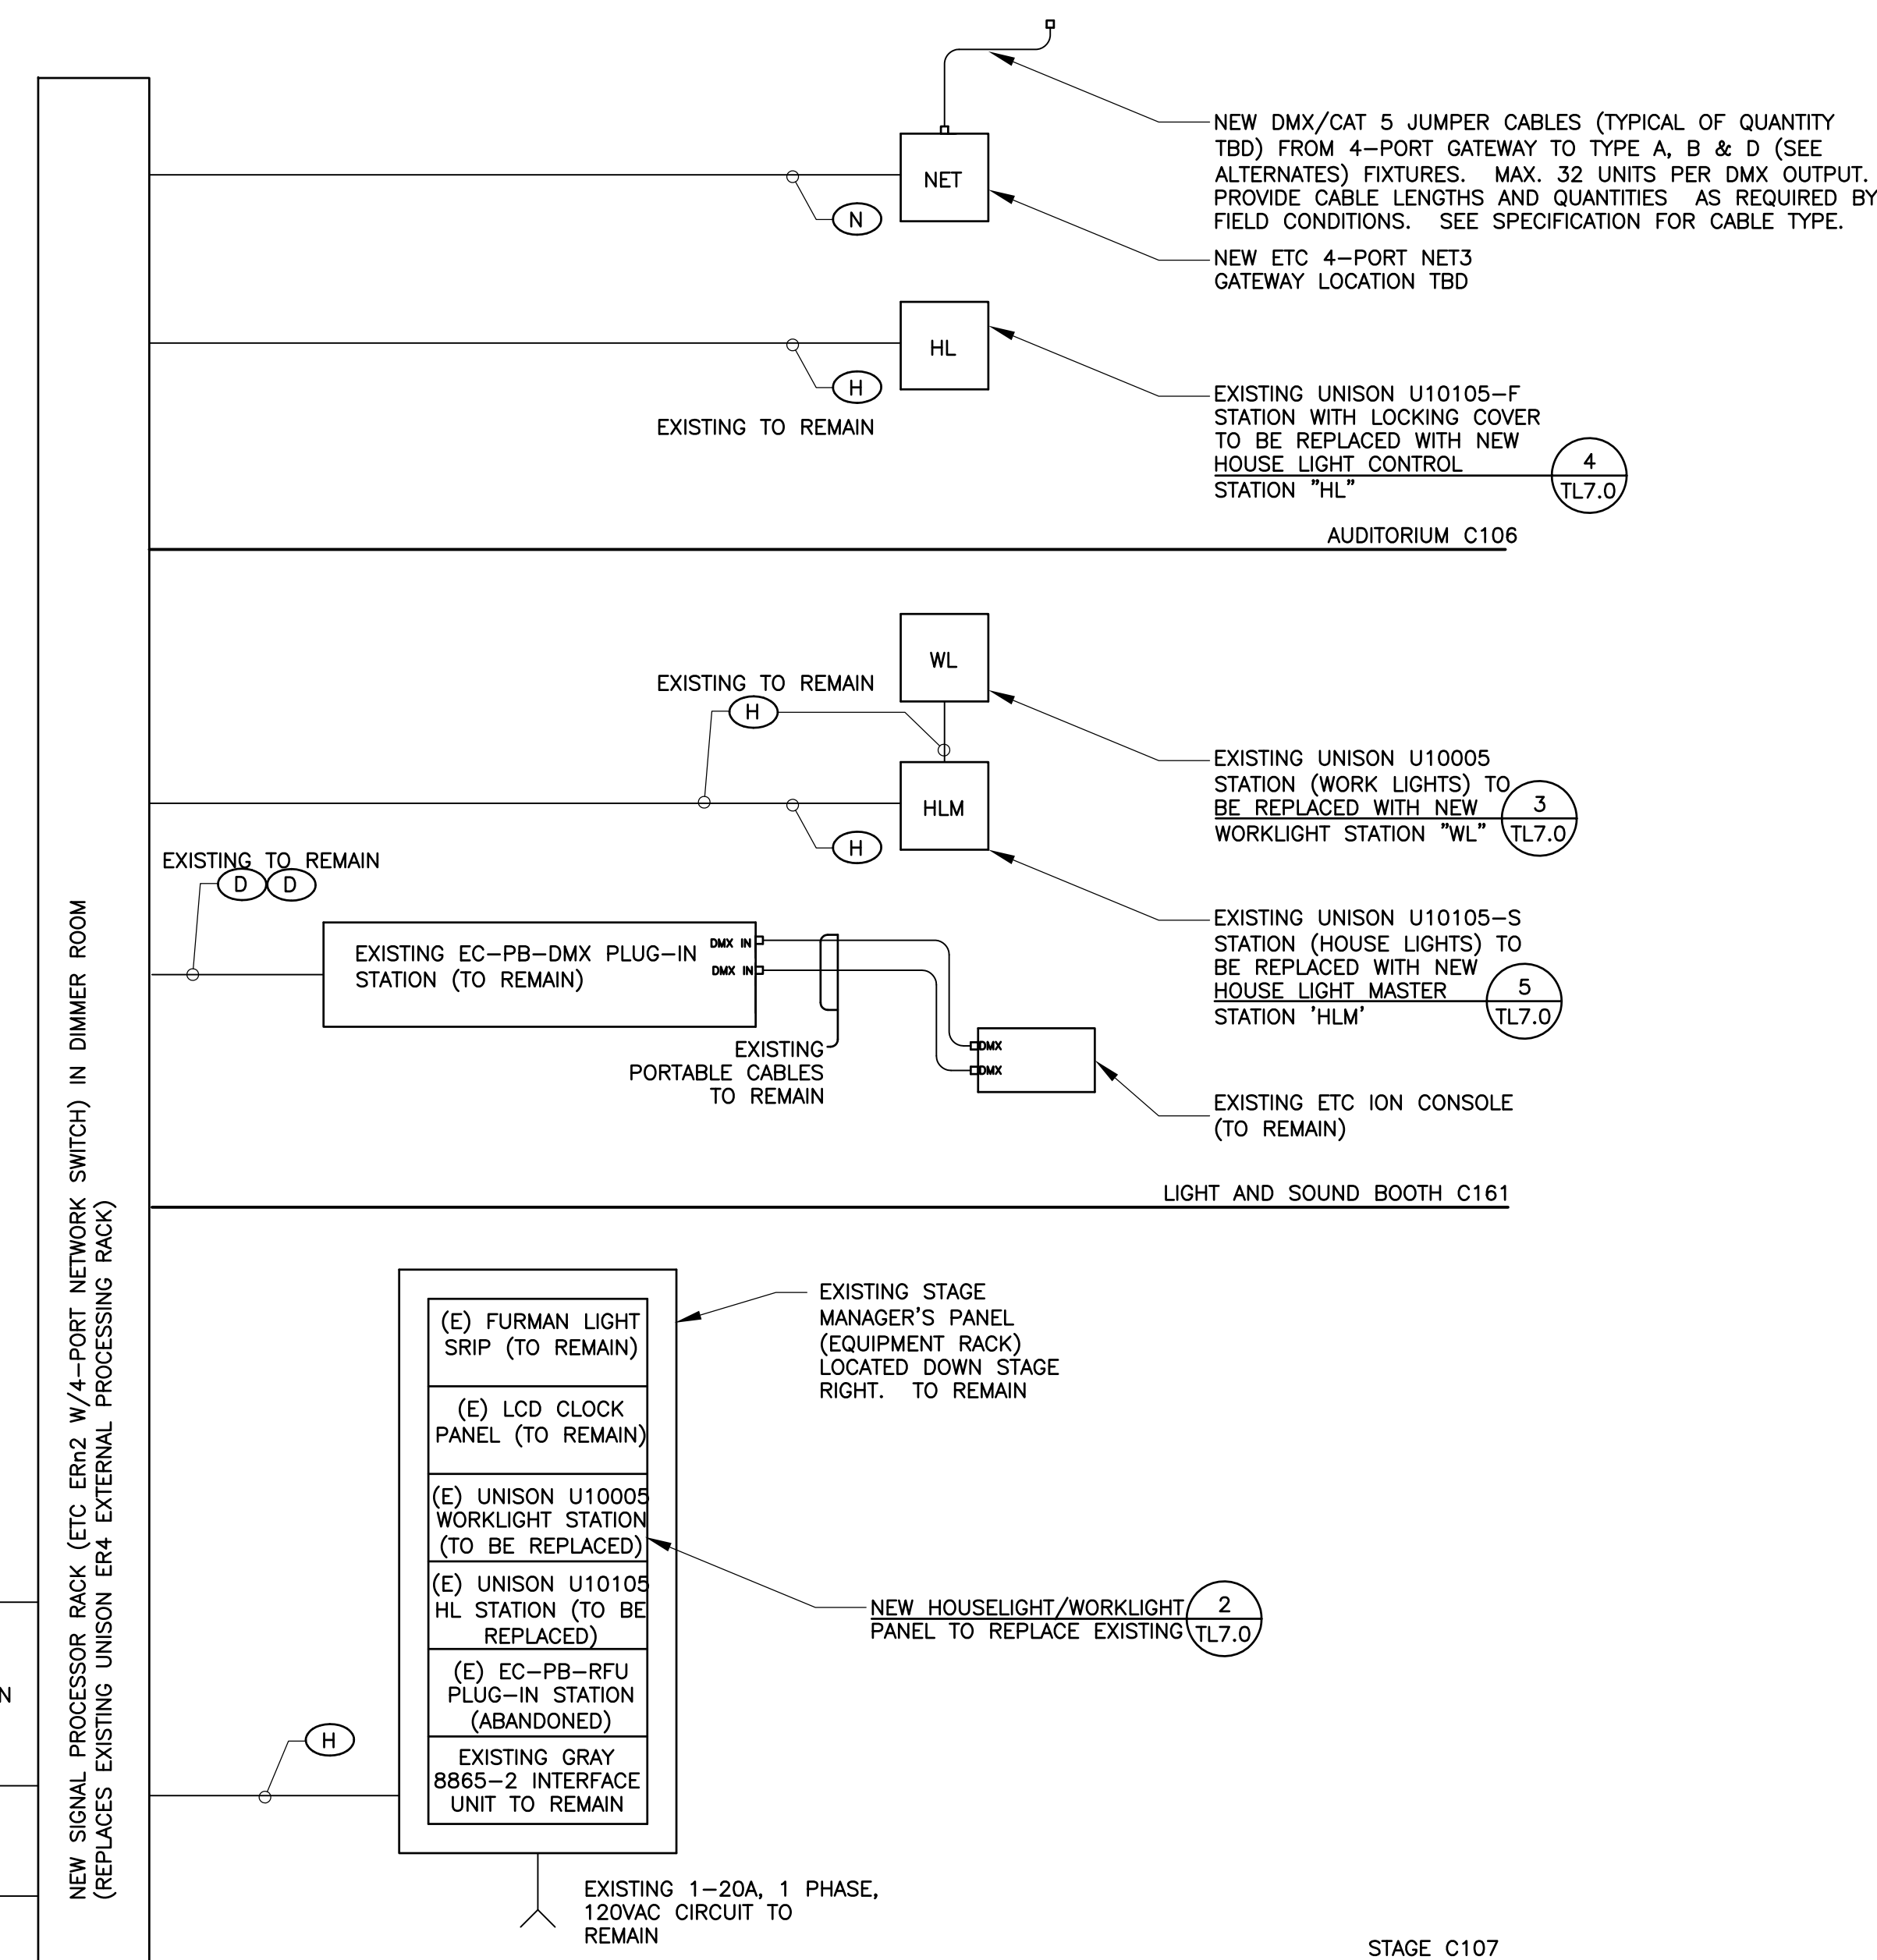

STAGE C107

LANDRY & BOGAN
THEATRE CONSULTANTS
783 W. Evelyn Ave. Mountain View, CA 94041
(650) 969-5195 Fax 969-4965
heather@landb.com

SAN MATEO COUNTY COMMUNITY COLLEGE DISTRICT
CAÑADA/COLLEGE OF SAN MATEO
THEATER HOUSE LIGHTING RETROFIT
CAÑADA COLLEGE - BUILDING 3
4200 FARM HILL BOULEVARD, REDWOOD CITY, CA 94061

REVISIONS
SHEET TITLE
THEATER HOUSE LIGHTING RETROFIT
RISER DIAGRAM + DETAILS

SCALE: 1/4" = 1'-0"
DATE: September 16, 2014

TL7.0

ELECTRICAL SYMBOL LIST

NOTE: This is a standard symbol list and not all items listed may be used.

Abbreviations

(E)	EXISTING
A	AMPERES, AMPER
AIC	AVAILABLE INTERRUPTING CAPACITY
AWG	AMERICAN WIRE GAUGE
C	CONDUIT, CLOSE, CONTROL
CB	CIRCUIT BREAKER
CLG	CEILING
COORD	COORDINATE
CU	COPPER
DIM	DIMENSION
DWG	DRAWING
EA	EACH
EL	ELEVATION
FT	FOOT, FEET
G, GND	GROUND
GFCI	GROUND FAULT CIRCUIT INTERRUPTER
GFI	GROUND FAULT INTERRUPTER
HT	HEIGHT
IN	INCH, INCHES
KVA	KILOVOLT AMPERES
KW	KILOWATT
LED	LIGHT EMITTING DIODE
MIN	MINIMUM
MT, MTD	MOUNT, MOUNTED
N/A	NOT APPLICABLE
NEC	NATIONAL ELECTRIC CODE
NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
NTS	NOT TO SCALE
OC	ON CENTER
REQD	REQUIRED
RM	ROOM
S	SWITCH
SHT	SHEET
TYP	TYPICAL
UL	UNDERWRITERS LABORATORIES
UNO	UNLESS OTHERWISE NOTED
V	VOLTS, VOLTAGE
W/	WITH
W/O	WITHOUT

Connections / Equipment

	OR		JUNCTION BOX
			WALL-MOUNTED JUNCTION BOX

General

	DEMOLISH
	EXISTING WORK
	NEW WORK
	DETAIL NUMBER AND SHEET LOCATION
	KEYED NOTE

Miscellaneous

	BRANCH CIRCUIT WIRING. ARROW INDICATES HOME RUN TO PANEL WITH CIRCUITS AS NOTED. WIRE SIZE IS #12 AWG MINIMUM UNLESS NOTED OTHERWISE. SHORT TICK MARKS INDICATE PHASE CONDUCTORS. LONG TICK MARKS INDICATE NEUTRAL CONDUCTORS. A SINGLE CURVED TICK MARK INDICATES INSULATED GREEN GROUND CONDUCTOR. SECOND CURVED TICK MARK INDICATES 'ISOLATED GROUND' (GREEN INSULATION WITH YELLOW STRIPE) CONDUCTOR.
	BRANCH PANEL
	FLUSH WALL MOUNTED BRANCH PANEL
	GROUNDING POINT

Raceways

	CONDUIT CONCEALED IN WALL OR CEILING SPACE
	CONDUIT ROUTED BELOW FLOOR / GRADE
	CONDUIT/WIRING CONTINUATION
	CONDUIT/WIRING STUBBED OUT WITH END CAP OR INSULATED PLASTIC BUSHING

Switches and Receptacles

	DUPLEX RECEPTACLE
--	-------------------

GENERAL ELECTRICAL NOTES

- A. DO NOT COMMENCE INSTALLATION OF ELECTRICAL SYSTEMS AND EQUIPMENT WITHOUT RELATED SHOP DRAWING APPROVALS.
- B. ELECTRICAL CIRCUITS SHALL BE INTERRUPTED ONLY WITH PRIOR WRITTEN CONSENT. SUCH INTERRUPTIONS SHALL BE PRECEDED BY ALL POSSIBLE PREPARATIONS BY THE CONTRACTOR WHICH ARE NECESSARY TO KEEP THE ELECTRICAL CIRCUITS OFF FOR A MINIMUM PERIOD IN AN EXPEDITIOUS MANNER PURSUANT WITH GOOD WORKMANSHIP. THIS INCLUDES CIRCUIT TRACING TO IDENTIFY THE ELECTRICAL LOAD BEING SERVED AND THE ORIGIN OF THE CIRCUIT.
- C. COORDINATE WITH OWNER SO THAT WORK CAN BE SCHEDULED NOT TO INTERRUPT OPERATIONS, NORMAL ACTIVITIES, BUILDING ACCESS, ACCESS TO DIFFERENT AREAS. THE OWNER WILL COOPERATE TO THE BEST OF THEIR ABILITY TO ASSIST IN A COORDINATED SCHEDULE, BUT WILL REMAIN THE FINAL AUTHORITY AS TO TIME OF WORK PERMITTED.
- D. COORDINATE THE EXACT LOCATION OF EXISTING UTILITIES AND EQUIPMENT PRIOR TO COMMENCEMENT OF WORK. COMPENSATE THE OWNER FOR DAMAGES CAUSED BY THE FAILURE TO LOCATE AND PRESERVE UTILITIES. REPLACE DAMAGED ITEMS WITH NEW MATERIAL TO MATCH EXISTING.
- E. REMOVE EXISTING LUMINAIRES, SWITCHES, RECEPTACLES, AND OTHER ELECTRICAL EQUIPMENT AND DEVICES AND ASSOCIATED WIRING FROM WALLS, CEILINGS, FLOORS, AND OTHER SURFACES SCHEDULED FOR REMODELING, RELOCATION, OR DEMOLITION UNLESS SHOWN AS RETAINED OR RELOCATED ON DRAWINGS.
- F. MAINTAIN ELECTRICAL CONTINUITY OF EXISTING SYSTEMS. REMOVE OR RELOCATE ELECTRICAL BOXES, CONDUIT, WIRING, EQUIPMENT, LUMINAIRES, AND THE LIKE, AS REQUIRED IN REMOVED OR REMODELED AREAS IN THE EXISTING CONSTRUCTION AFFECTED BY THIS WORK.
- G. REMOVE AND RESTORE WIRING WHICH SERVES USABLE EXISTING OUTLETS CLEAR OF THE CONSTRUCTION OR DEMOLITION.
- H. IF EXISTING JUNCTION BOXES WILL BE MADE INACCESSIBLE, OR IF ABANDONED OUTLETS SERVE AS FEED THROUGH BOXES FOR OTHER EXISTING ELECTRICAL EQUIPMENT WHICH IS BEING RETAINED, PROVIDE NEW CONDUIT AND WIRE TO BYPASS THE ABANDONED OUTLETS.
- I. IF EXISTING CONDUITS PASS THROUGH PARTITIONS OR CEILING WHICH ARE BEING REMOVED OR REMODELED, PROVIDE NEW CONDUIT AND WIRE TO REROUTE CLEAR OF THE CONSTRUCTION OR DEMOLITION AND MAINTAIN SERVICE TO THE EXISTING LOAD.
- J. CONCEALED CONDUIT LOCATED IN CONCRETE WALLS OR HARDBOARD CEILING SPACES MAY BE ABANDONED IN PLACE, REMOVE CONDUCTORS AND TAG ABANDONED CONDUITS WITH CORRESPONDING SYSTEM AND TERMINATION POINT. CUT AND CAP ABANDONED CONDUIT. DO NOT EXTEND STUBS ABOVE FINISHED FLOOR.
- K. EXTEND CIRCUITING AND DEVICES IN EXISTING WALLS TO BE FURRED OUT.
- L. PROVIDE TEMPORARY SUPPORT FOR ELECTRICAL SYSTEMS THAT REMAIN IN PLACE.
- M. VERIFY EXACT LOCATION AND NUMBER OF EXISTING ELECTRICAL OUTLETS AND LUMINAIRES IN THE FIELD. LOCATIONS OF ITEMS SHOWN ON DRAWINGS AS EXISTING ARE PARTIALLY BASED ON RECORD AND OTHER DRAWINGS WHICH MAY CONTAIN ERRORS. VERIFY THE ACCURACY OF THE INFORMATION SHOWN PRIOR TO BIDDING AND PROVIDE SUCH LABOR AND MATERIAL AS IS NECESSARY TO ACCOMPLISH THE INTENT OF THE CONTRACT DOCUMENTS.
- N. REMOVE ABANDONED WIRING TO LEAVE SITE CLEAN.
- O. EXISTING LIGHTING WHICH IS TO REMAIN OR BE RELOCATED IS TO BE RELAMPED, REBALLASTED, AND CLEANED. LEAVE ALL LUMINAIRES IN PROPER WORKING ORDER. REPLACE DAMAGED OR BROKEN LENS AND/OR COMPONENTS.
- P. MAINTAIN ACCESS TO EXISTING ELECTRICAL INSTALLATIONS WHICH REMAIN ACTIVE. MODIFY INSTALLATION OR PROVIDE ACCESS PANEL AS APPROPRIATE.
- Q. WHERE DRAWINGS INDICATE EXISTING ELECTRICAL EQUIPMENT OR DEVICES TO BE RELOCATED AND/OR REUSED, REFURBISH THEM, THOROUGHLY CLEAN SUCH ITEMS, NOTIFY ARCHITECT OF ANY DEFECTS IN SUCH INSTALLATIONS. REPAIR ANY DAMAGE CAUSED BY DEMOLITION OR CONSTRUCTION PERFORMED UNDER THIS CONTRACT.
- R. PROVIDE UPDATED PANEL SCHEDULES AND DIRECTORIES THAT IDENTIFY EXISTING CIRCUITS AND NUMBER OF SPARE CIRCUITS AVAILABLE UPON COMPLETION OF DEMOLITION WORK.
- S. OFFER REMOVED LUMINAIRES, WIRING DEVICES, PANELBOARDS AND EQUIPMENT TO THE OWNER. IF OWNER CHOOSES TO RETAIN THESE ITEMS, RETURN SUCH ITEMS TO OWNER, CAREFULLY REMOVE AND DISPOSE OF ITEMS REJECTED BY OWNER FROM PROJECT SITE AND IN A LEGAL MANNER.
- T. RECONNECT EXISTING LUMINAIRES NOT SHOWN ON DRAWINGS AND AFFECTED DUE TO DEMOLITION TO NEAREST AVAILABLE EXISTING LIGHTING CIRCUIT ABLE TO TAKE THE ADDITIONAL LOAD.
- U. REFER TO SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
- V. DRAWINGS AND SPECIFICATIONS COMPLIMENT EACH OTHER. REQUIREMENT BY EITHER INFERS REQUIREMENT BY BOTH.
- W. CONNECT EQUIPMENT AND DEVICES FURNISHED UNDER OTHER DIVISIONS OF THIS CONTRACT, BY OWNER OR BY OTHER CONTRACTS.
- X. UNLESS OTHERWISE NOTED, PROVIDE CONCEALED AND FLUSH MOUNTED INSTALLATION OF DEVICES AND EQUIPMENT IN AREAS.
- Y. PROVIDE SEPARATE EQUIPMENT GROUNDING CONDUCTOR IN 120 VOLT, MULTI-WIRE CIRCUITS.
- Z. FOR 120 VOLT, 20 AMP CIRCUITS, WHERE CIRCUIT DISTANCE FROM PANELBOARD TO FARTHEST DEVICE/FIXTURE EXCEEDS 75 FEET, PROVIDE #10 SIZE CONDUCTOR.
- AA. RUN ELECTRICAL CONDUIT CONCEALED AND PARALLEL TO BUILDING LINES. VERIFY WITH ARCHITECT.
- AB. RECEPTACLE OUTLETS SHALL COMPLY WITH CEC SECTION 210.7.
- AC. LIGHTS, SWITCHES AND CONTROL MECHANISMS SHALL COMPLY WITH CEC SECTION 404.
- AD. BRACE ELECTRICAL EQUIPMENT TO RESIST A HORIZONTAL FORCE THAT ACT IN ANY DIRECTION. COMPLY WITH TITLE 24 REQUIREMENTS.
- AE. INSTALL COMPLETE SYSTEM OF CONDUCTORS IN RACEWAY SYSTEM THROUGHOUT BUILDING FOR FEEDERS, BRANCH CIRCUITS, ETC.

SHEET INDEX

E0.1	SYMBOL LIST AND GENERAL NOTES - ELECTRICAL
E2.1	FLOOR PLAN - LIGHTING
E2.2	LIGHTING CONTROL FLOOR PLANS



Date Signed: 9/9/14

PROJECT CONTRACT
2014.0380
Jason Lau

717 Market Street,
Suite 500
Berkeley, CA 94710
Tel: 415.888.7240
Fax: 415.888.7289
www.interfaceengineering.com

LANDRY & BOGAN
THEATRE CONSULTANTS
783 W. Evelyn Ave, Mountain View, CA 94041
(650) 968-9185 Fax 968-6865
theatrelandb.com


SAN MATEO COUNTY COMMUNITY COLLEGE DISTRICT
CAÑADA/COLLEGE OF SAN MATEO
THEATER HOUSE LIGHTING RETROFIT
COLLEGE OF SAN MATEO - BUILDING 3
1700 WEST HILLSDALE BLVD., SAN MATEO, CA 94402

REVISIONS

SHEET TITLE
THEATER HOUSE
LIGHTING RETROFIT
SYMBOL LIST AND
GENERAL NOTES
- ELECTRICAL

SCALE: NO SCALE
DATE: Sept. 9, 2014

E0.1

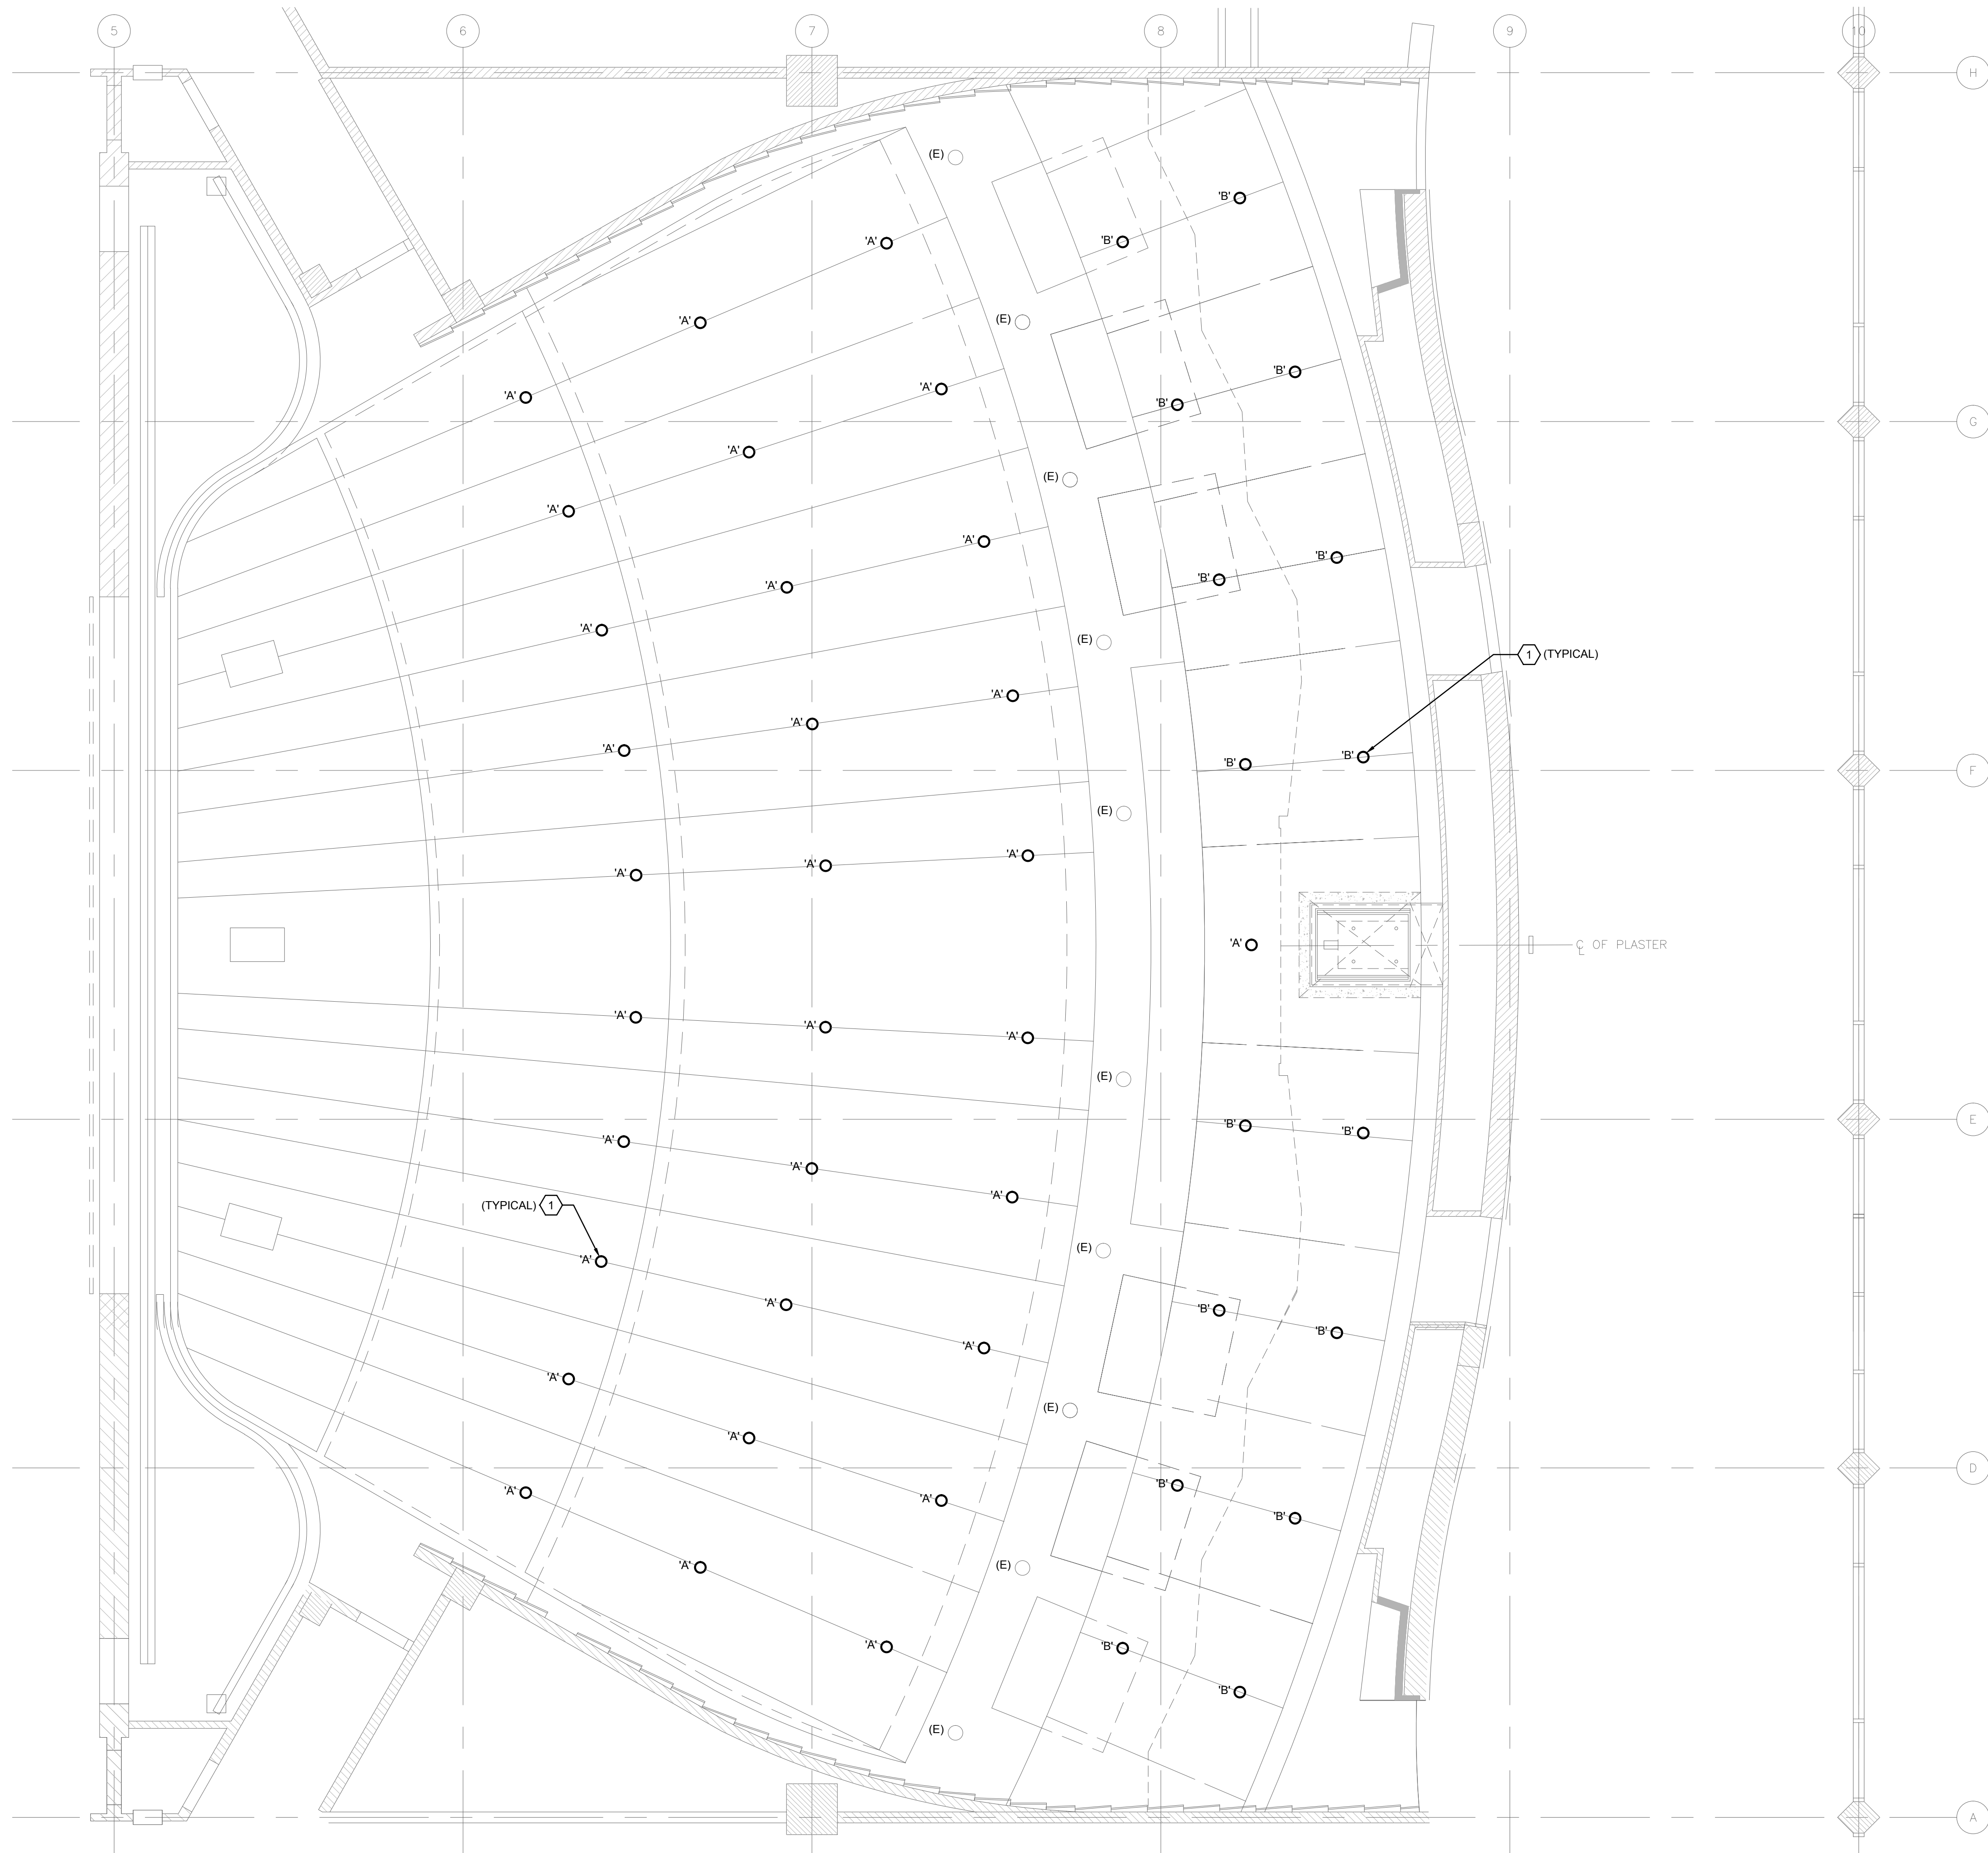

1 FLOOR PLAN - LIGHTING
 0 2' 4' 8'
 SCALE: 1/4"=1'-0"

GENERAL SHEET NOTES

- A. COORDINATE EXACT LOCATION AND MOUNTING HEIGHT OF LUMINAIRES AND LIGHTING CONTROLS WITH THEATRICAL LIGHTING CONSULTANT PRIOR TO INSTALLATION.
- B. REFER TO THEATRICAL LIGHTING CONSULTANT DRAWINGS FOR ADDITIONAL INFORMATION AND LIGHTING CONTROL REQUIREMENTS.
- C. REFER TO THEATRICAL LIGHTING CONSULTANT DRAWINGS FOR LUMINAIRE SCHEDULE AND SYMBOLS.
- D. EXISTING LUMINAIRES AND LIGHTING CONTROLS NOT SHOWN ON PLAN SHALL REMAIN, U.O.N.

SHEET KEYNOTES

- 1 DISCONNECT AND REUSE EXISTING LIGHTING CIRCUIT AS PART OF LED LUMINAIRE REPLACEMENT. LUMINAIRES TO BE RECONNECTED BACK TO EXISTING DIMMER RACK.

PROJECT CONTACT
 2014.0330
 Jason Lau
 INTERFACE ENGINEERING
 717 Market Street
 Suite 500
 San Francisco, CA 94103
 TEL: 415.488.7240
 FAX: 415.488.7289
 www.interfaceengineering.com


LANDRY & BOGAN
 THEATRE CONSULTANTS
 733 W. Evelyn Ave. Mountain View, CA 94041
 (650) 968-5185 Fax 968-6865
 theathr@landb.com

SAN MATEO COUNTY COMMUNITY COLLEGE DISTRICT
 CAÑADA/COLLEGE OF SAN MATEO
 THEATER HOUSE LIGHTING RETROFIT
 COLLEGE OF SAN MATEO - BUILDING 3
 1700 WEST HILLSDALE BLVD., SAN MATEO, CA 94402

REVISIONS

SHEET TITLE
**THEATER HOUSE
 LIGHTING RETROFIT
 FLOOR PLAN -
 LIGHTING**

SCALE: AS NOTED
 DATE: Sept. 9, 2014

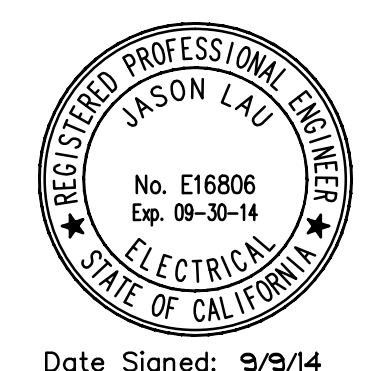

Date Signed: 9/9/14


E2.1

GENERAL SHEET NOTES


- A. COORDINATE EXACT LOCATION AND MOUNTING HEIGHT OF EQUIPMENTS AND LIGHTING CONTROLS WITH THEATRICAL LIGHTING CONSULTANT PRIOR TO INSTALLATION.
- B. REFER TO THEATRICAL LIGHTING CONSULTANT DRAWINGS FOR ADDITIONAL INFORMATION AND LIGHTING CONTROL REQUIREMENTS.
- C. EXISTING EQUIPMENTS AND LIGHTING CONTROLS NOT SHOWN ON PLAN SHALL REMAIN, U.O.N.

SHEET KEYNOTES


- 1. DISCONNECT AND REMOVE EXISTING UNISON SINGLE-GANG 10-BUTTON SNAPSHOT STATION AND REPLACE WITH NEW STATION 'S'. RECONNECT COMPLETE BACK TO EXISTING CIRCUIT TO PLACE BACK INTO SERVICE.
- 2. DISCONNECT AND REMOVE EXISTING UNISON SINGLE-GANG 5-BUTTON HOUSE/WORKLIGHT STATION AND REPLACE WITH NEW STATION 'HL'. RECONNECT COMPLETE BACK TO EXISTING CIRCUIT TO PLACE BACK INTO SERVICE.
- 3. DISCONNECT AND REMOVE EXISTING HOUSE LIGHT KEYSWITCH CONTROL STATION AND REPLACE WITH NEW STATION 'HLK'. RECONNECT COMPLETE BACK TO EXISTING CIRCUIT TO PLACE BACK INTO SERVICE.
- 4. EXISTING ETC UNISON ER-4 DR12 WALL MOUNTED DIMMER RACK TO REMAIN.
- 5. INSTALL NEW ETC UNISON PARADIGM ERn2 SIGNAL PROCESSOR RACK WITH SMALL 4-PORT NETWORK SWITCH. INTERCEPT AND EXTEND EXISTING CIRCUIT '3RBB-1' TO NEW RACK AND CONNECT COMPLETE AS REQUIRED TO PLACE INTO SERVICE.

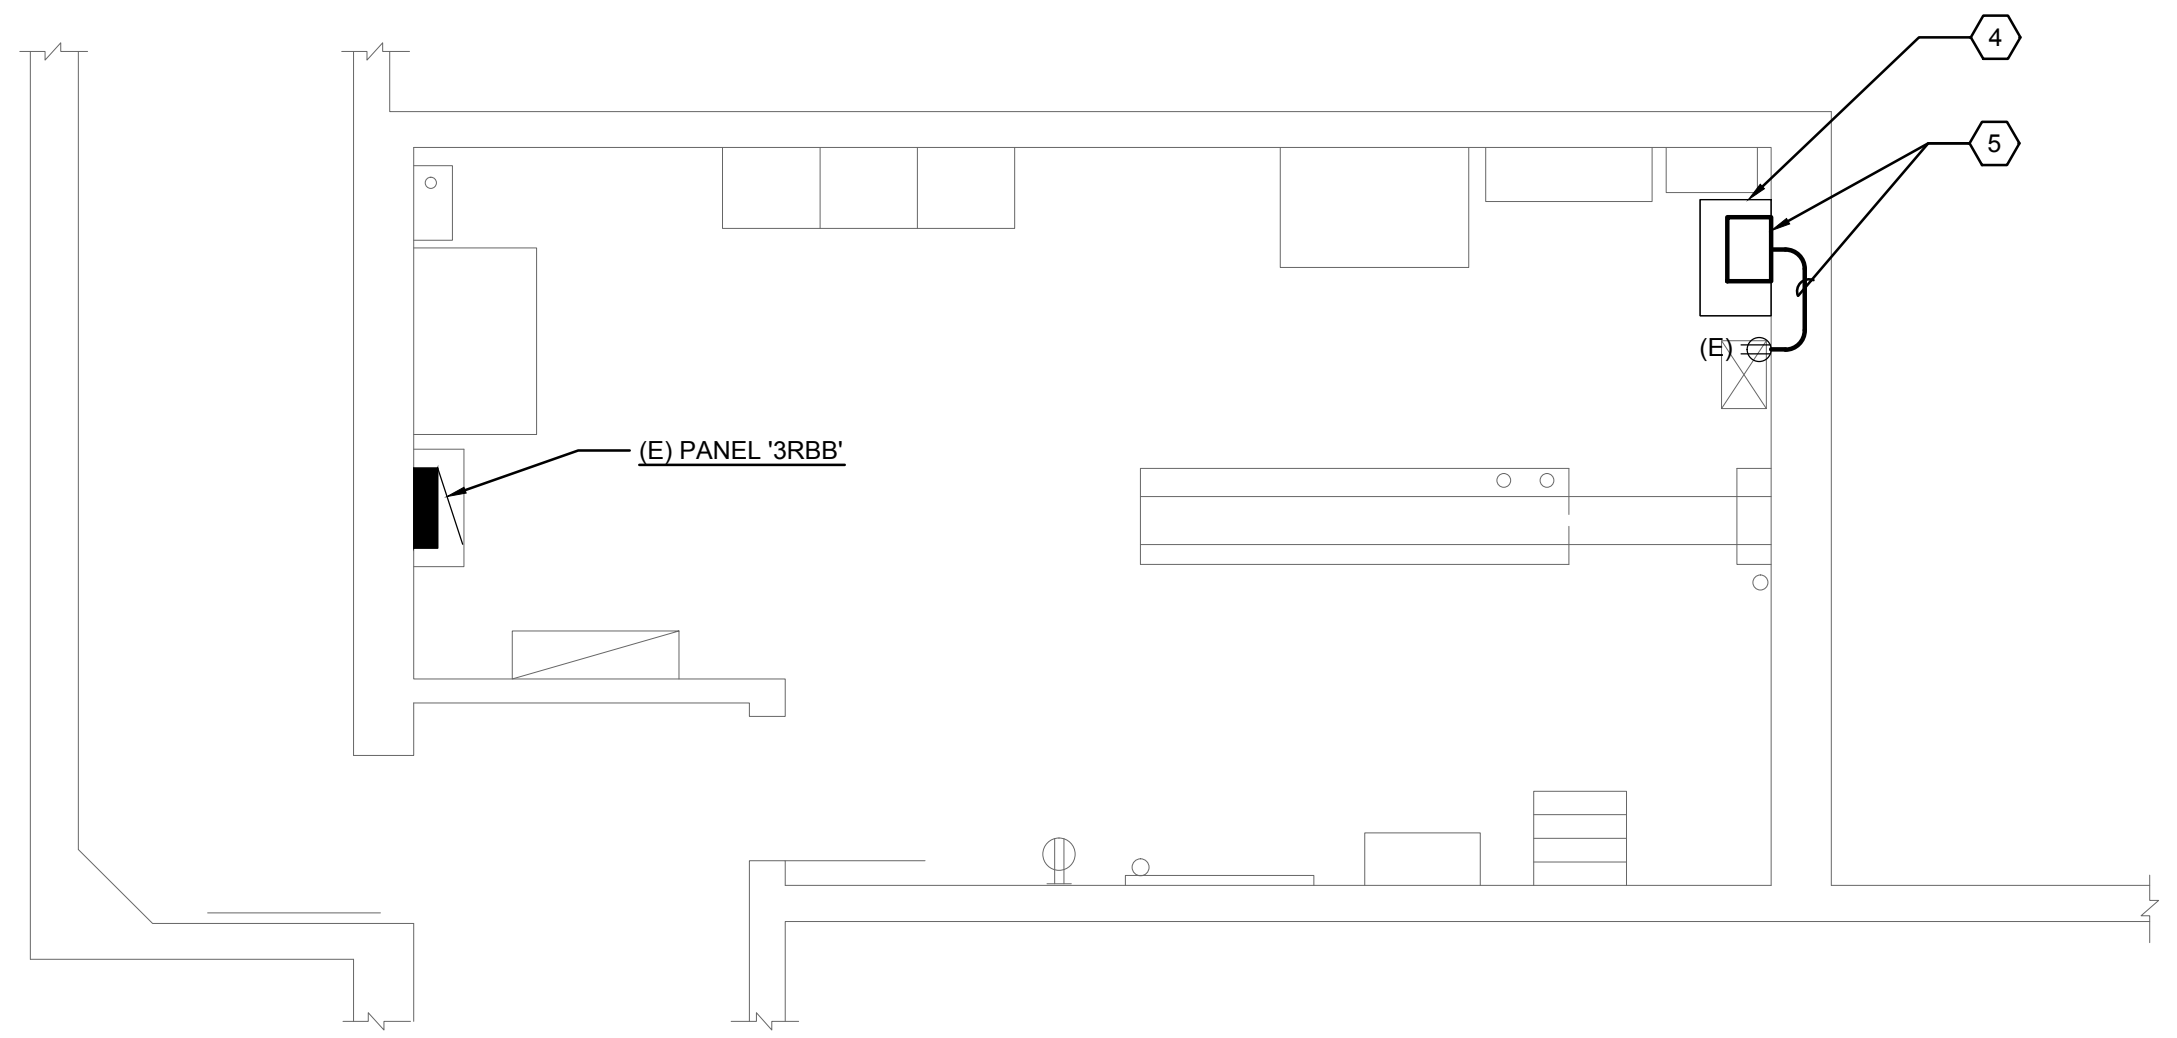


4 THEATER BASEMENT LEVEL ELECTRICAL ROOM PLAN
SCALE: 1/4"=1'-0"

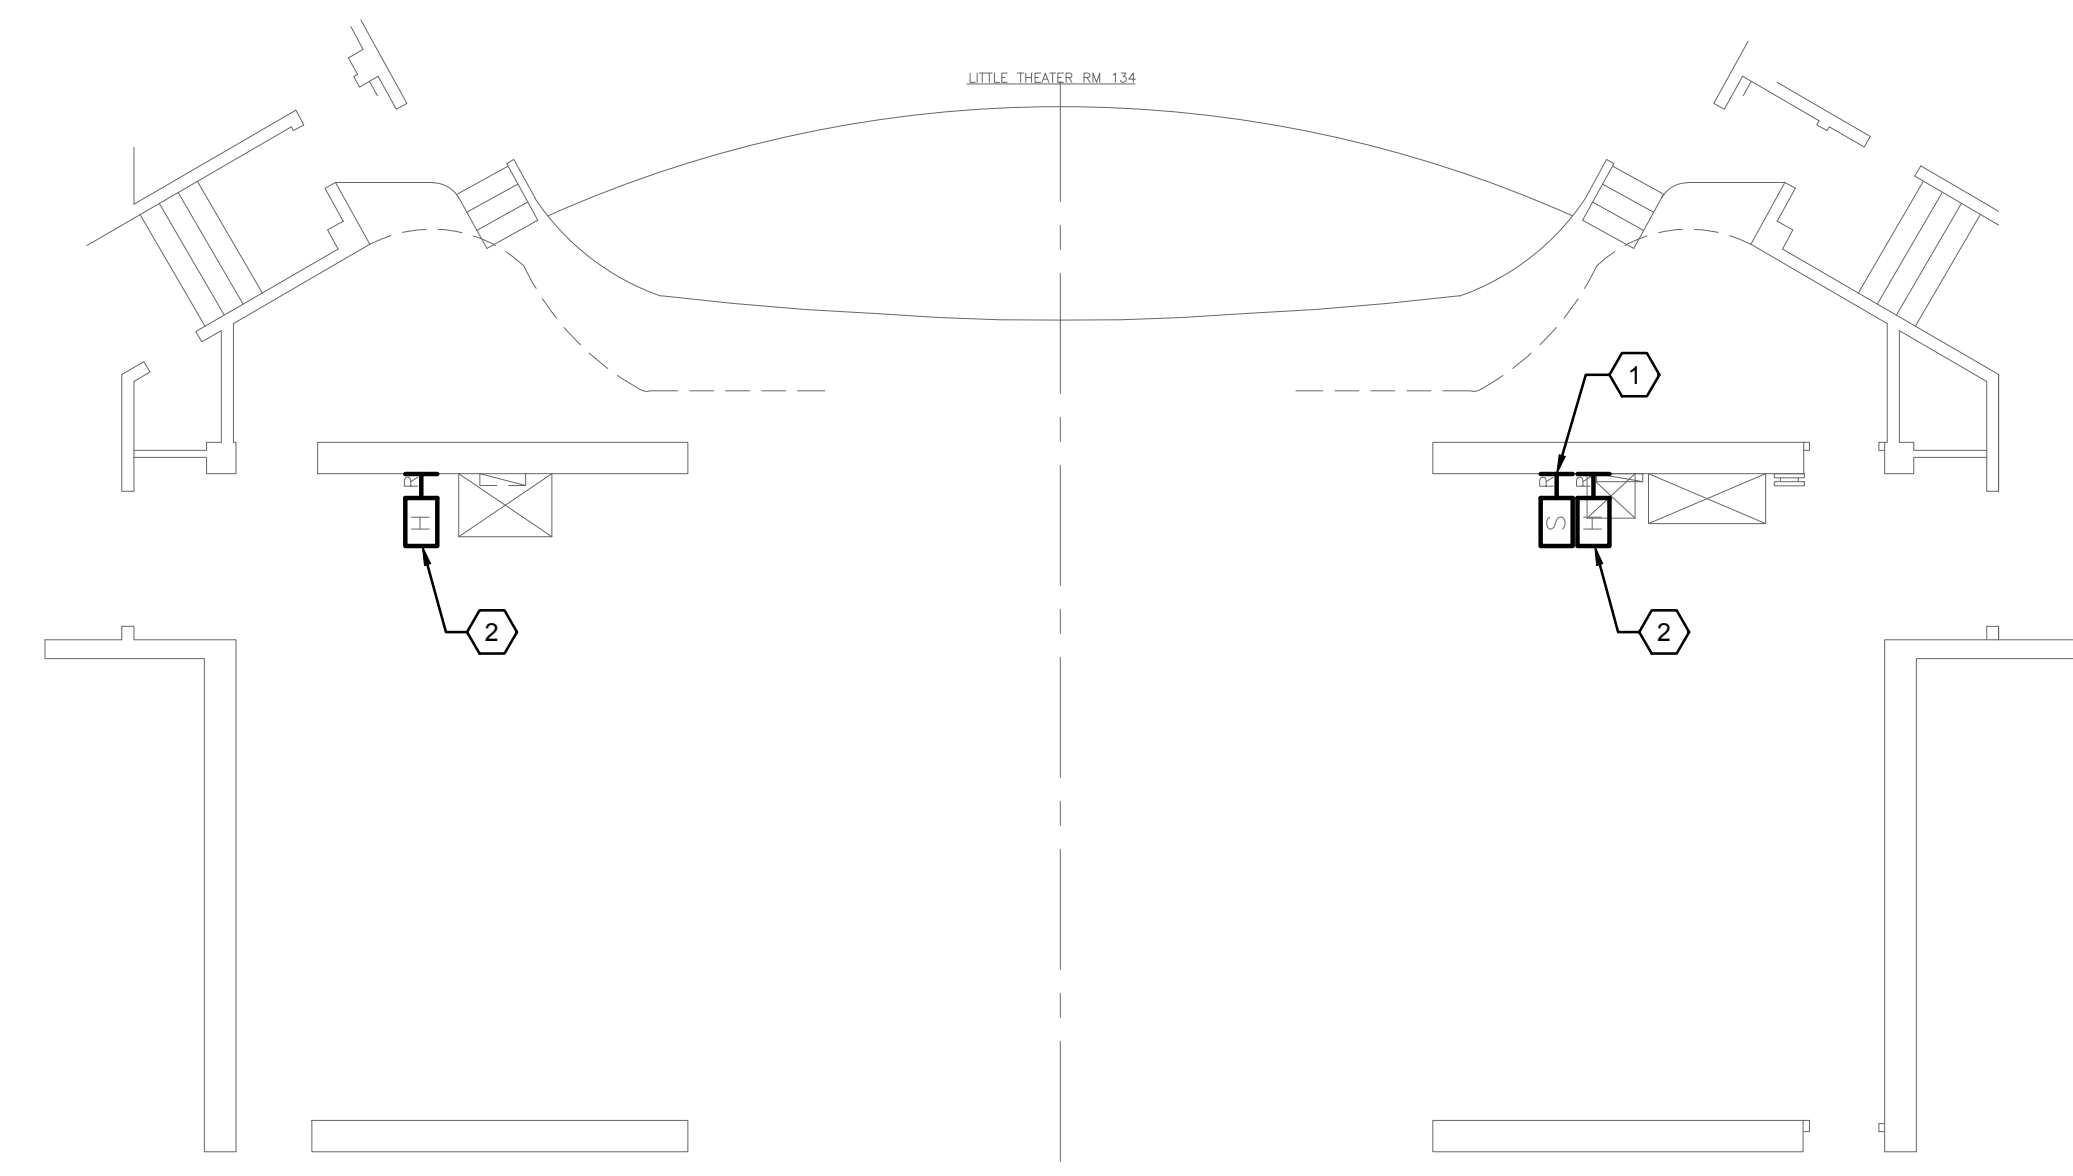


3 THEATER MAIN LEVEL STAGE PLAN
SCALE: 1/8"=1'-0"

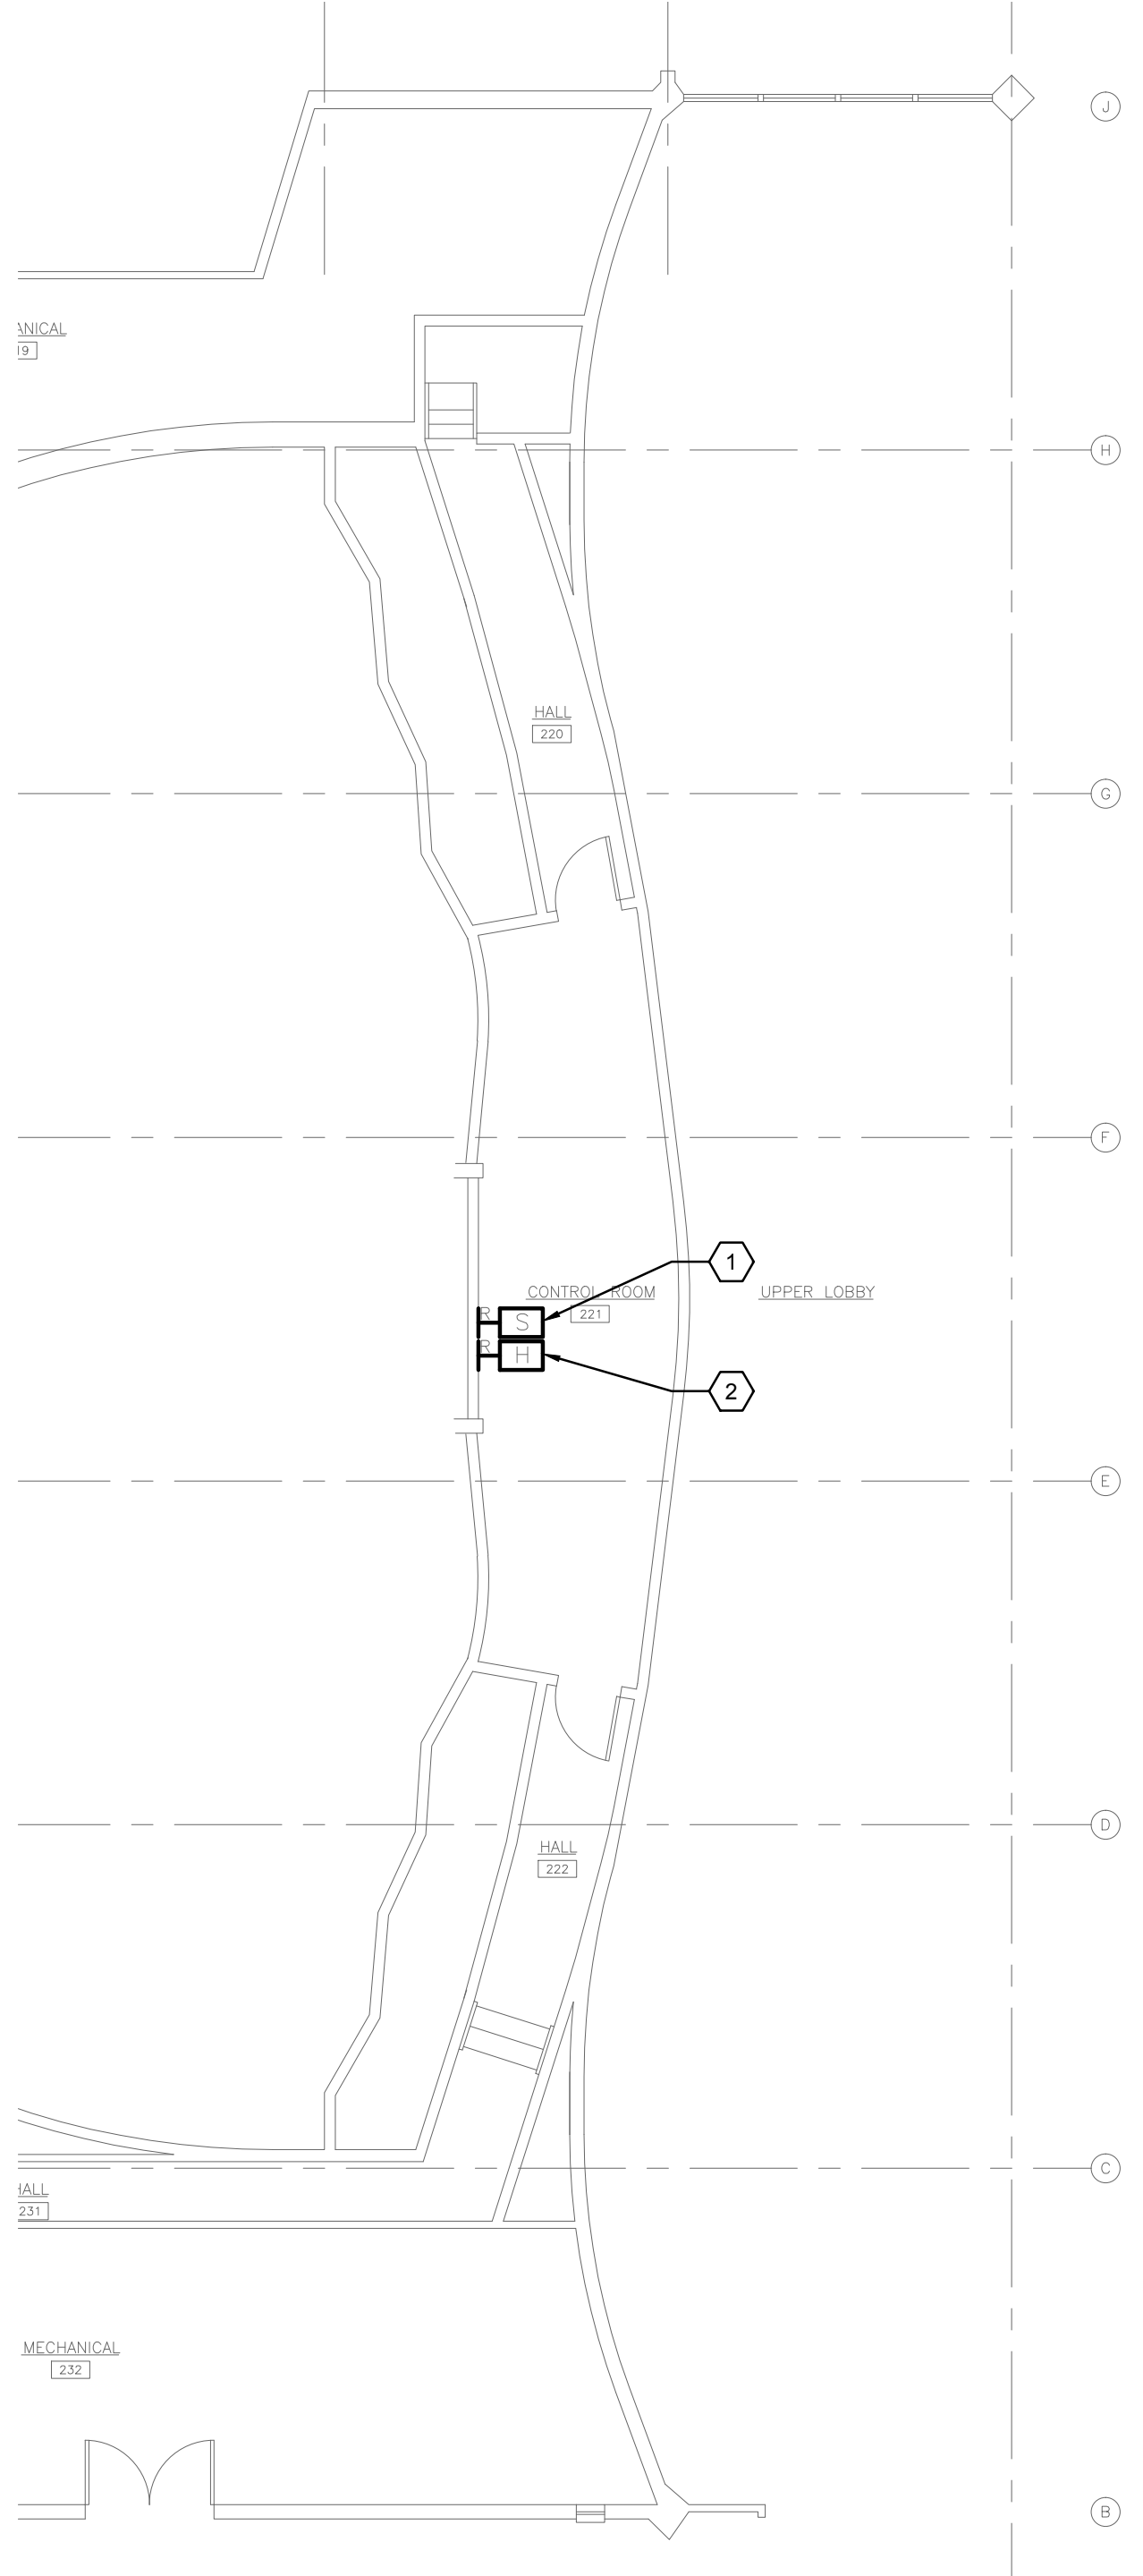

2 CONTROL ROOM PLAN
SCALE: 1/8"=1'-0"

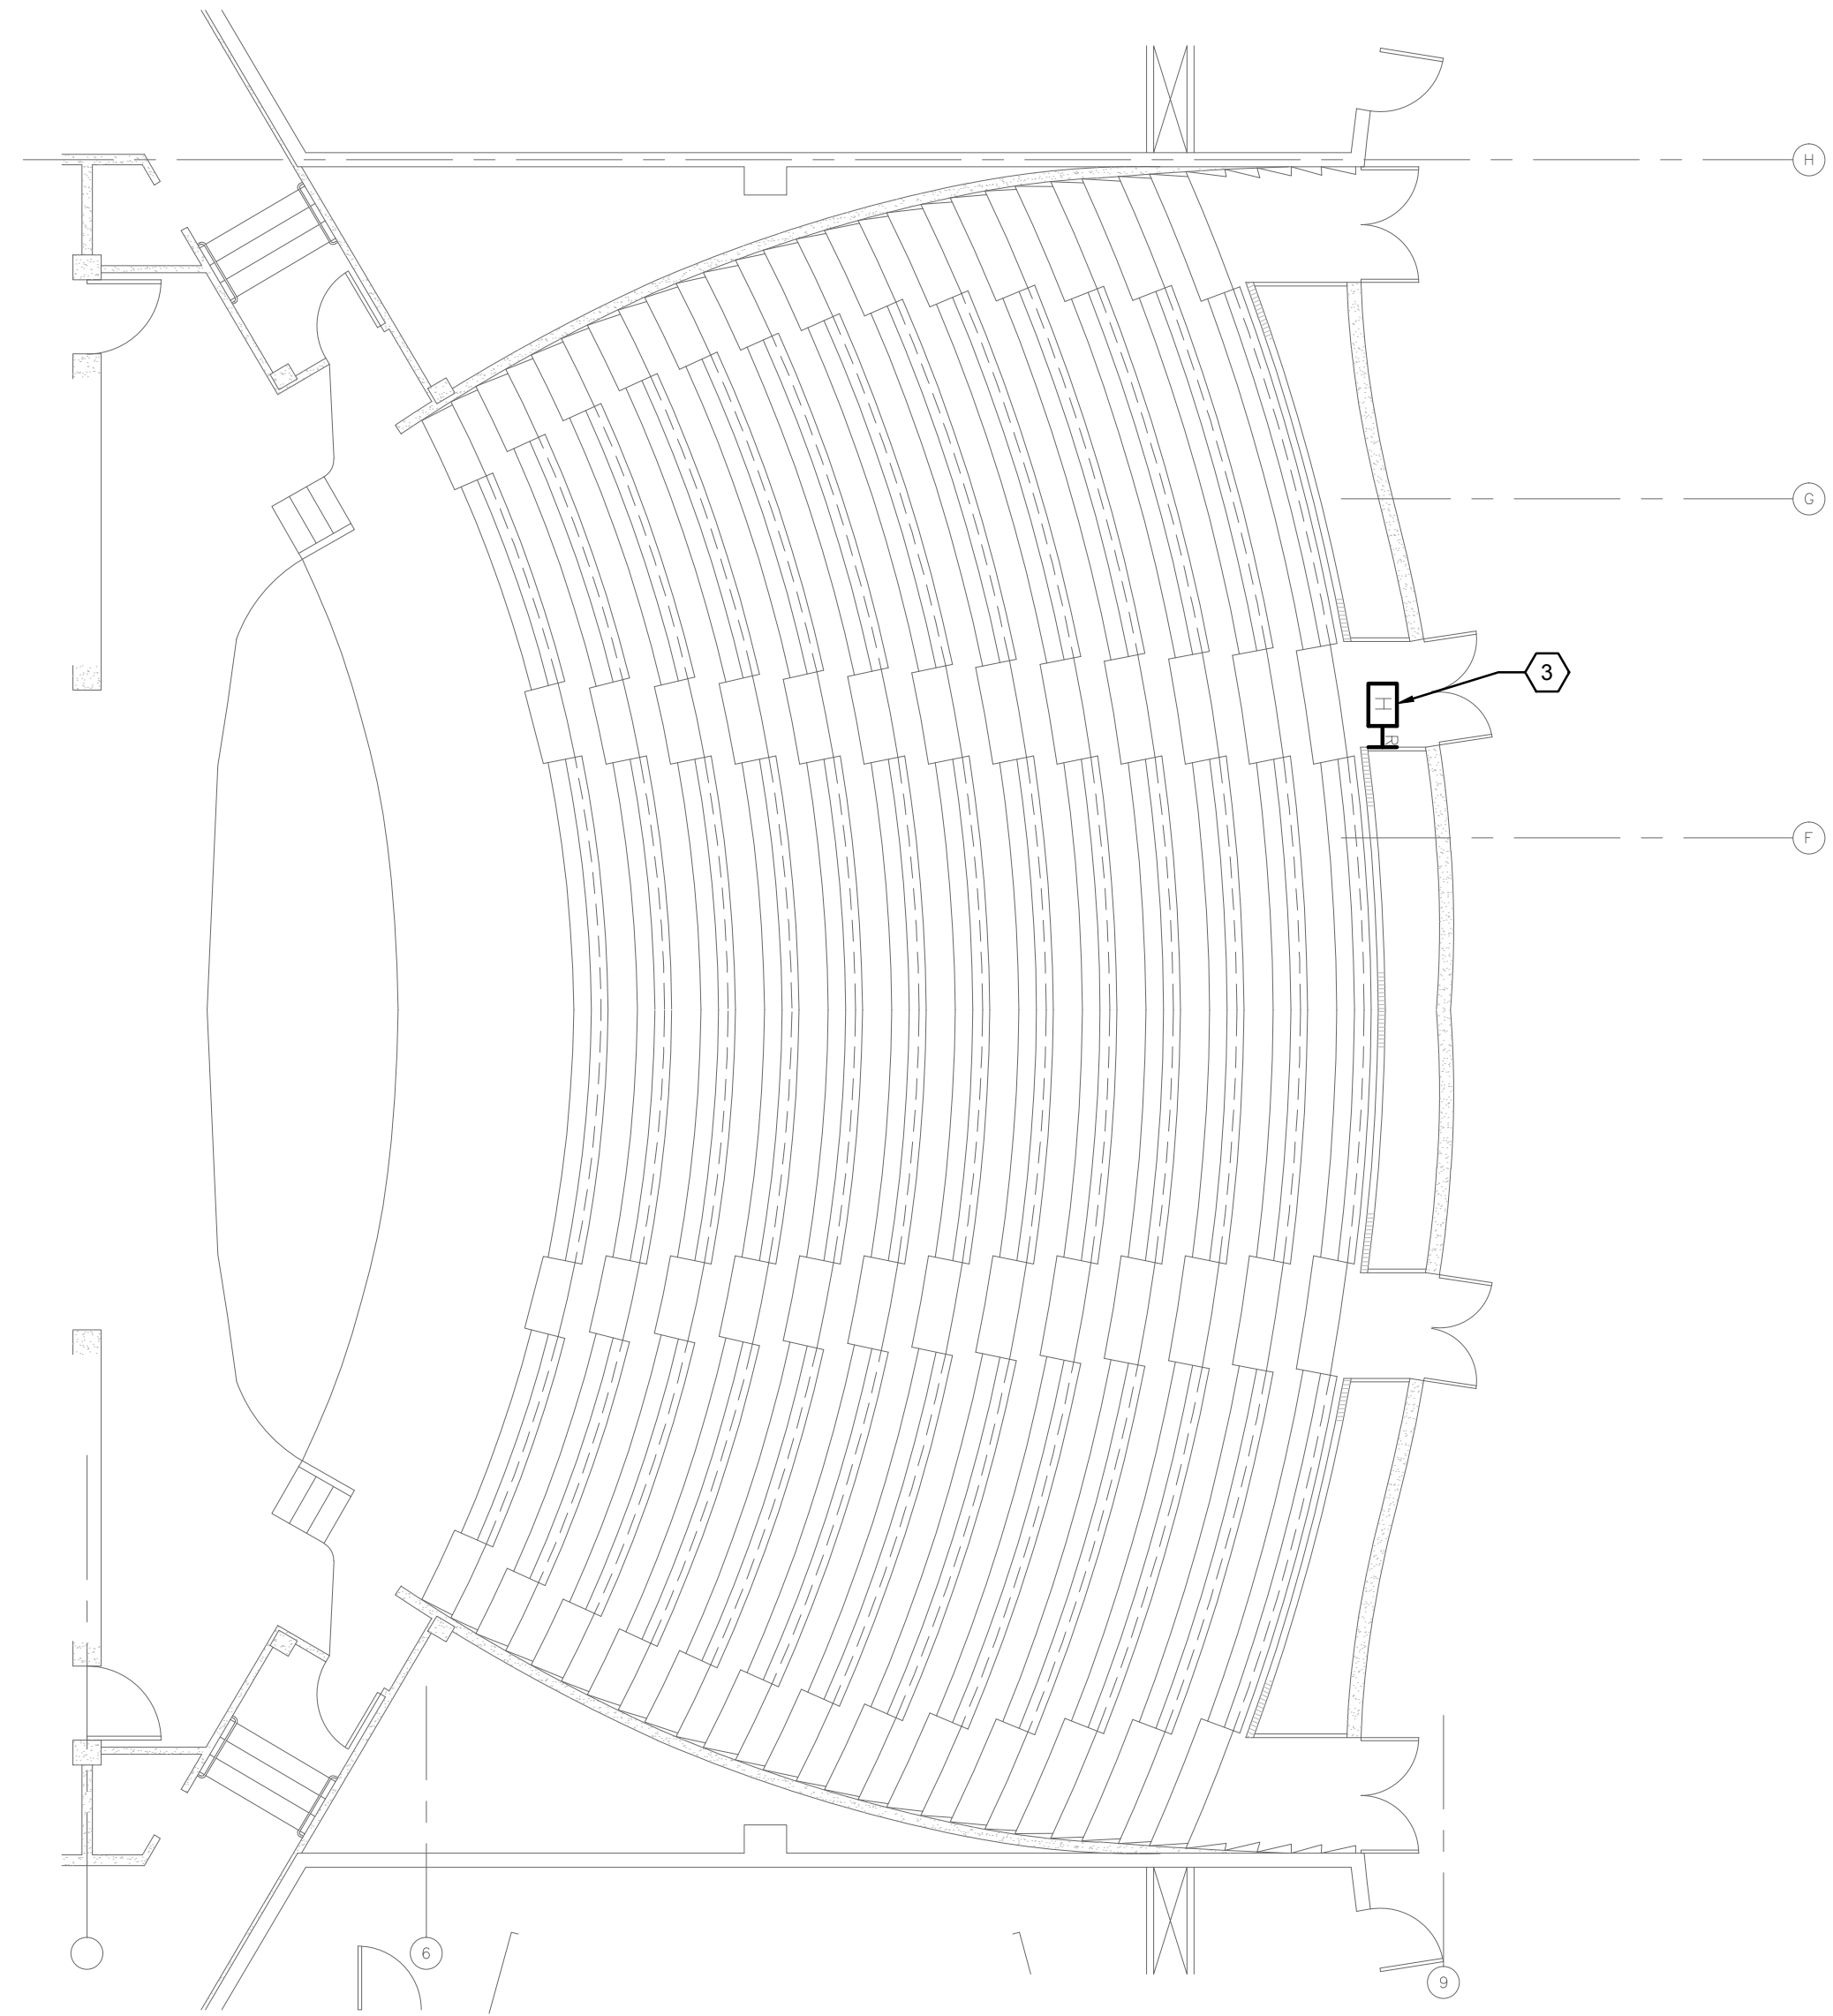

1 THEATER MAIN LEVEL AUDITORIUM PLAN
SCALE: 1/8"=1'-0"

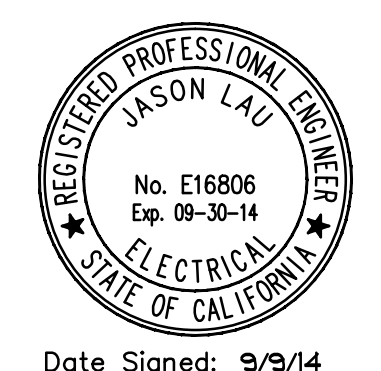

Date Signed: 9/9/14

SHEET NOTES


- ① PROVIDE DMX JUMPERS TO DAISY CHAIN DMX SIGNAL FROM FIXTURE TO FIXTURE FOR FIXTURES TYPE A & B. MAXIMUM NUMBER OF FIXTURES PER RUN IS 32. EXTEND DMX FROM NEW ETC 4-PORT NET 3 GATEWAY LOCATED IN ATTIC (EXACT LOCATION TBD)
- ② DISCONNECT AND REMOVE EXISTING INCANDESCENT DOWNLIGHT FIXTURES AND DISPOSE OF AS DIRECTED BY OWNER. EXISTING APERTURES WILL BE REUSED FOR INSTALLATION OF NEW TYPE A & B FIXTURES. INSTALL NEW TYPE A & B FIXTURES INTO EXISTING OPENINGS. CONNECT POWER SUPPLIES OF TYPE A & B FIXTURES TO EXISTING HOME-RUNS TO EXISTING ETC DR12 DIMMER RACK.

SYMBOL	DESCRIPTION
	Fixture type (see schedule for details)
	Down light luminaire, ceiling mounted in existing opening.
	Existing Snapshot Control Station
	Existing House Light Control Station

SCHEDULE OF LIGHTING FIXTURES

REFER TO ARCHITECTURAL DETAILS TO DETERMINE NECESSARY FIXTURE MOUNTING ACCESSORIES AND TO APPLICABLE BUILDING CODES FOR REQUIRED FIXTURE SUPPORTS, AND FOR MAINTAINING CEILING FIRE RATINGS.

TYPE	FIXTURE DESCRIPTION	MFR'S CATALOG NO.	MOUNTING	VOLTAGE	LAMPS/WATTAGE
	RECESSED LED DOWNLIGHT, 2700 KELVIN, 2000 LUMENS, 45 DEGREE BEAM ANGLE, DMX-RDM CONTROLLED.	GOHAM ICO 27/20 6AR 45 120 DMXR, NPP16D	RECESSED HT. AS NOTED	120	2700K WHITE LED 35 WATTS
	RECESSED LED DOWNLIGHT, 2700 KELVIN, 2000 LUMENS, 70 DEGREE BEAM ANGLE, DMX-RDM CONTROLLED.	GOHAM ICO 27/20 6AR 70 120 DMX5, NPP16D	RECESSED HT. AS NOTED	120	2700K WHITE LED 35 WATTS

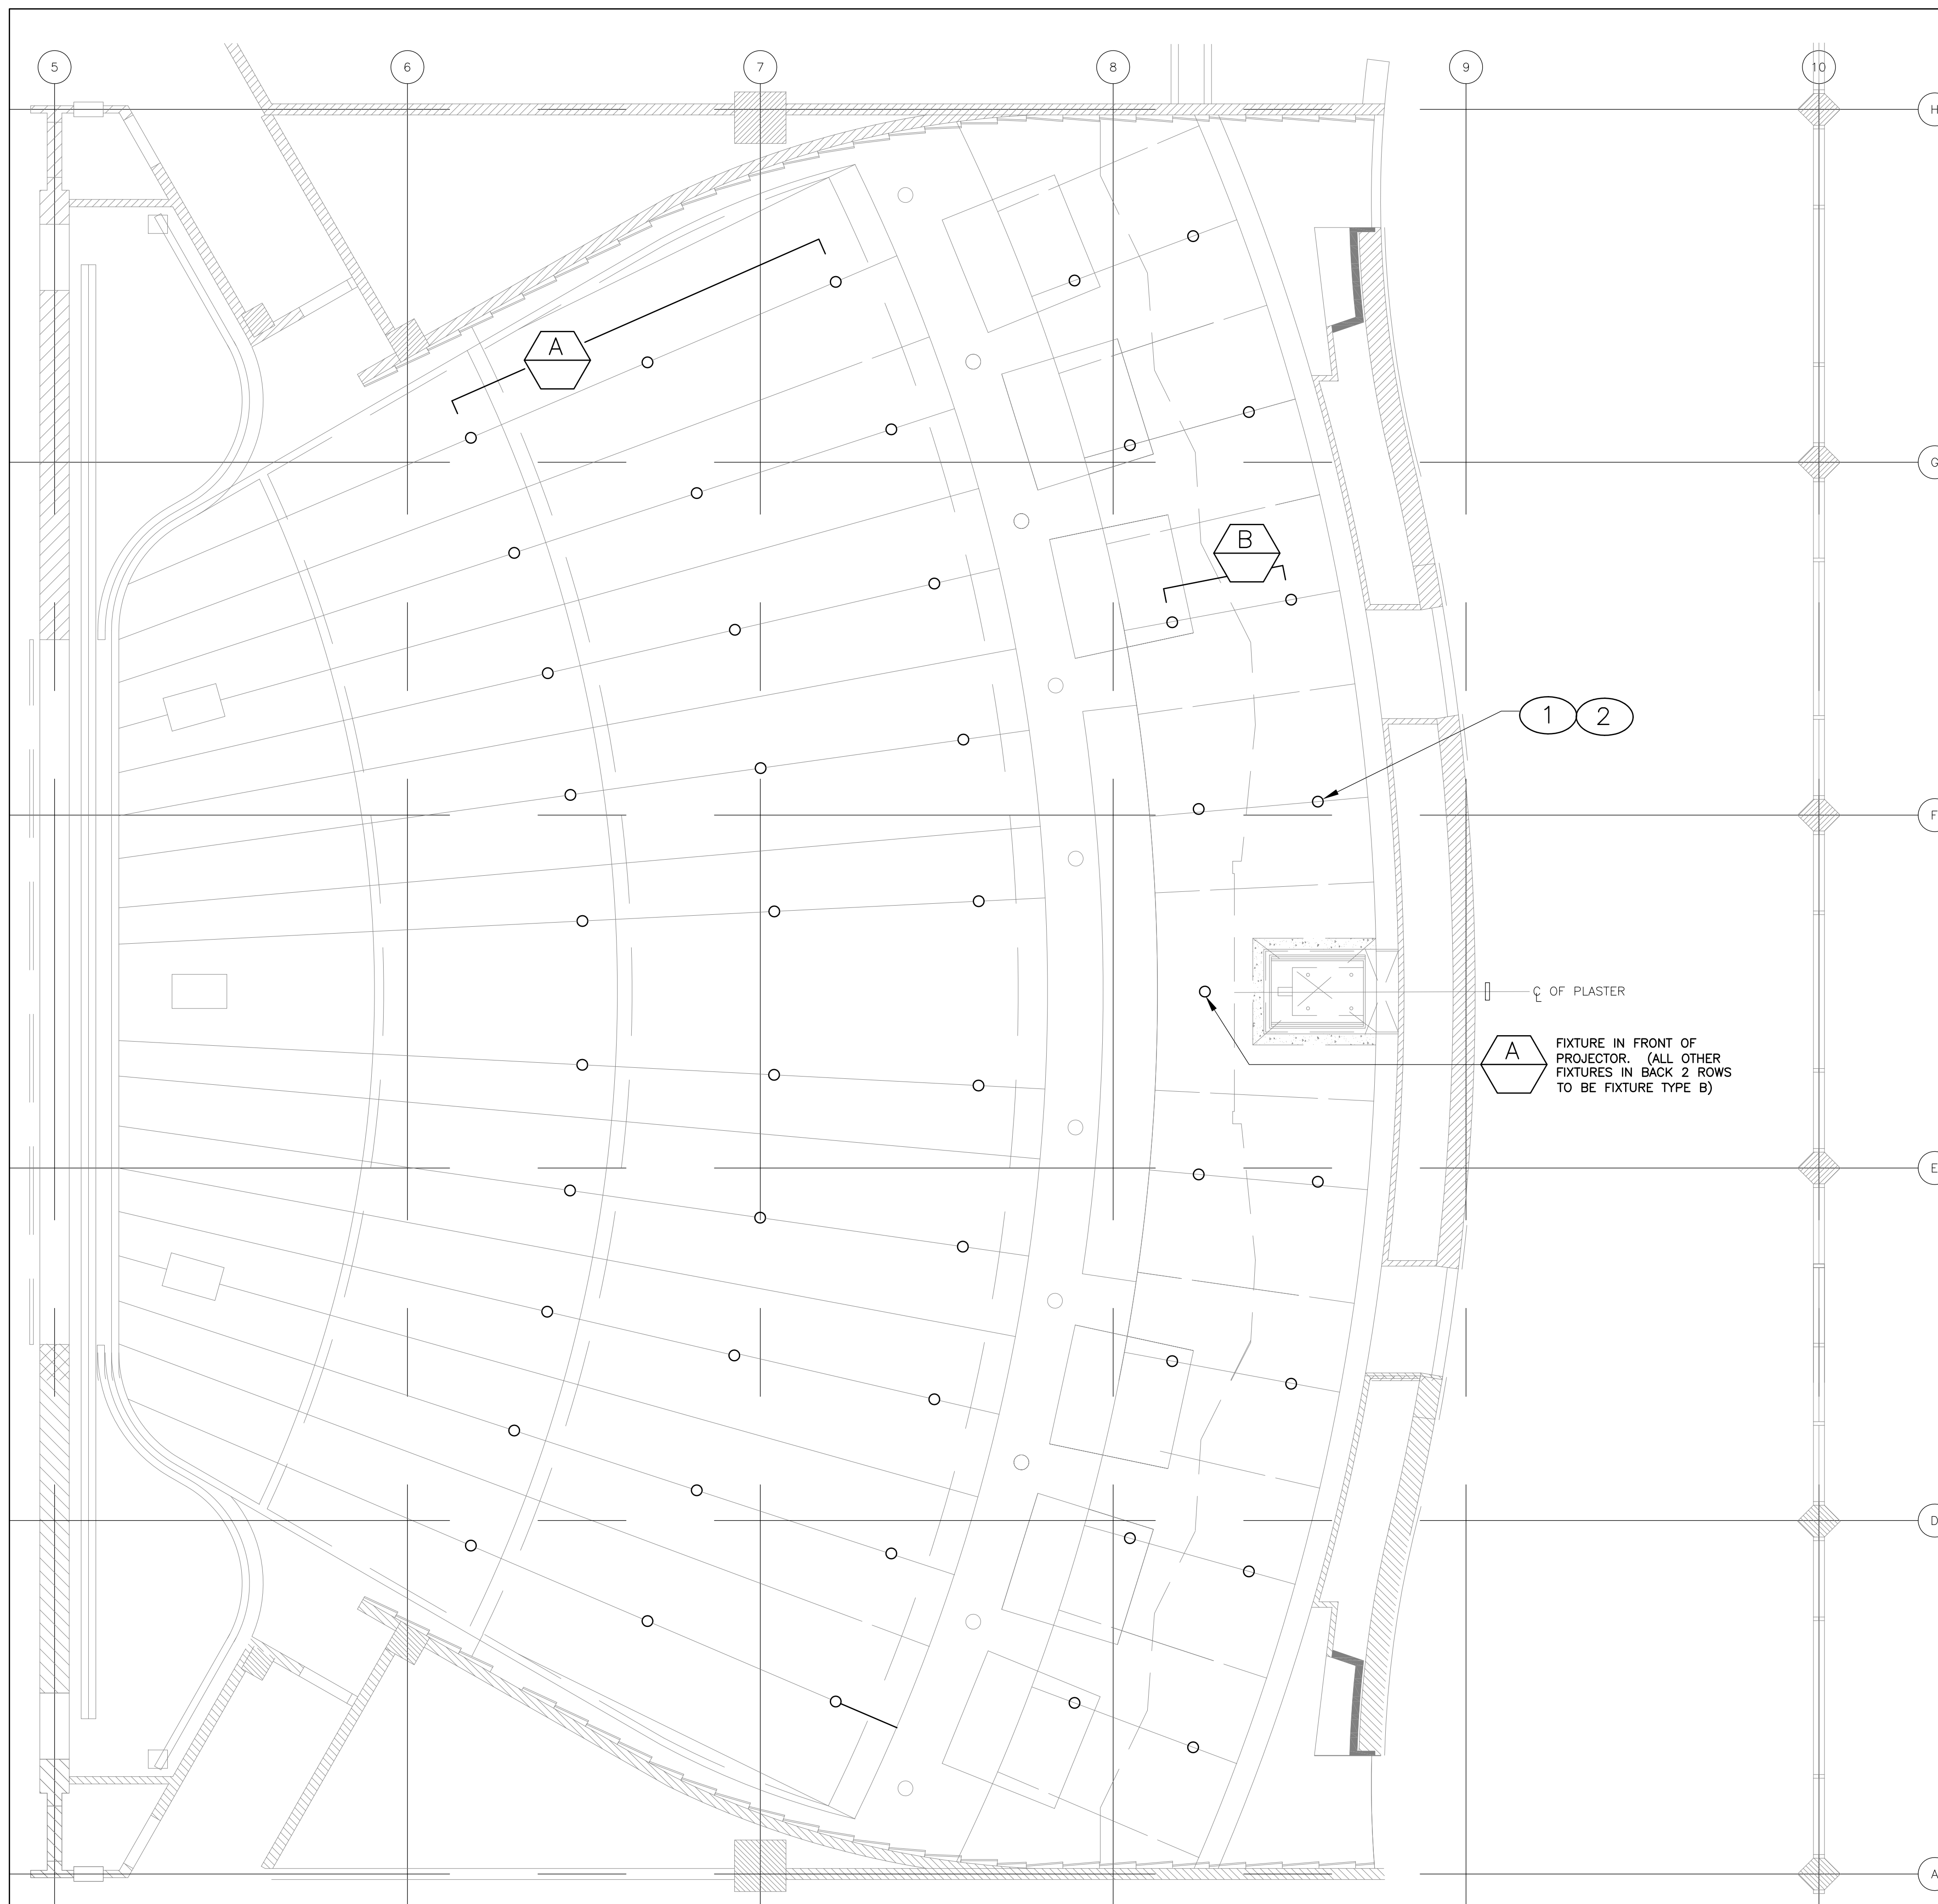

① THEATER REFLECTED CEILING PLAN
1/4" = 1'-0"

LANDRY & BOGAN
THEATRE CONSULTANTS
733 W. Evelyn Ave. Mountain View, CA 94041
(650) 969-5195 Fax 969-4965
heather@landb.com

SAN MATEO COUNTY COMMUNITY COLLEGE DISTRICT
CAÑADA/COLLEGE OF SAN MATEO
THEATER HOUSE LIGHTING RETROFIT
COLLEGE OF SAN MATEO - BUILDING 3
1700 WEST HILLSDALE BLVD., SAN MATEO, CA 94402


REVISIONS

--	--


SHEET TITLE
THEATER HOUSE
LIGHTING RETROFIT
REFLECTED CEILING
PLAN

SCALE: AS NOTED
DATE: September 16, 2014


TL2.1

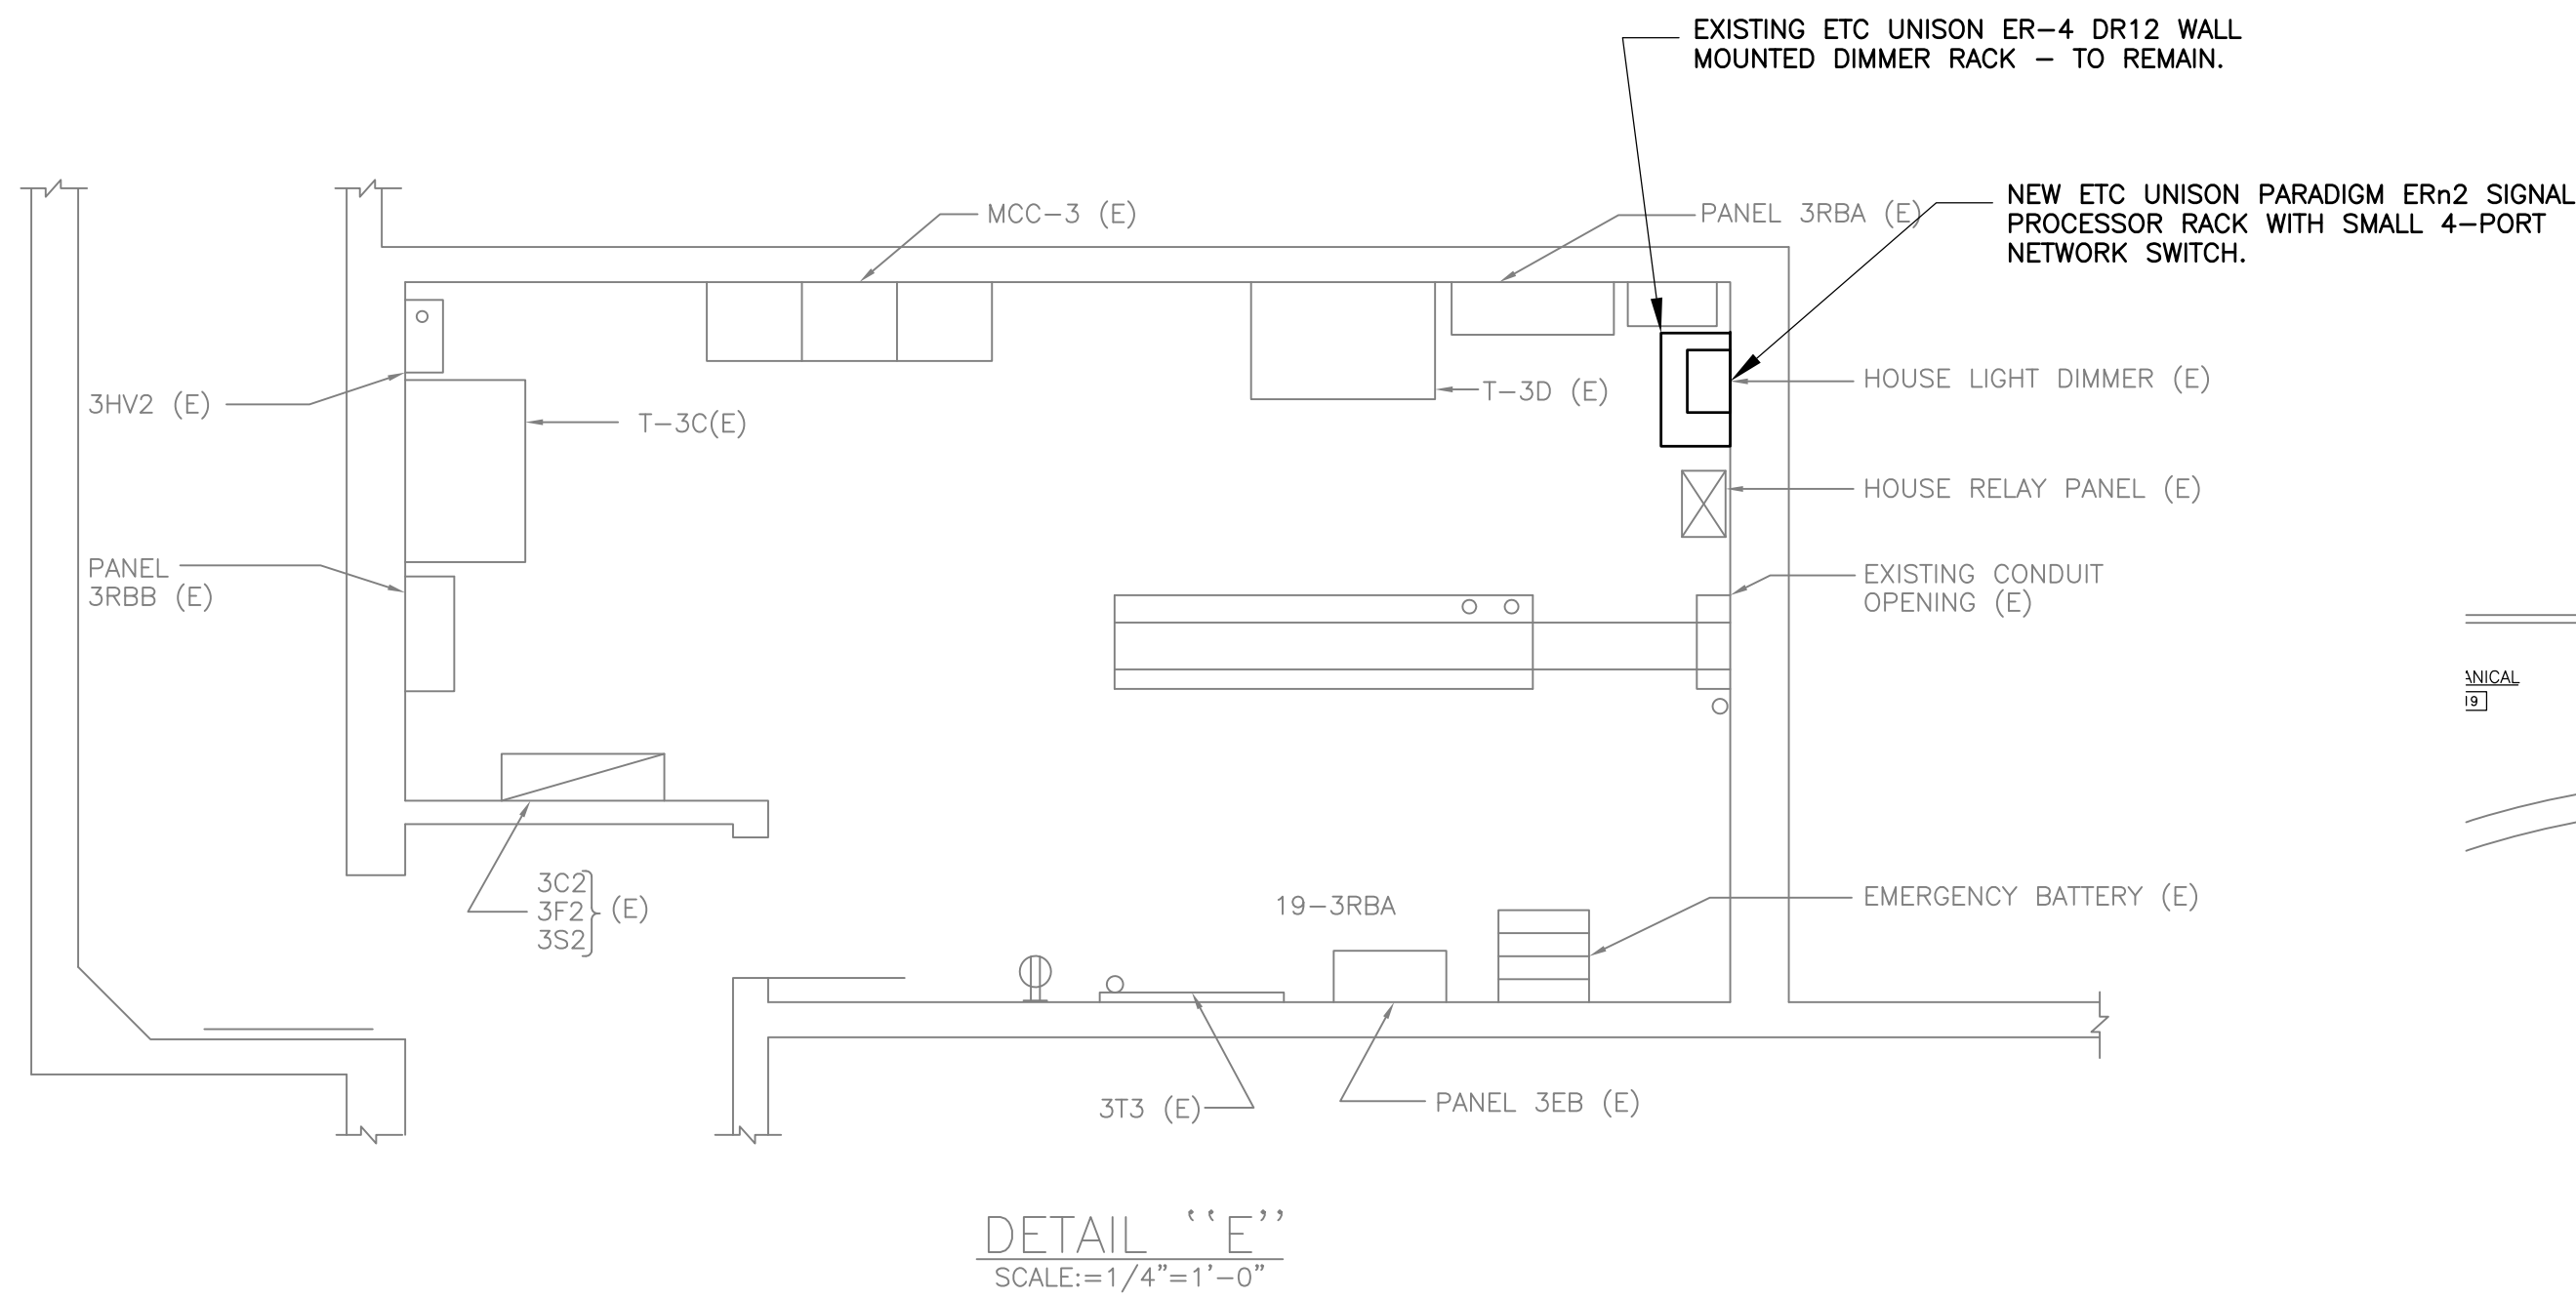


4 THEATER BASEMENT LEVEL ELECTRICAL ROOM PLAN
1/4" = 1'-0"

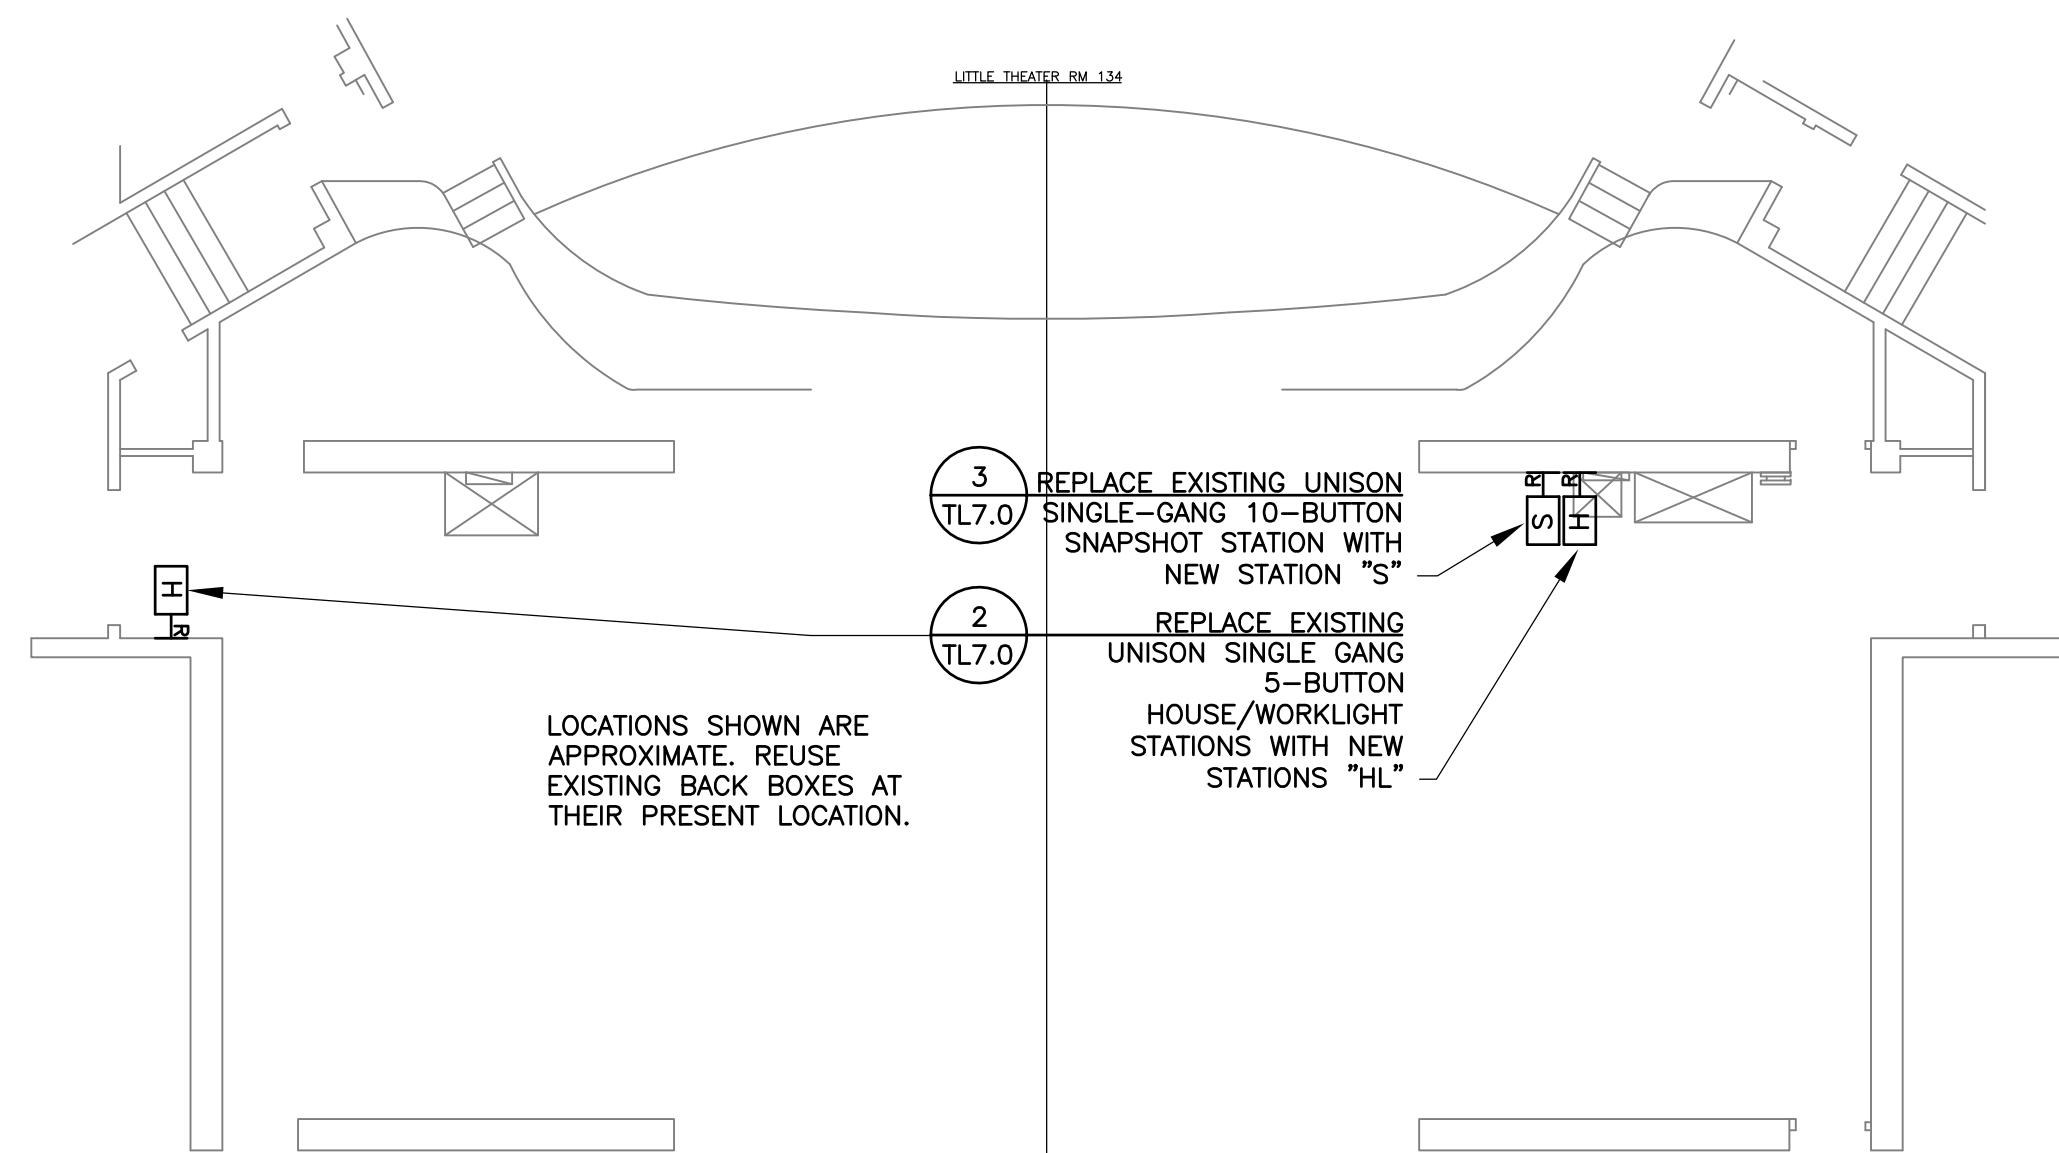

3 THEATER MAIN LEVEL STAGE PLAN
1/8" = 1'-0"

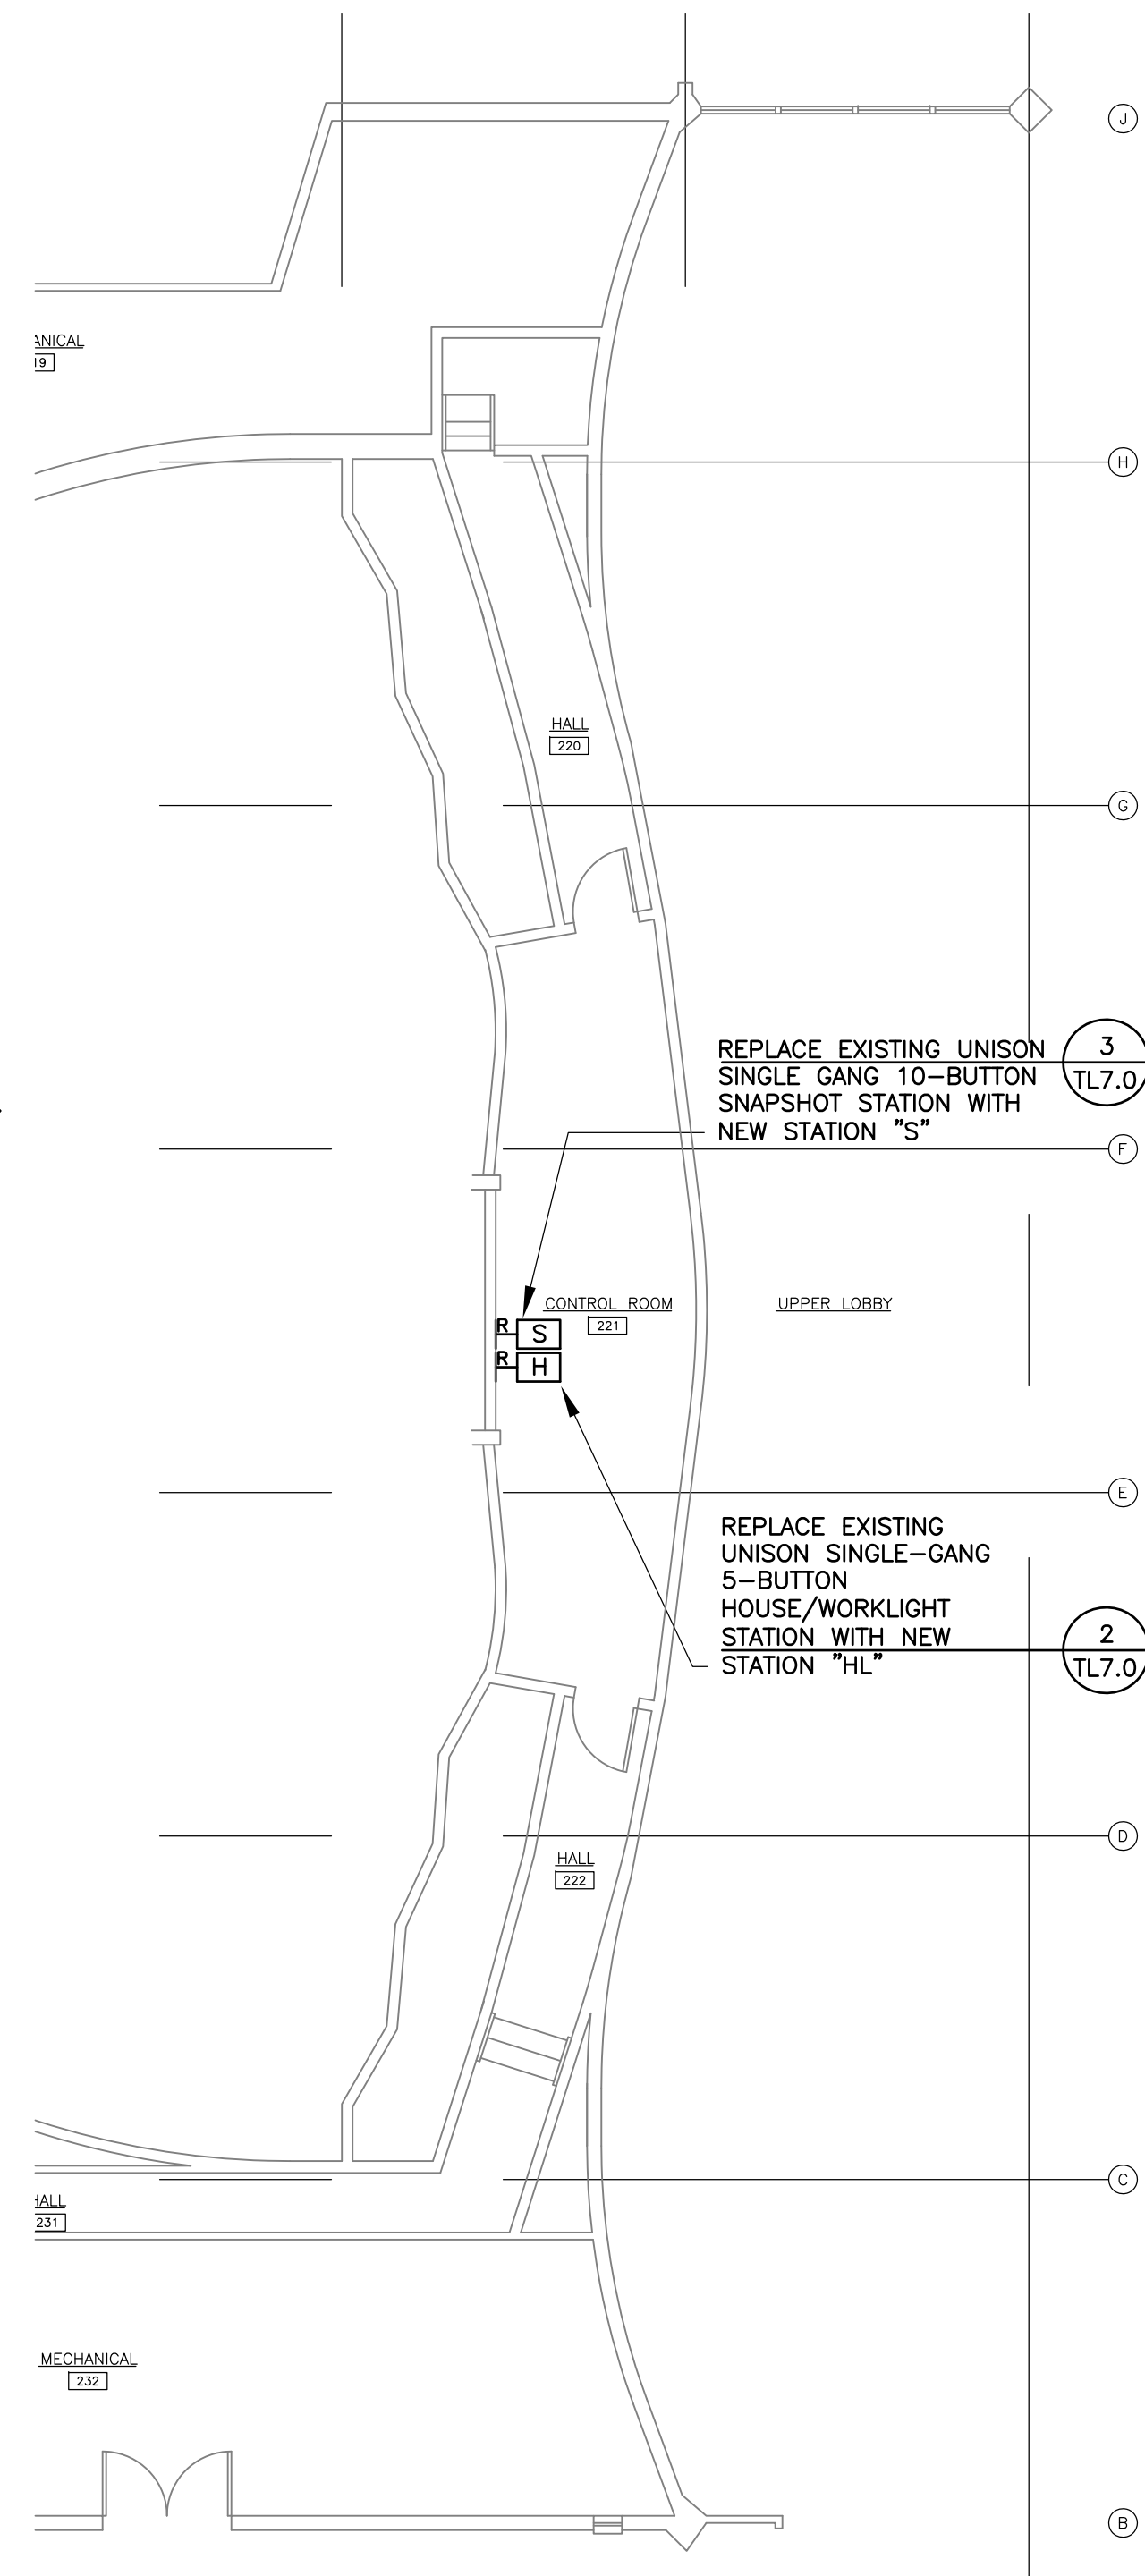

2 CONTROL ROOM PLAN
1/8" = 1'-0"

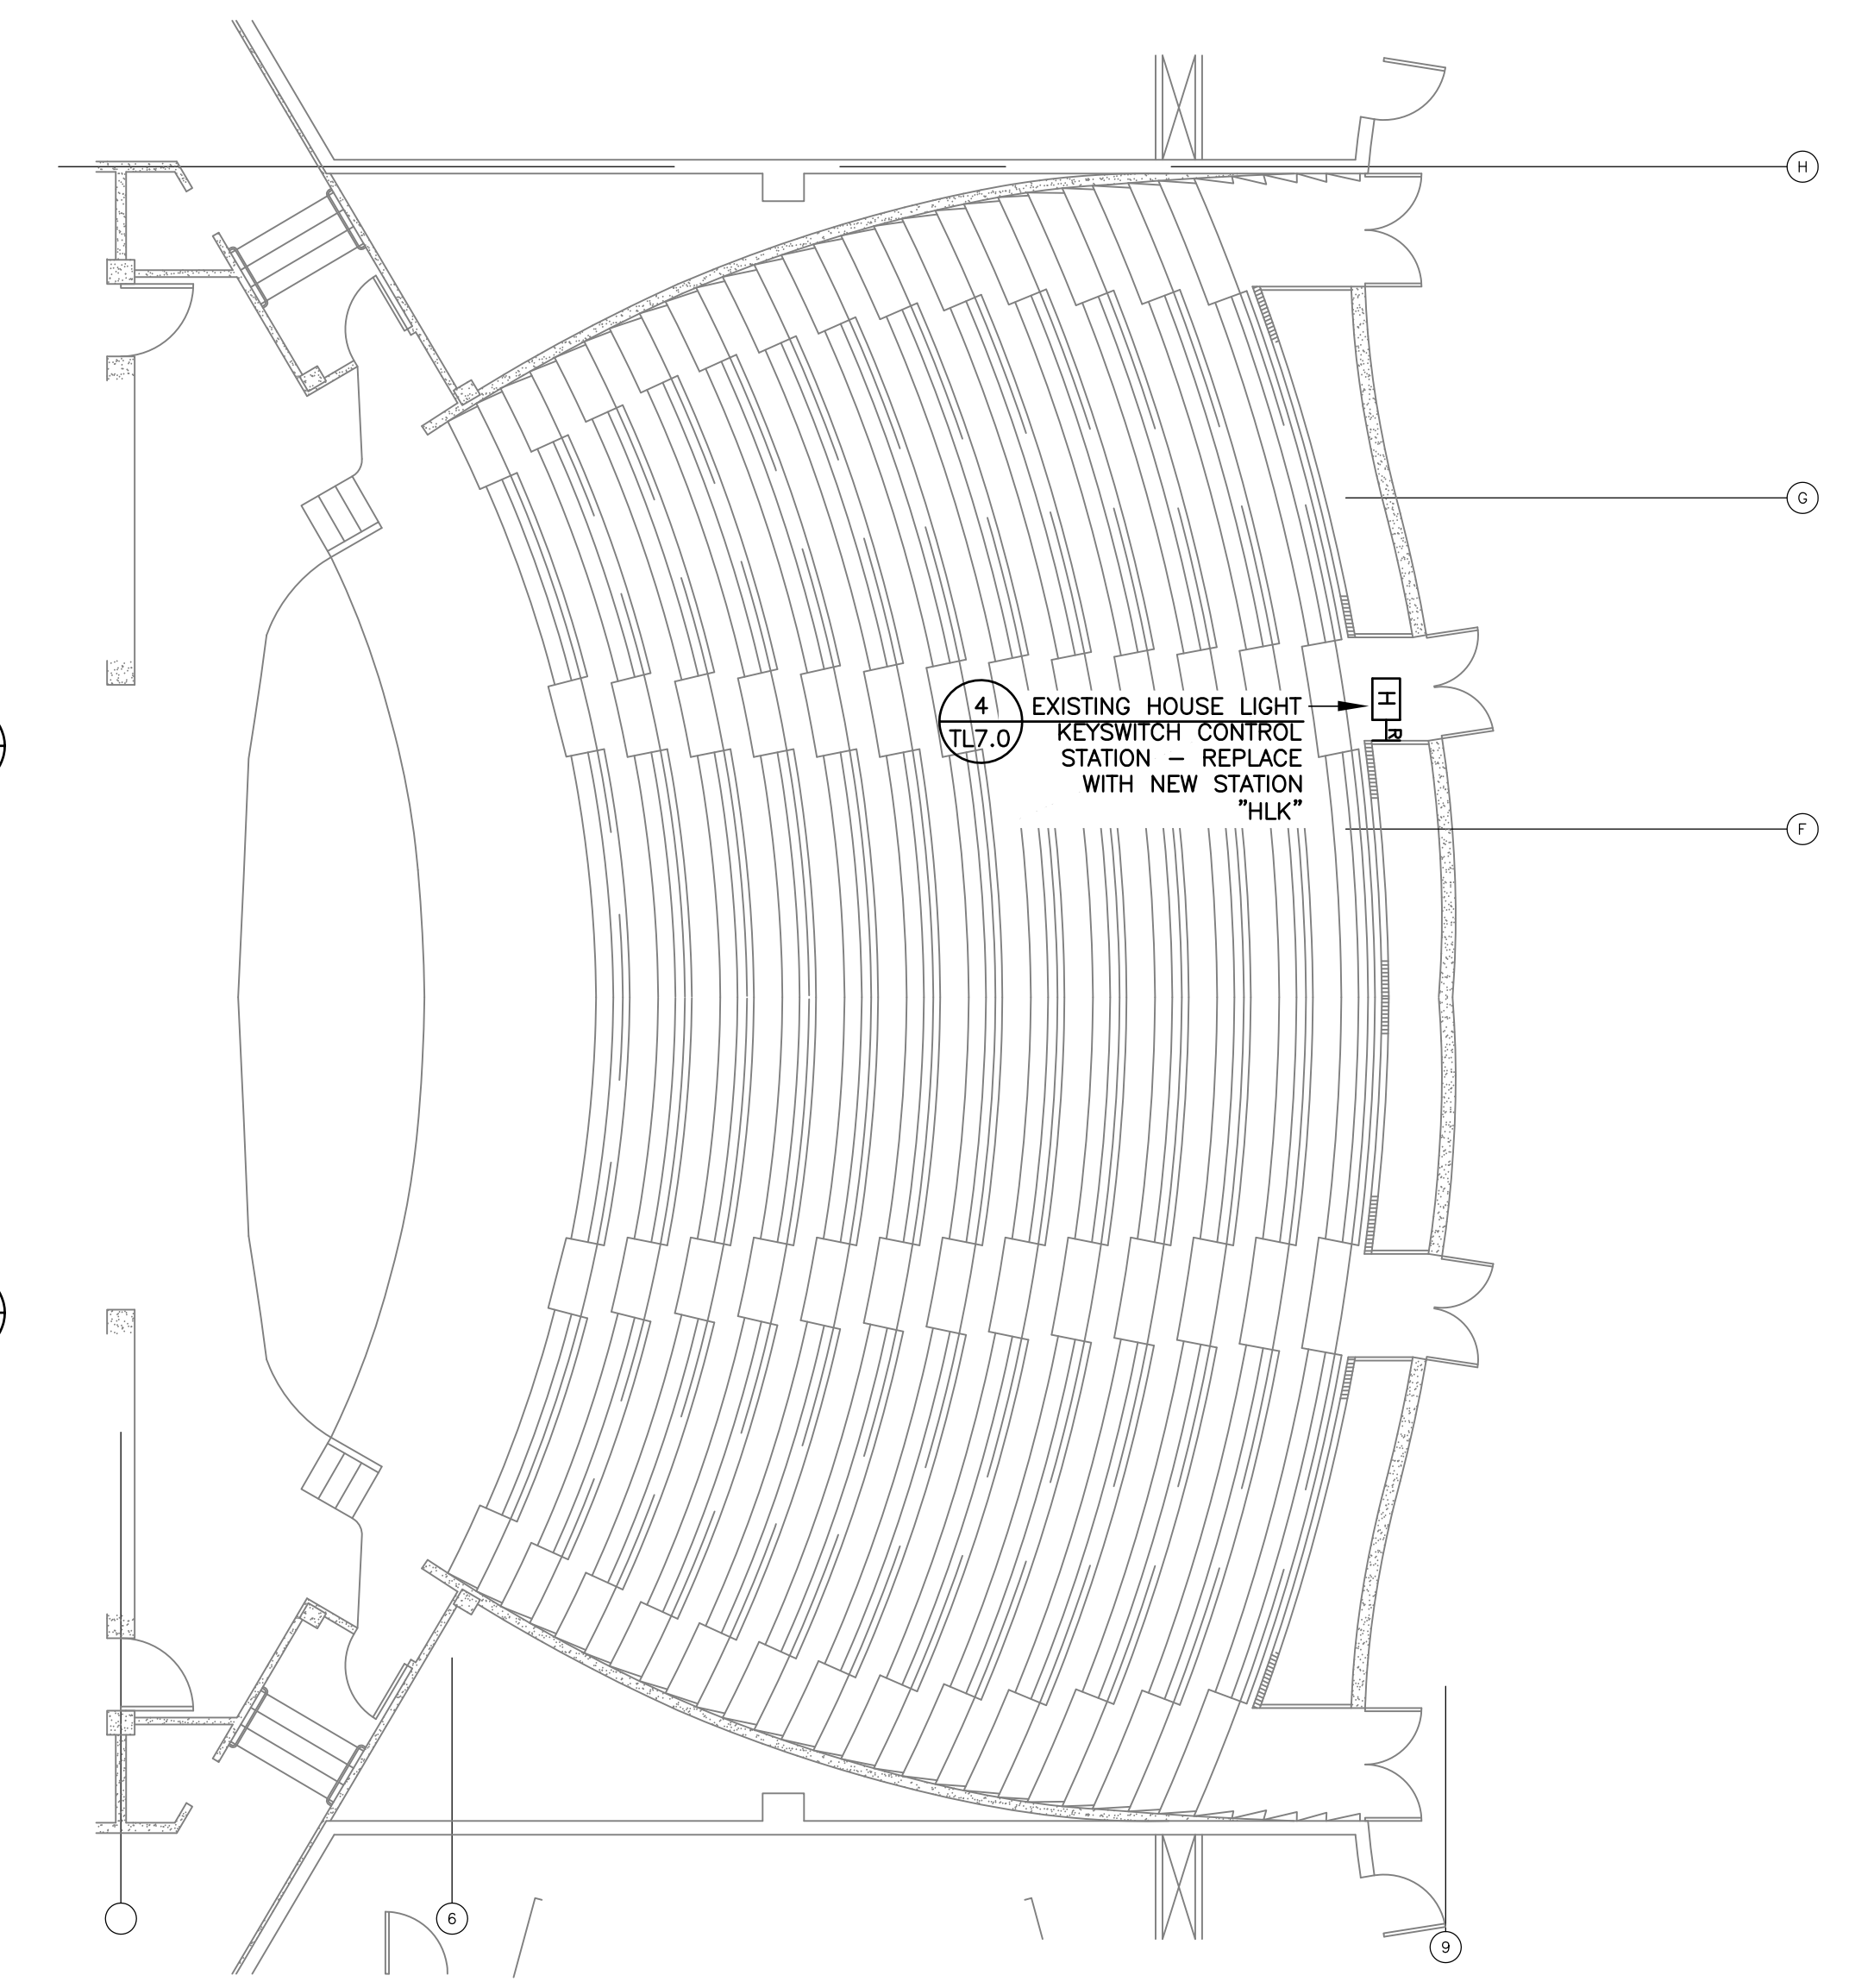

1 THEATER MAIN LEVEL AUDITORIUM PLAN
1/8" = 1'-0"

File Name: 3501E-1

LANDRY & BOGAN
THEATRE CONSULTANTS
733 W. Evelyn Ave. Mountain View, CA 94041
(650) 969-5195 Fax 969-4965
heather@landb.com


SAN MATEO COUNTY COMMUNITY COLLEGE DISTRICT
CAÑADA/COLLEGE OF SAN MATEO
THEATER HOUSE LIGHTING RETROFIT
COLLEGE OF SAN MATEO - BUILDING 3
1700 WEST HILLSDALE BLVD., SAN MATEO, CA 94402

REVISIONS

SHEET TITLE
THEATER HOUSE
LIGHTING RETROFIT
MAIN LEVEL
PLAN

SCALE: AS NOTED
DATE: September 16, 2014


TL2.2

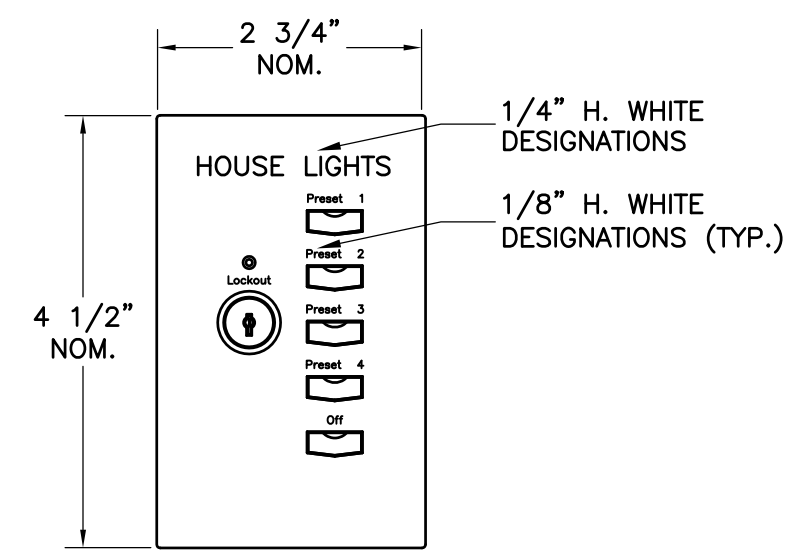

STEEL OR ALUMINUM FACEPLATE W/BLACK SEMI-GLOSS FINISH AND WHITE DESIGNATIONS. FACE PLATE REMOVABLE FOR ACCESS.

MOUNT ON EXISTING SINGLE-GANG BACK BOX


4 HOUSELIGHT KEYSWITCH STATION "HLK"
6' - 1'-0"

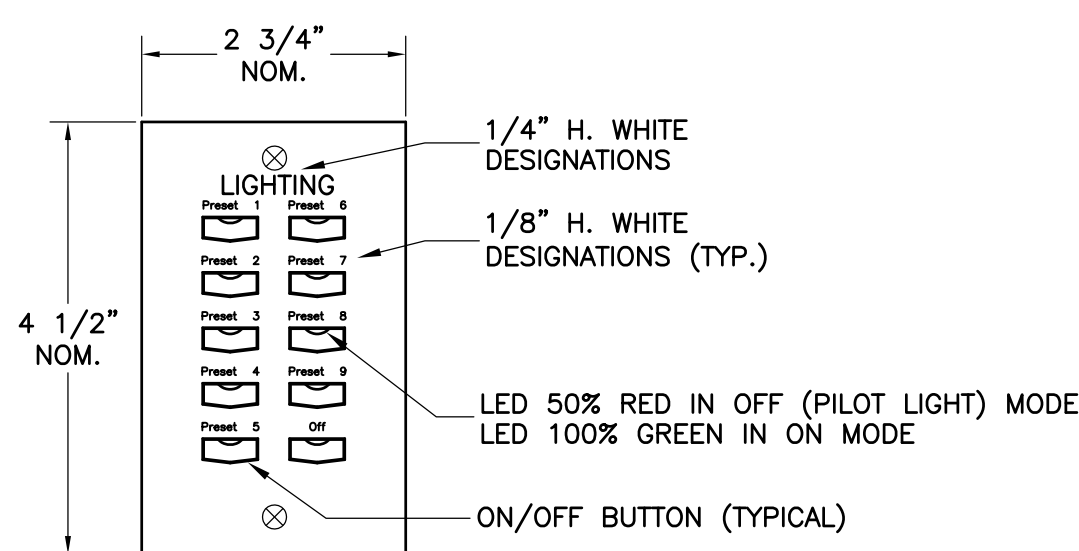

STEEL OR ALUMINUM FACEPLATE W/BLACK SEMI-GLOSS FINISH AND WHITE DESIGNATIONS. FACE PLATE REMOVABLE FOR ACCESS.

MOUNT ON EXISTING SINGLE GANG BACK BOX.

3 SNAPSHOT STATION "S"
6' - 1'-0"

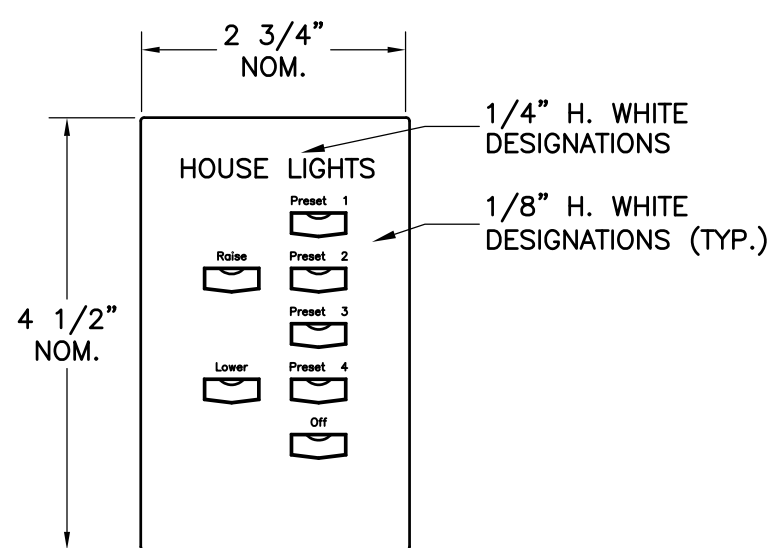

STEEL OR ALUMINUM FACEPLATE W/BLACK SEMI-GLOSS FINISH AND WHITE DESIGNATIONS. FACE PLATE REMOVABLE FOR ACCESS.


MOUNT ON EXISTING SINGLE-GANG BACK BOX.

2 HOUSE LIGHT STATION "HL"
6' - 1'-0"

SCHEDULE OF SIGNAL AND CONTROL CONDUCTORS

Cond. Group	Wire Count	Cable type (or equal)	Conductor Use(s)
(D)	2PR#24	(1) Belden 9729	DMX (EXISTING - REUSE)
(H)	1PR#16 1#14	(1) Belden 8471 THHN	UNISON STATIONS (EXISTING - REUSE)
(N) X#	4PR#24	(1) Belden 1583A	NETWORK (NEW)

= Number of type in conduit

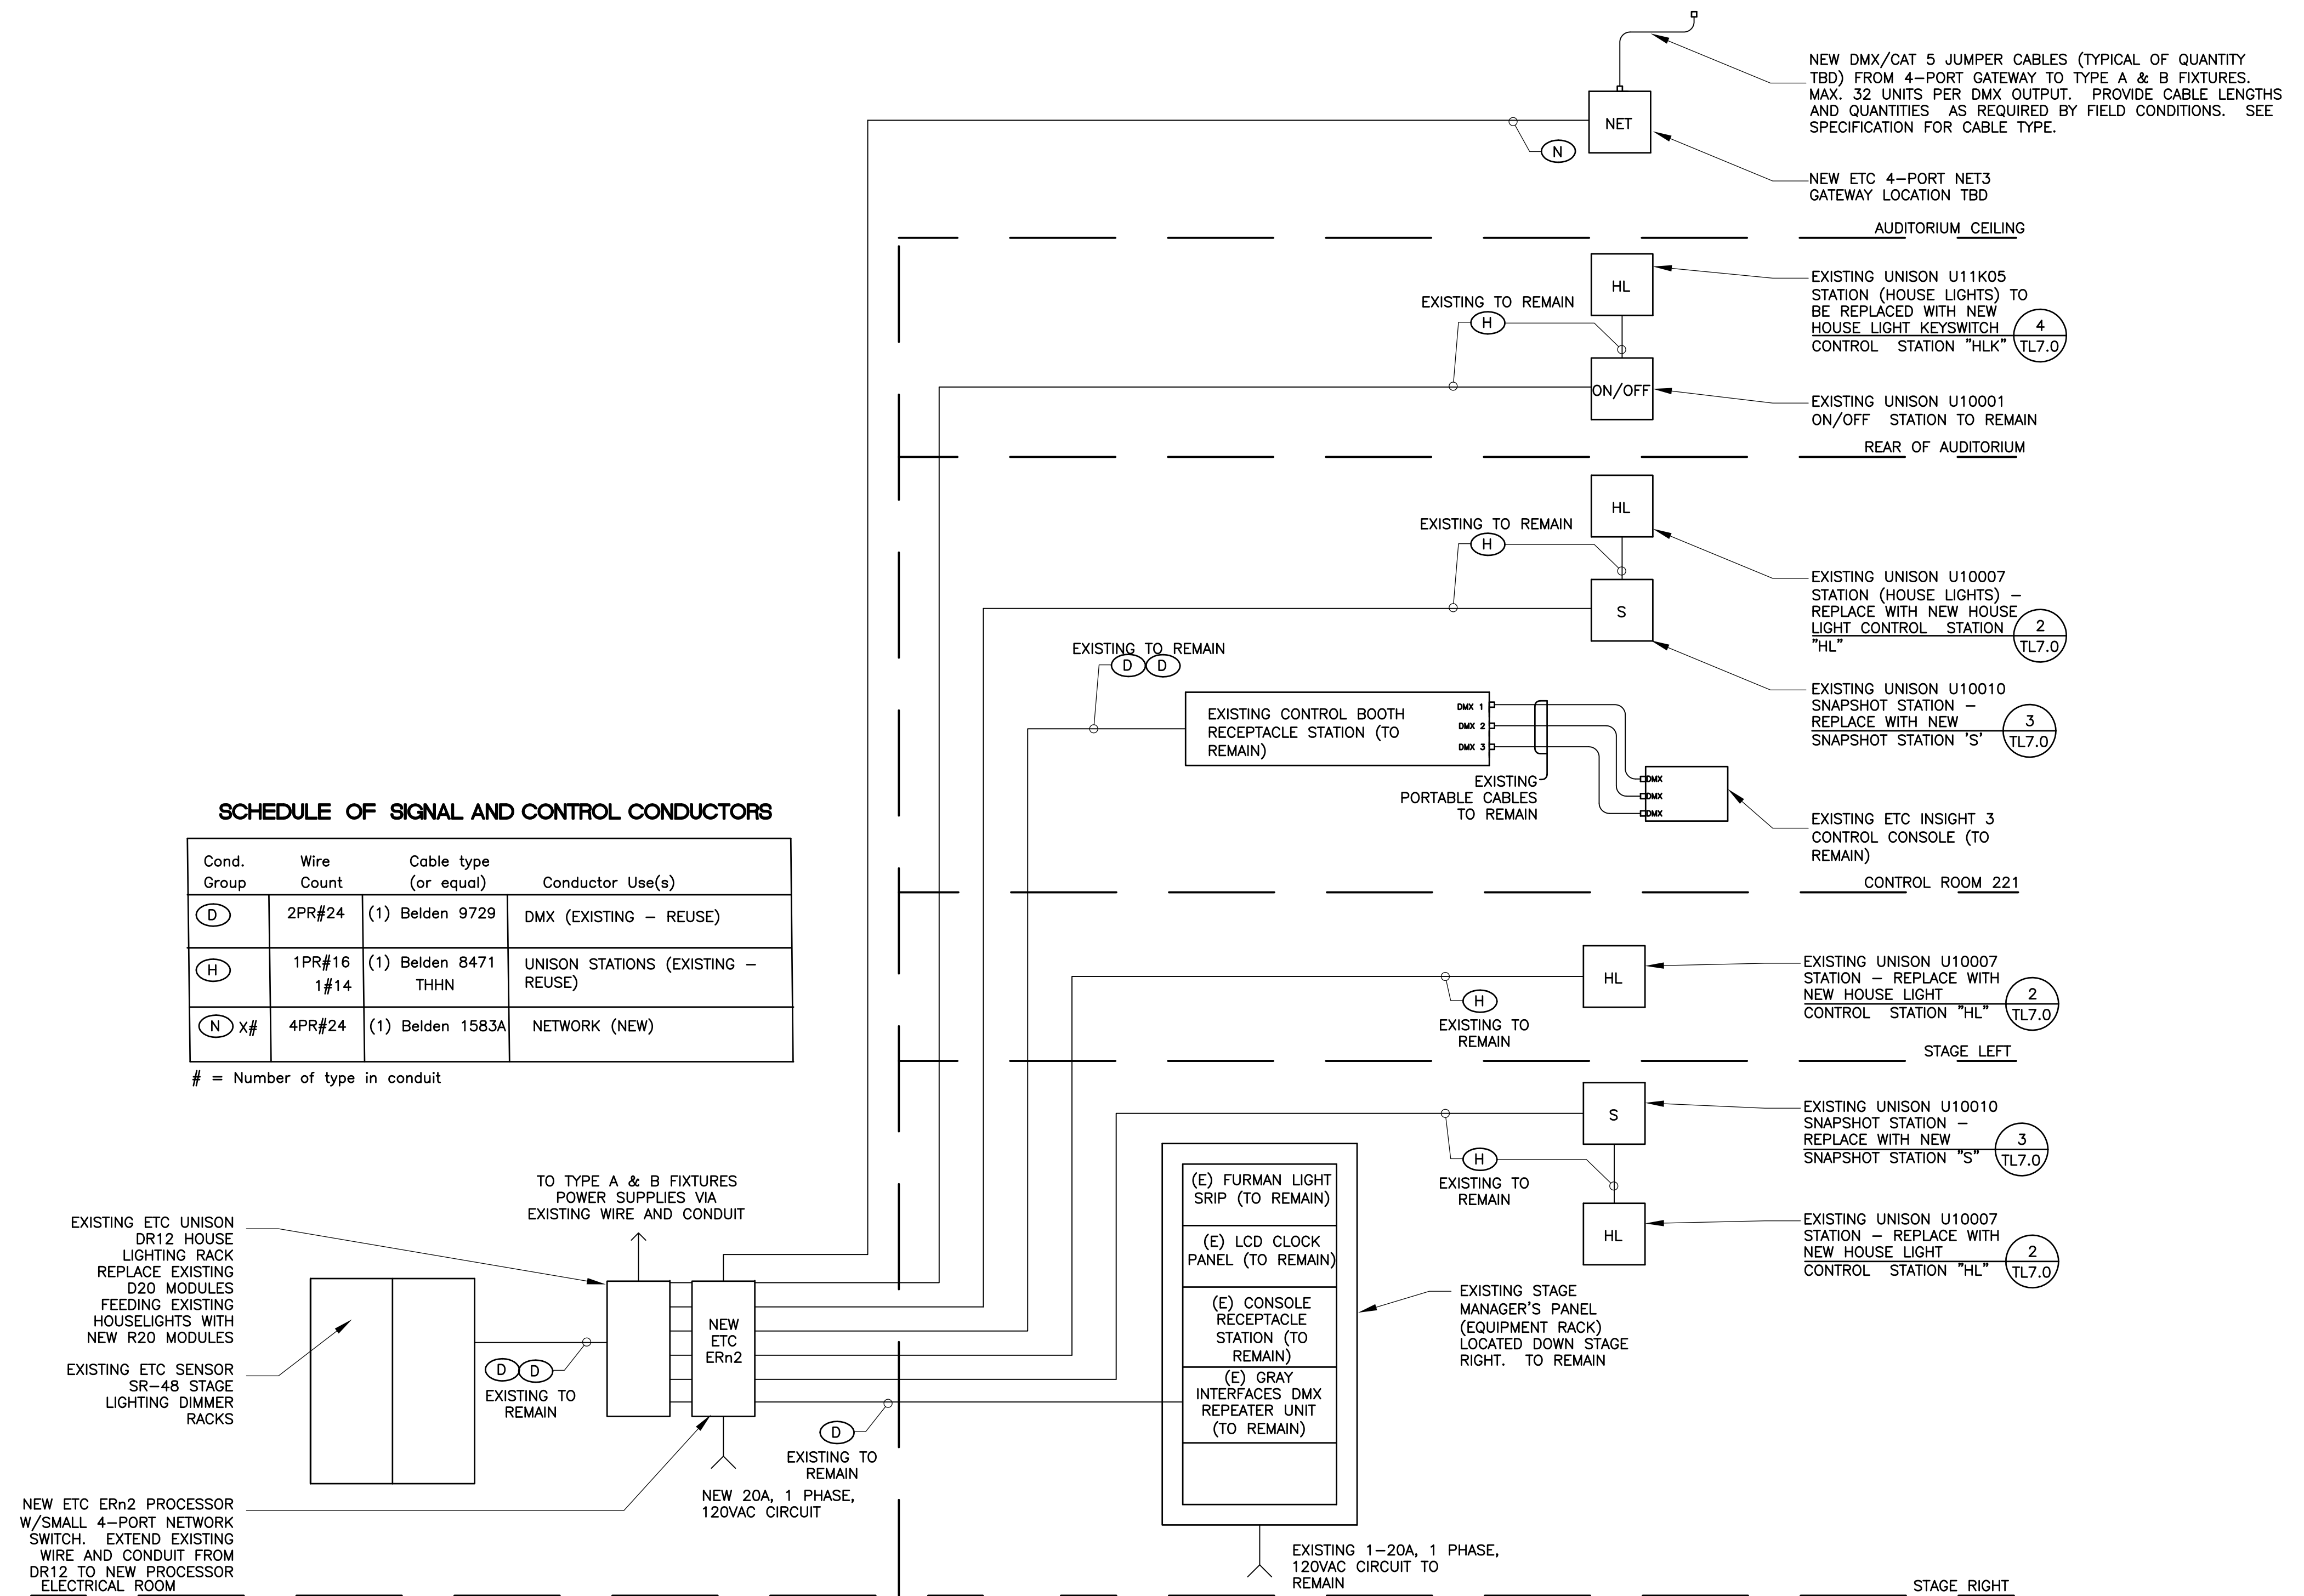

1 THEATRE SYSTEM SIGNAL AND CONTROL RISER DIAGRAM

NTS NOTES: 1. ALL NEW SIGNAL & CONTROL CONDUIT TO BE 3/4" U.N.O.
2. TYPES AND QUANTITIES OF SIGNAL & CONTROL CONDUCTORS ARE APPROXIMATE. ACTUAL TYPES & QUANTITIES TO BE AS RECOMMENDED BY STAGE LIGHTING EQUIPMENT MANUFACTURER.