

NO.	ISSUES/REVISIONS	DATE
100	100% SCHEMATIC DESIGN	04/28/18
200	20% DESIGN DEVELOPMENT	06/12/18
300	30% DESIGN DEVELOPMENT	07/26/18
400	40% DESIGN DEVELOPMENT	09/10/18
500	50% DESIGN DEVELOPMENT	11/19/18
600	60% DESIGN DEVELOPMENT	12/20/18
700	70% DESIGN DEVELOPMENT	02/06/19
800	80% DESIGN DEVELOPMENT	02/06/19
900	90% DESIGN DEVELOPMENT	02/06/19
1000	100% DESIGN DEVELOPMENT	02/06/19


NO.	ISSUES/REVISIONS	DATE
100	100% SCHEMATIC DESIGN	04/28/18
200	20% DESIGN DEVELOPMENT	06/12/18
300	30% DESIGN DEVELOPMENT	07/26/18
400	40% DESIGN DEVELOPMENT	09/10/18
500	50% DESIGN DEVELOPMENT	11/19/18
600	60% DESIGN DEVELOPMENT	12/20/18
700	70% DESIGN DEVELOPMENT	02/06/19
800	80% DESIGN DEVELOPMENT	02/06/19
900	90% DESIGN DEVELOPMENT	02/06/19
1000	100% DESIGN DEVELOPMENT	02/06/19

NO.	ISSUES/REVISIONS	DATE
100	100% SCHEMATIC DESIGN	04/28/18
200	20% DESIGN DEVELOPMENT	06/12/18
300	30% DESIGN DEVELOPMENT	07/26/18
400	40% DESIGN DEVELOPMENT	09/10/18
500	50% DESIGN DEVELOPMENT	11/19/18
600	60% DESIGN DEVELOPMENT	12/20/18
700	70% DESIGN DEVELOPMENT	02/06/19
800	80% DESIGN DEVELOPMENT	02/06/19
900	90% DESIGN DEVELOPMENT	02/06/19
1000	100% DESIGN DEVELOPMENT	02/06/19

NO.	ISSUES/REVISIONS	DATE
100	100% SCHEMATIC DESIGN	04/28/18
200	20% DESIGN DEVELOPMENT	06/12/18
300	30% DESIGN DEVELOPMENT	07/26/18
400	40% DESIGN DEVELOPMENT	09/10/18
500	50% DESIGN DEVELOPMENT	11/19/18
600	60% DESIGN DEVELOPMENT	12/20/18
700	70% DESIGN DEVELOPMENT	02/06/19
800	80% DESIGN DEVELOPMENT	02/06/19
900	90% DESIGN DEVELOPMENT	02/06/19
1000	100% DESIGN DEVELOPMENT	02/06/19

NO.	ISSUES/REVISIONS	DATE
100	100% SCHEMATIC DESIGN	04/28/18
200	20% DESIGN DEVELOPMENT	06/12/18
300	30% DESIGN DEVELOPMENT	07/26/18
400	40% DESIGN DEVELOPMENT	09/10/18
500	50% DESIGN DEVELOPMENT	11/19/18
600	60% DESIGN DEVELOPMENT	12/20/18
700	70% DESIGN DEVELOPMENT	02/06/19
800	80% DESIGN DEVELOPMENT	02/06/19
900	90% DESIGN DEVELOPMENT	02/06/19
1000	100% DESIGN DEVELOPMENT	02/06/19

NO.	ISSUES/REVISIONS	DATE
100	100% SCHEMATIC DESIGN	04/28/18
200	20% DESIGN DEVELOPMENT	06/12/18
300	30% DESIGN DEVELOPMENT	07/26/18
400	40% DESIGN DEVELOPMENT	09/10/18
500	50% DESIGN DEVELOPMENT	11/19/18
600	60% DESIGN DEVELOPMENT	12/20/18
700	70% DESIGN DEVELOPMENT	02/06/19
800	80% DESIGN DEVELOPMENT	02/06/19
900	90% DESIGN DEVELOPMENT	02/06/19
1000	100% DESIGN DEVELOPMENT	02/06/19

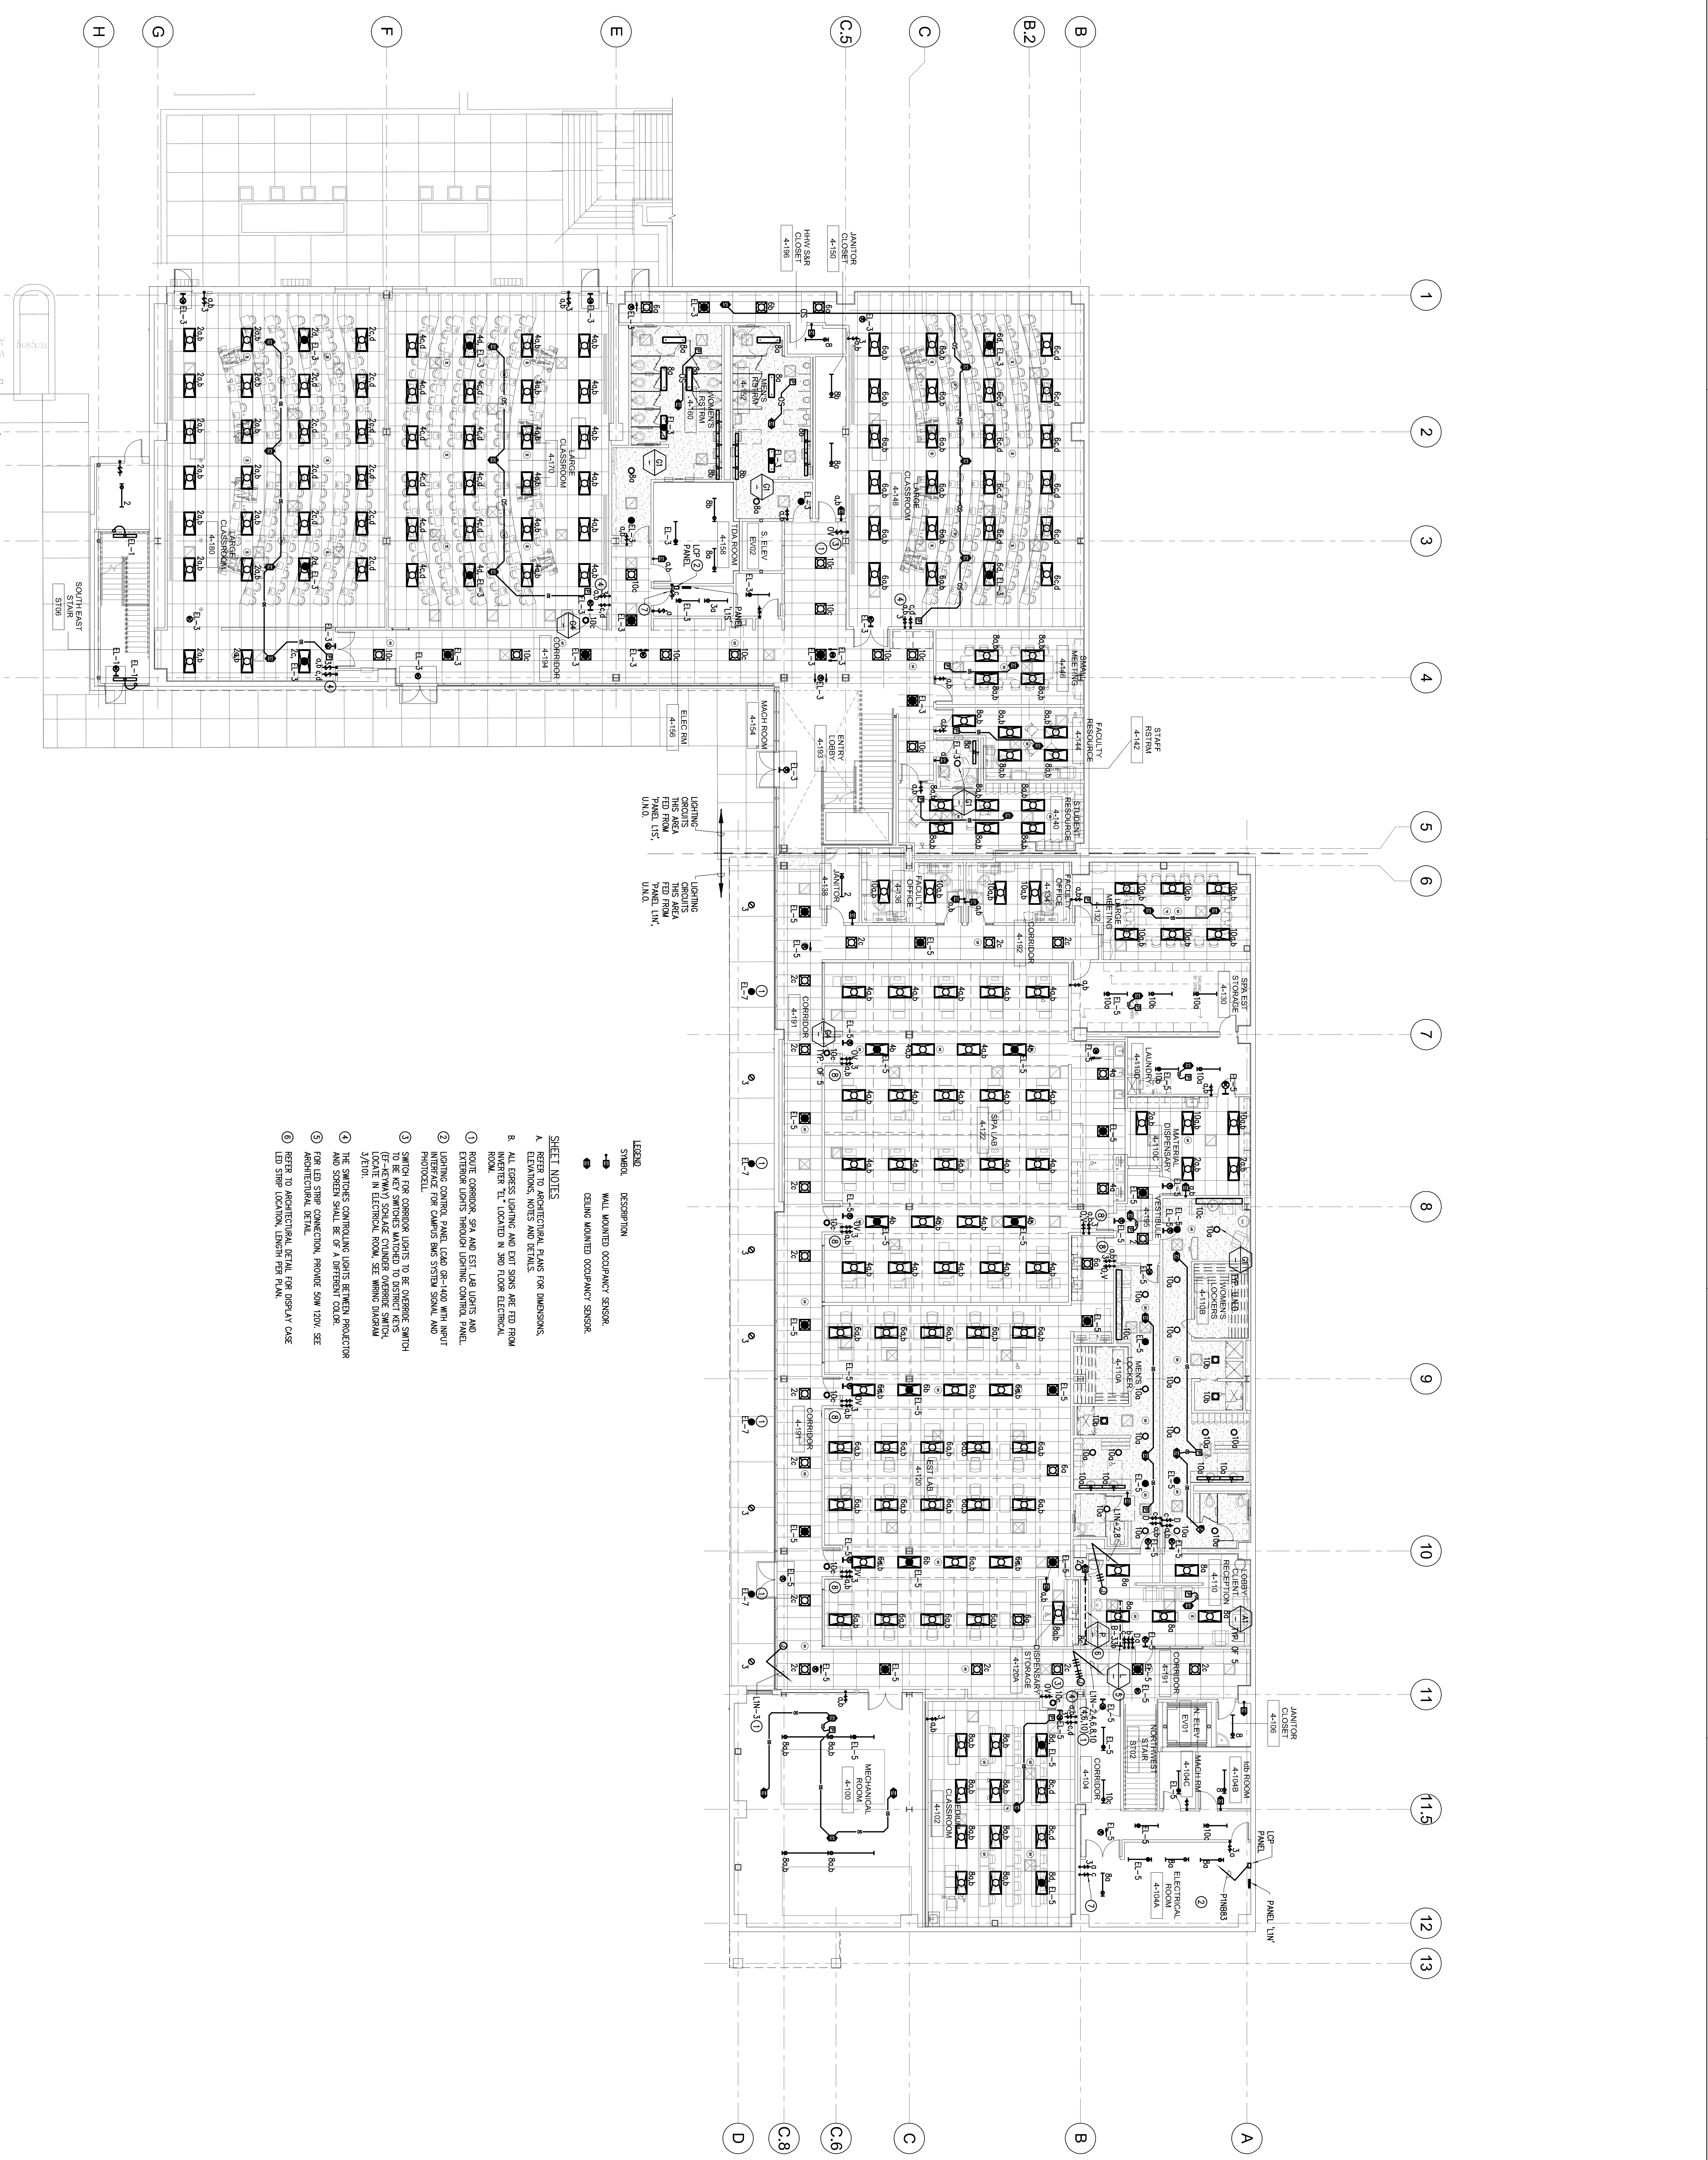

- LEGEND**
- SYMBOL DESCRIPTION
- WALL MOUNTED OCCUPANCY SENSOR
  - CEILING MOUNTED OCCUPANCY SENSOR
- SHEET NOTES**
1. REFER TO ARCHITECTURAL PLANS FOR DIMENSIONS.
  2. ALL EGRESS LIGHTING AND EXIT SIGNS ARE LED ROOM INVERTER T-8 LOCATED IN 2ND FLOOR ELECTRICAL ROOM.
  3. ROUTE CORRIDOR SPA AND EST. LAB LIGHTS AND EXTERIOR LIGHTS THROUGH LIGHTING CONTROL PANEL. INTERFACE FOR CAMPUS BMS SYSTEM SIGNAL AND PHOTOCELL.
  4. SWITCH FOR CORRIDOR LIGHTS TO BE OVERSEE SWITCH TO BE KEYS WATCHED TO DISTRICT KEYS LOCKED BY ELECTRONIC CONTROL SYSTEM DURING BUSINESS HOURS.
  5. THE SWITCHES CONTROLLING LIGHTS BETWEEN PROTECTOR AND SCREEN SHALL BE OF A DIFFERENT COLOR ARCHITECTURAL DETAIL.
  6. FOR LED STRIP CONNECTION, PROVIDE 50W 120V. SEE ARCHITECTURAL DETAIL.
  7. REFER TO ARCHITECTURAL DETAIL FOR DISPLAY CASE LED STRIP LOCATION, LENGTH PER PLAN.

**LEVEL 1 - LIGHTING PLAN**

SCALE: 3/32"=1'-0"

All drawings and written material appearing herein constitute original and unpublished work of the Architect/Engineer and may not be duplicated, used or disclosed without consent of Architect/Engineer.

If this drawing is not 36"x42", then the drawing has been revised from its original size. Note: scales must be indicated. This line should be equal to one inch.