

NO.	ISSUES/REVISIONS	DATE
100	100% SCHEDULED DESIGN	04/20/18
200	20% DESIGN DEVELOPMENT	06/12/18
300	30% DESIGN DEVELOPMENT	07/29/18
400	40% DESIGN DEVELOPMENT	07/29/18
500	50% DESIGN DEVELOPMENT	10/10/18
600	60% DESIGN DEVELOPMENT	11/19/18
700	70% DESIGN DEVELOPMENT	11/19/18
800	80% DESIGN DEVELOPMENT	12/20/18
900	90% DESIGN DEVELOPMENT	02/06/19
1000	100% DESIGN DEVELOPMENT	04/20/19
1100	100% DESIGN DEVELOPMENT	07/29/19
1200	100% DESIGN DEVELOPMENT	08/22/19
1300	100% DESIGN DEVELOPMENT	09/27/19
1400	100% DESIGN DEVELOPMENT	10/22/19
1500	100% DESIGN DEVELOPMENT	11/19/19
1600	100% DESIGN DEVELOPMENT	04/18/21
1700	100% DESIGN DEVELOPMENT	06/09/21
1800	100% DESIGN DEVELOPMENT	06/22/21
1900	100% DESIGN DEVELOPMENT	06/22/21
2000	100% DESIGN DEVELOPMENT	06/22/21

THE DIVISION OF THE UNIVERSITY OF CALIFORNIA

PROJECT # 01-10117

DATE: 01-10-17

BY: [Signature]

SCALE: AS SHOWN

Increment 3

**SKYLINE COLLEGE**  
 SAN MATEO COUNTY  
 DISTRICT  
 COMMUNITY COLLEGE


**CIP2 DESIGN-BUILD PROJECT BUILDING 4 INCREMENT 3**

**LEVELS**

LEVEL 3	DATE: 04/26/18	DRAWN BY: IB
LEVEL 2	DATE: 04/26/18	CHECKED BY: AS
LEVEL 1	DATE: 04/26/18	CHECKED BY: AS

SCALE: 3/32"=1'-0"

SHEET TITLE: LEVEL 3 LIGHTING PLAN

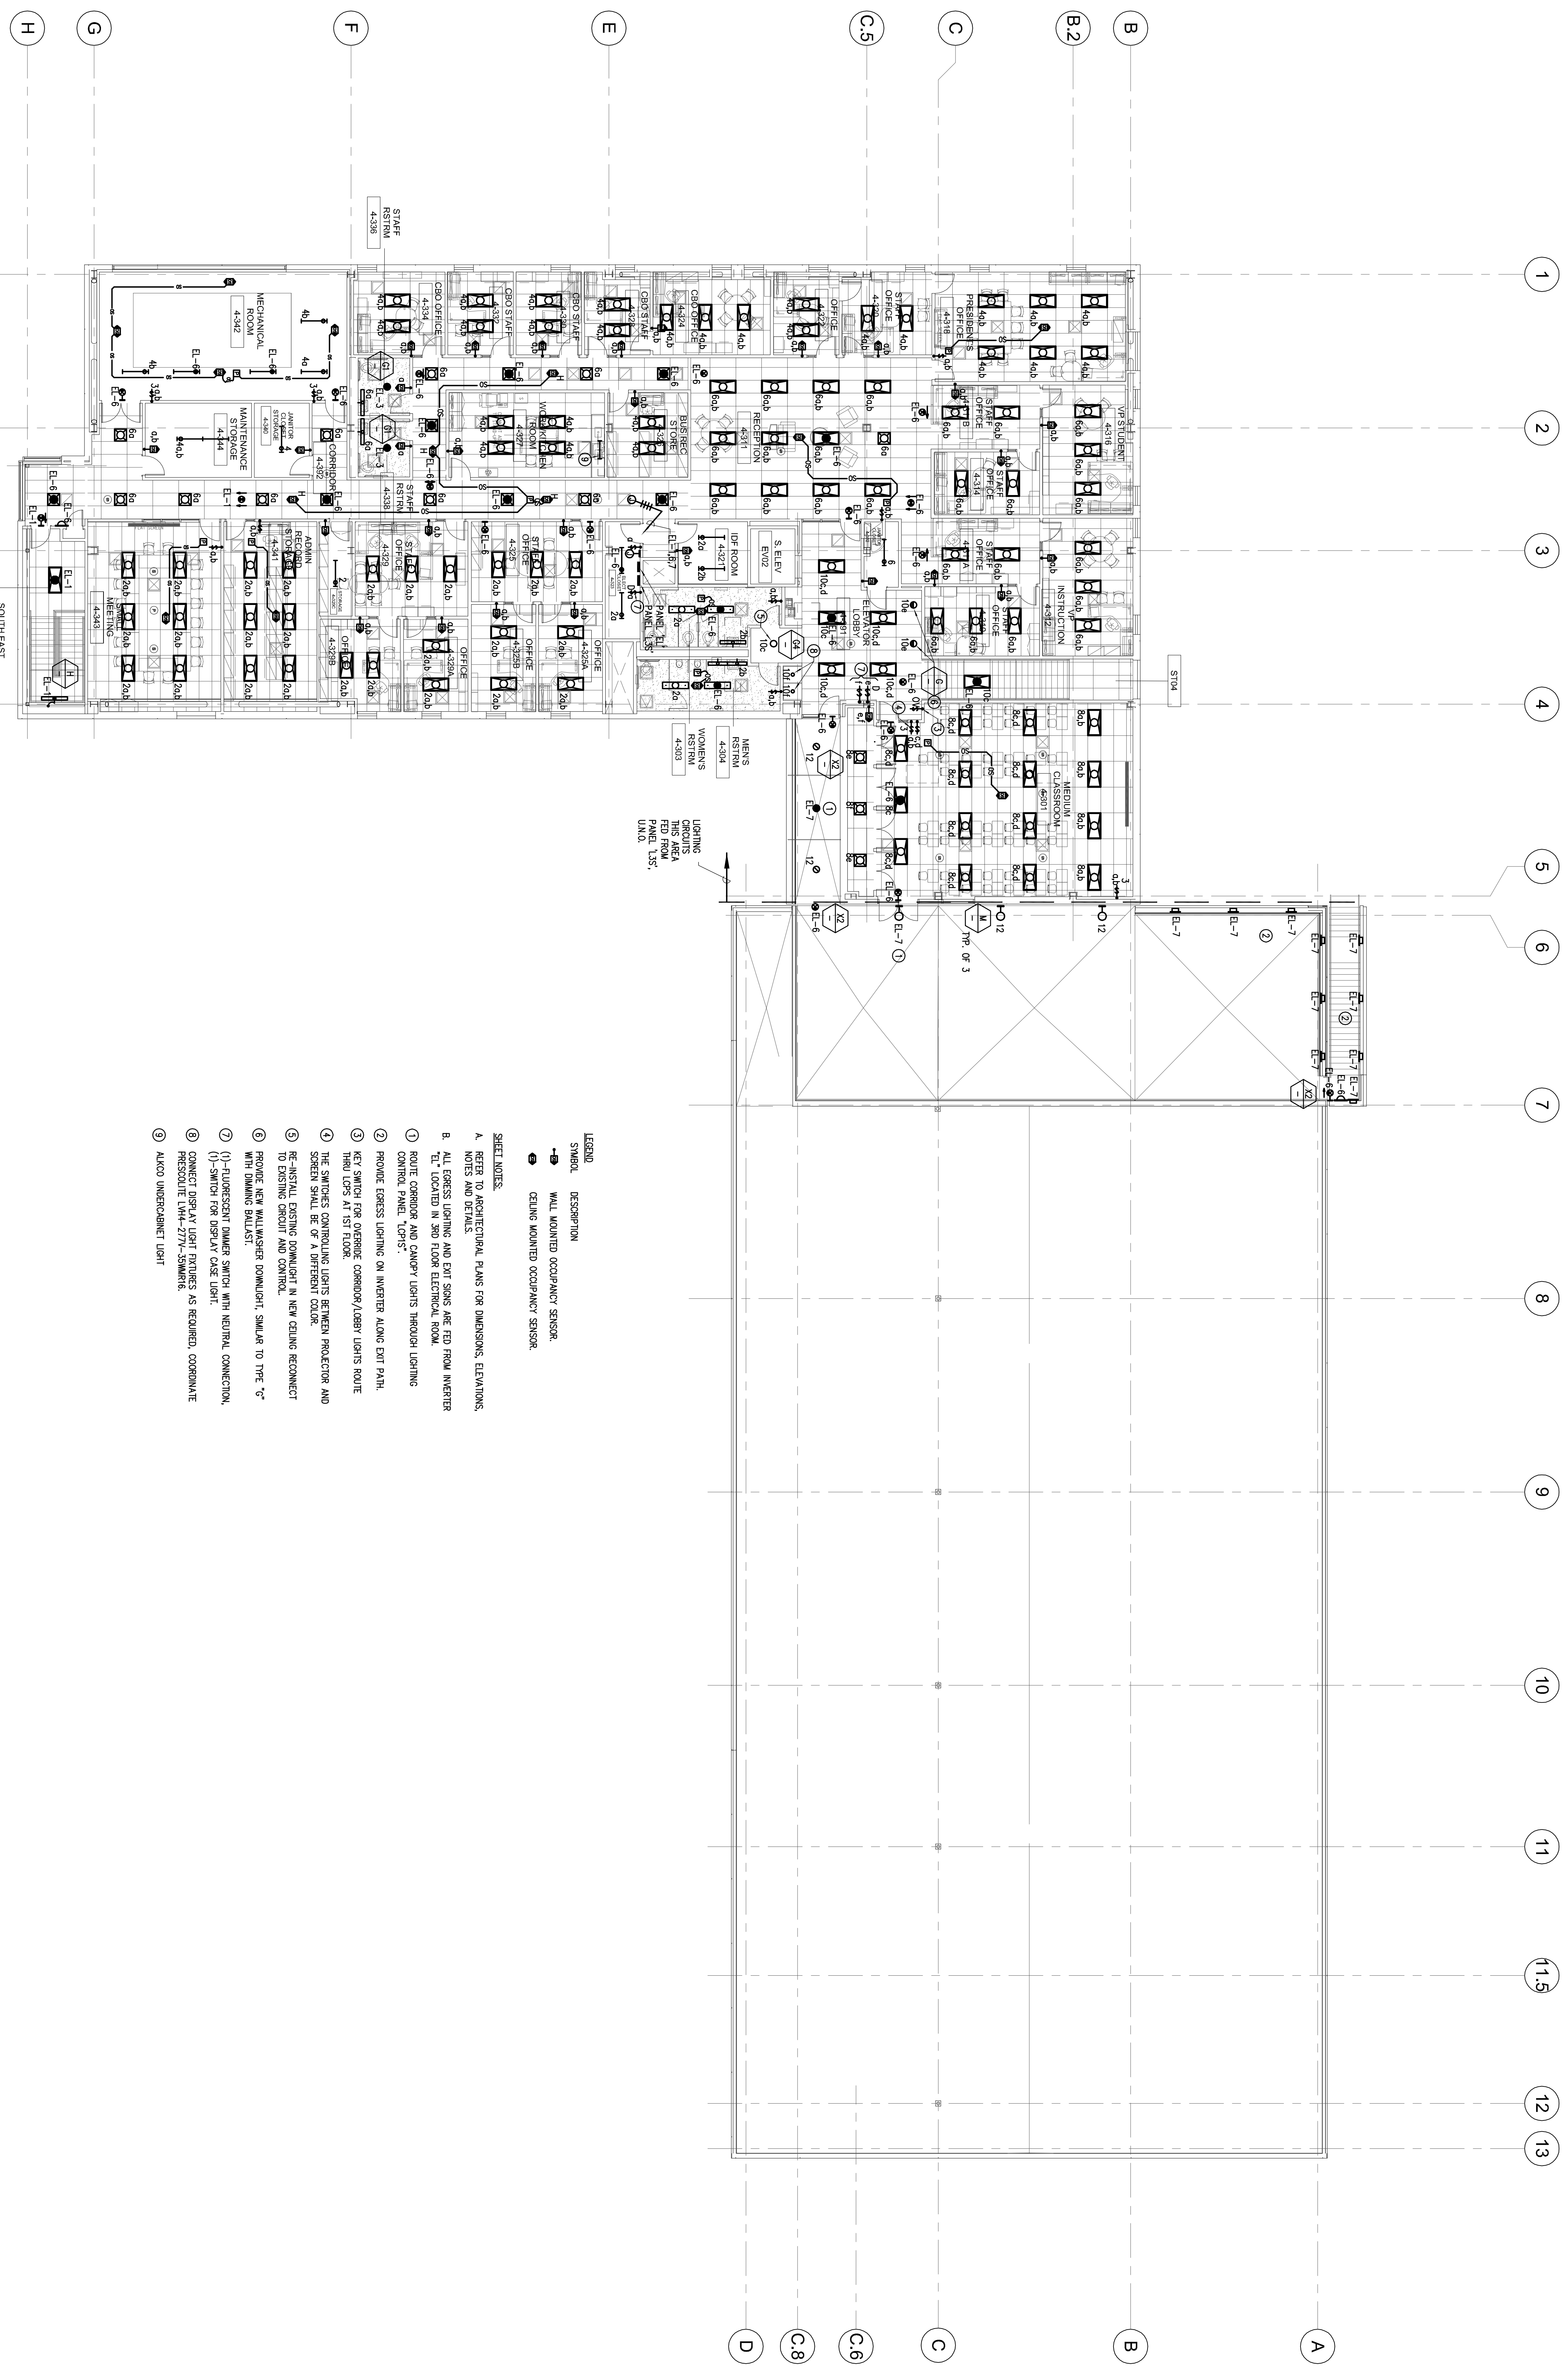

- LEGEND**
- SYMBOL DESCRIPTION
- WALL MOUNTED OCCUPANCY SENSOR
- CEILING MOUNTED OCCUPANCY SENSOR
- SHEET NOTES:**
- REFER TO ARCHITECTURAL PLANS FOR DIMENSIONS, ELEVATIONS, NOTES AND DETAILS.
  - ALL EGRESS LIGHTING AND EXIT SIGNS ARE FED FROM INVERTER CONTROL PANEL UNITS.
  - ROUTE CORRIDOR AND CHANGING LIGHTS THROUGH LIGHTING CONTROL PANEL UNITS.
  - PROVIDE EGRESS LIGHTING ON INVERTER ALONG EXIT PATH. KEY SWITCH FOR OVERIDE CORRIDOR/LOBBY LIGHTS ROUTE THEN UPS AT 1ST FLOOR.
  - THE SWITCHES CONTROLLING LIGHTS BETWEEN PROJECTOR AND SCREEN SHALL BE OF A DIFFERENT COLOR.
  - BE-INSTALL EXISTING DOWNLIGHT IN NEW CEILING RECONNECT TO EXISTING CIRCUIT AND CONTROL.
  - REMOVE NEW MULTIWIRE DOWNLIGHT, SIMILAR TO TYPE 'C' WITH DIMMING BALLAST.
  - (-) FLUORESCENT DIMMER SWITCH WITH NEUTRAL CONNECTION.
  - (V) SWITCH FOR DISPLAY CASE LIGHT.
  - CONNECT DISPLAY LIGHT FIXTURES AS REQUIRED. COORDINATE PROSCULTE LVM-2711-SMARTS.
  - ALCO UNDERCABINET LIGHT.

**LEVEL 3 - LIGHTING PLAN - SECTOR A**

SCALE: 3/32"=1'-0"

All drawings and written material appearing herein constitute original and unpublished work of the Architect/Engineer and may not be duplicated, used or disclosed without consent of Architect/Engineer.

If this drawing is not 36"x42", then the drawing has been revised from its original size. Model scales must be indicated. This line should be equal to one inch.