


Revision	Description	Date
001	ISSUED FOR PERFORMING SET	09 APRIL 2009
002	ISSUED FOR PERFORMING SET	09 APRIL 2009
003	ISSUED FOR PERFORMING SET	09 APRIL 2009
004	ISSUED FOR PERFORMING SET	09 APRIL 2009
005	ISSUED FOR PERFORMING SET	09 APRIL 2009

Revision	Description	Date
001	ISSUED FOR PERFORMING SET	09 APRIL 2009
002	ISSUED FOR PERFORMING SET	09 APRIL 2009
003	ISSUED FOR PERFORMING SET	09 APRIL 2009
004	ISSUED FOR PERFORMING SET	09 APRIL 2009
005	ISSUED FOR PERFORMING SET	09 APRIL 2009

Job No.	27082.30
Date	09 APRIL 2009
Drawn by	MC
Checked by	PR
Scale	NO SCALE

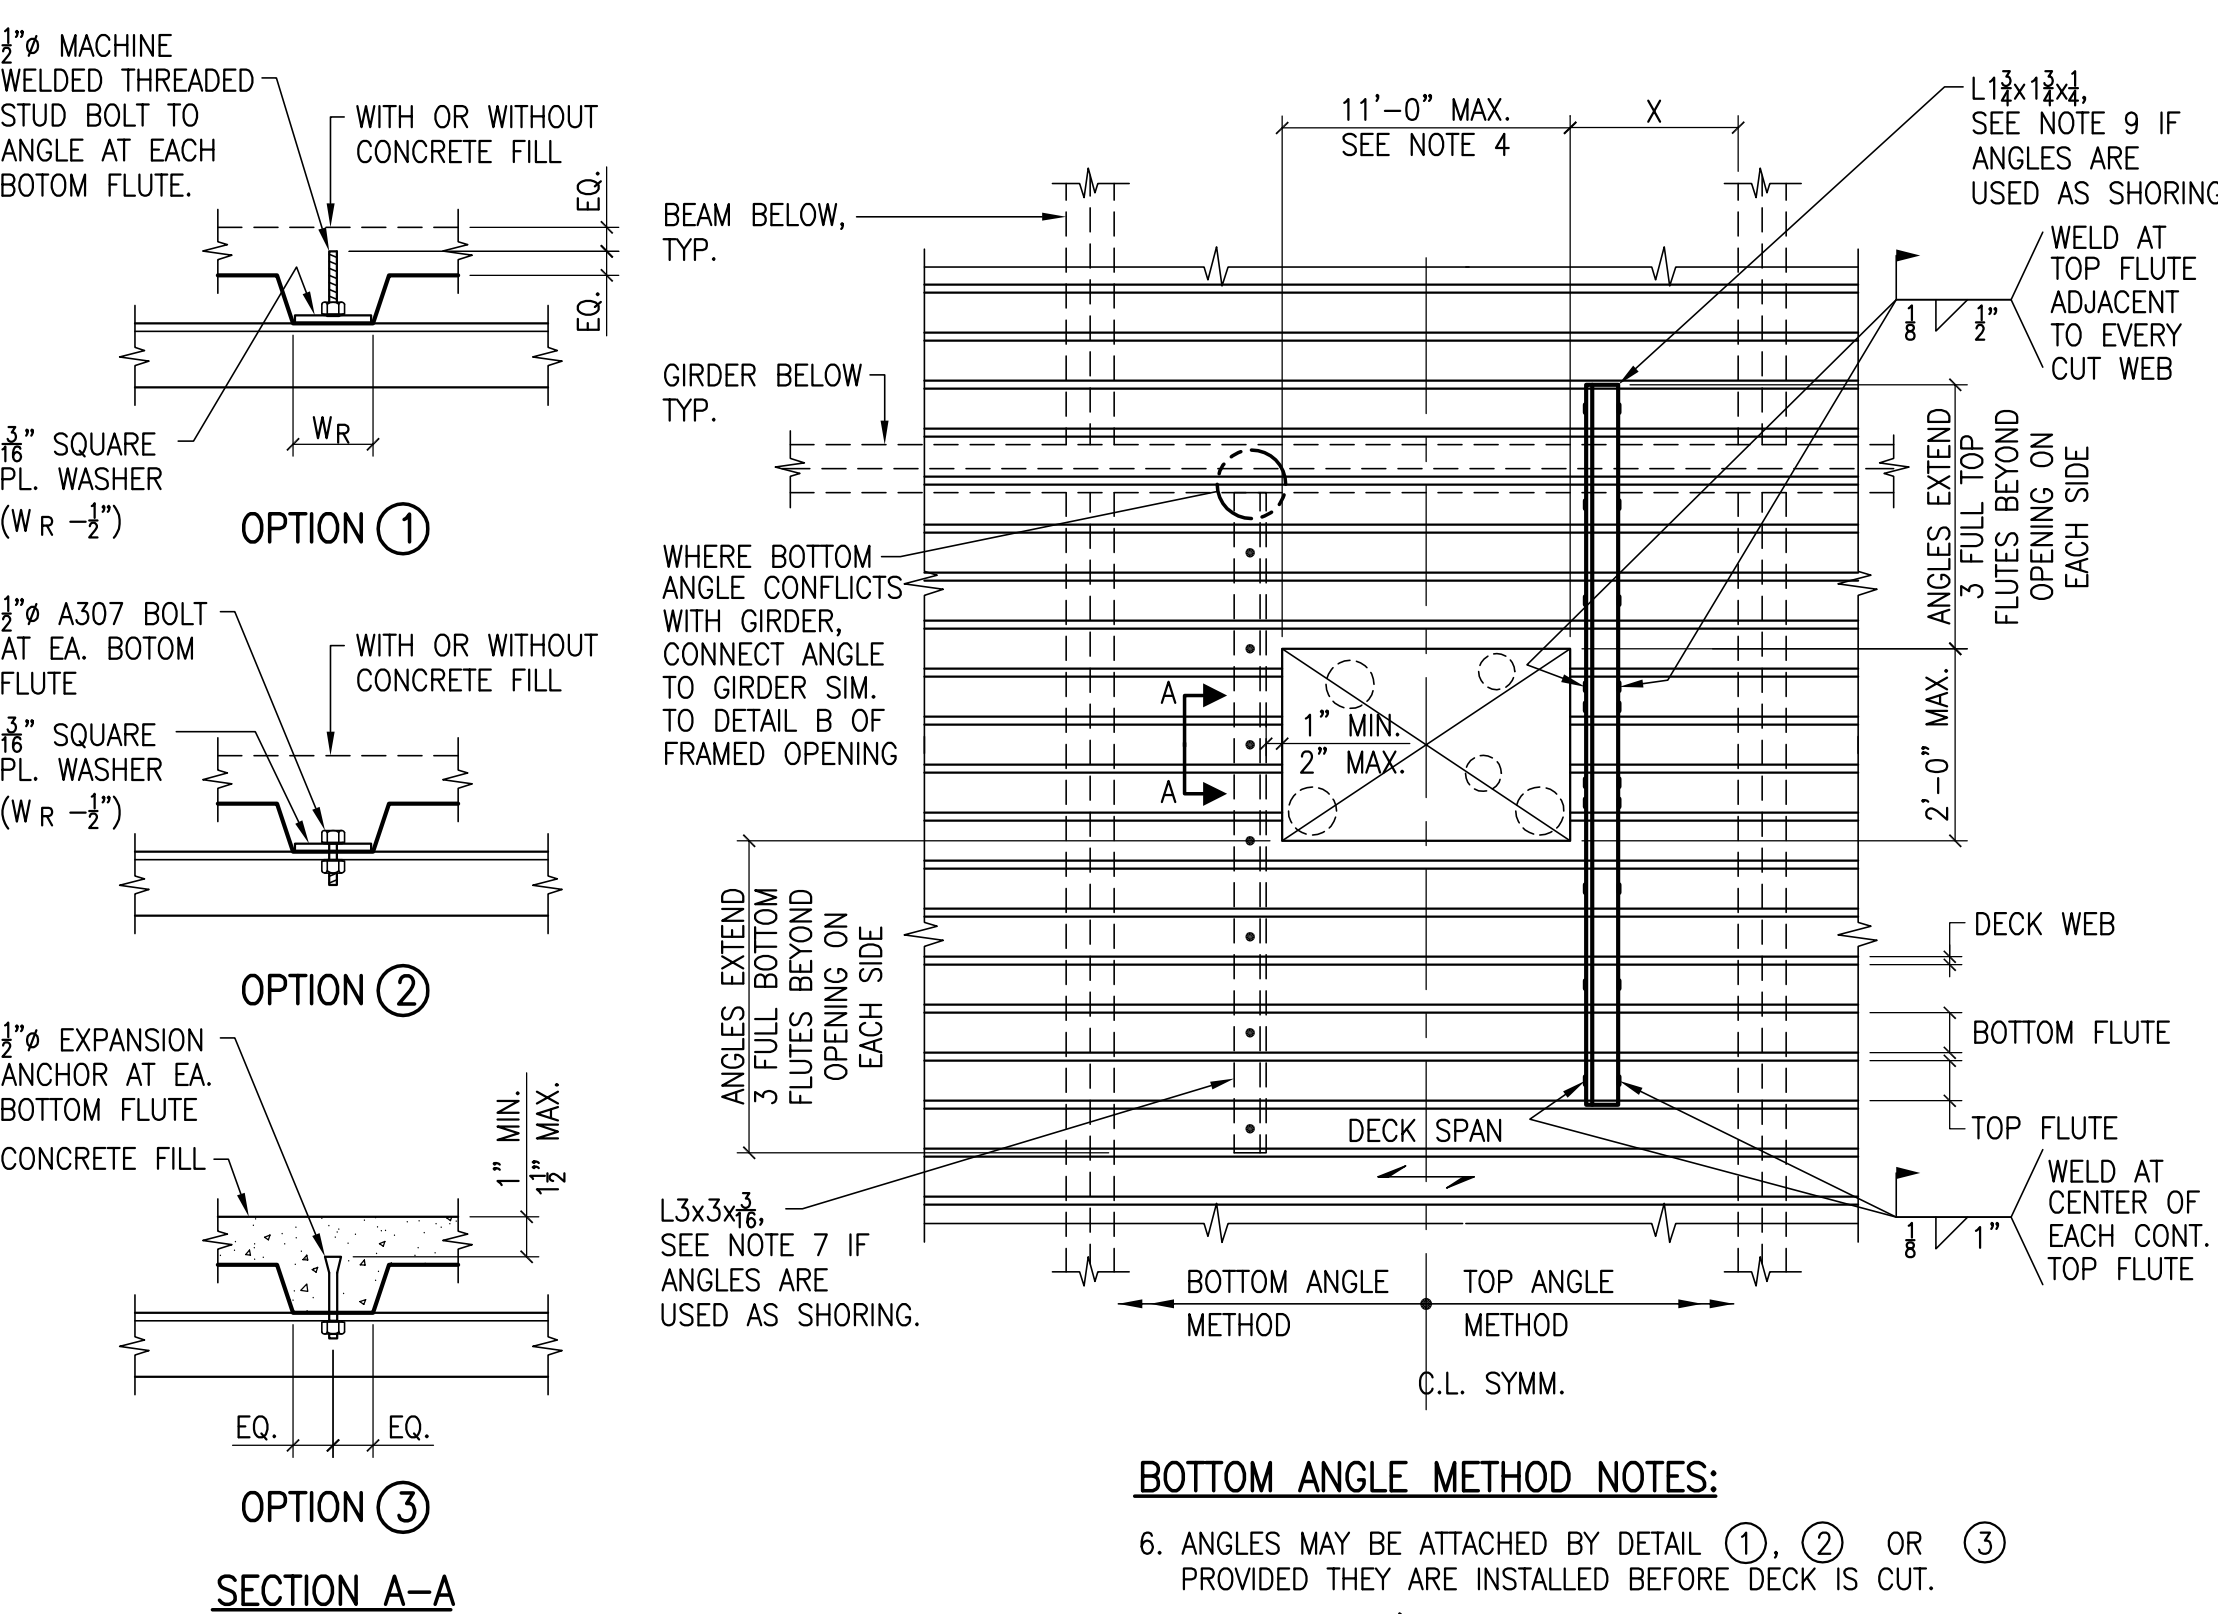

GENERAL NOTES:

- SEE ARCH., M.E. & P DRAWINGS FOR SIZE AND LOCATIONS OF OPENINGS.
- IF X IS NOT GREATER THAN 1'-0" ANGLE MAY BE OMITTED ON SIDE CLOSEST TO BEAM.
- OPENING SHALL BE BLOCKED OUT PRIOR TO CONCRETE POUR AND DECK LEFT INTACT UNTIL 14 DAYS AFTER CONCRETE POUR.
- OPENING DIMENSION SHALL BE CONFINED TO CLEAR SPACE BETWEEN EDGES OF ADJACENT BEAMS.
- PROVIDE TRIM BAR AROUND OPENING PER TYPICAL DETAILS.

SECTION A-A

CLASSIFICATION OF OPENINGS IN DECK (18) S7.1


REINFORCED OPENING (SEE 18)

BOTTOM ANGLE METHOD NOTES:

- ANGLES MAY BE ATTACHED BY DETAIL 1, 2, OR 3 PROVIDED THEY ARE INSTALLED BEFORE DECK IS CUT.
- AT CONTRACTOR'S OPTION, DECK MAY BE CUT AHEAD OF CONCRETE POUR PROVIDED THAT THE ANGLES ARE INSTALLED BY DETAIL 1 OR 2 BEFORE THE DECK IS CUT. ANGLES SHALL BE L4x4x3/8

TOP ANGLE METHOD NOTES:

- CONCRETE FILL MUST BE 4" MIN. TO USE TOP ANGLE REINFORCEMENT.
- AT CONTRACTOR'S OPTION, DECK MAY BE CUT AHEAD OF CONCRETE POUR PROVIDED THAT THE ANGLES ARE INSTALLED BEFORE THE DECK IS CUT. ANGLES SHALL BE REPLACED BY FLAT HSSx1 1/2 x1/8.

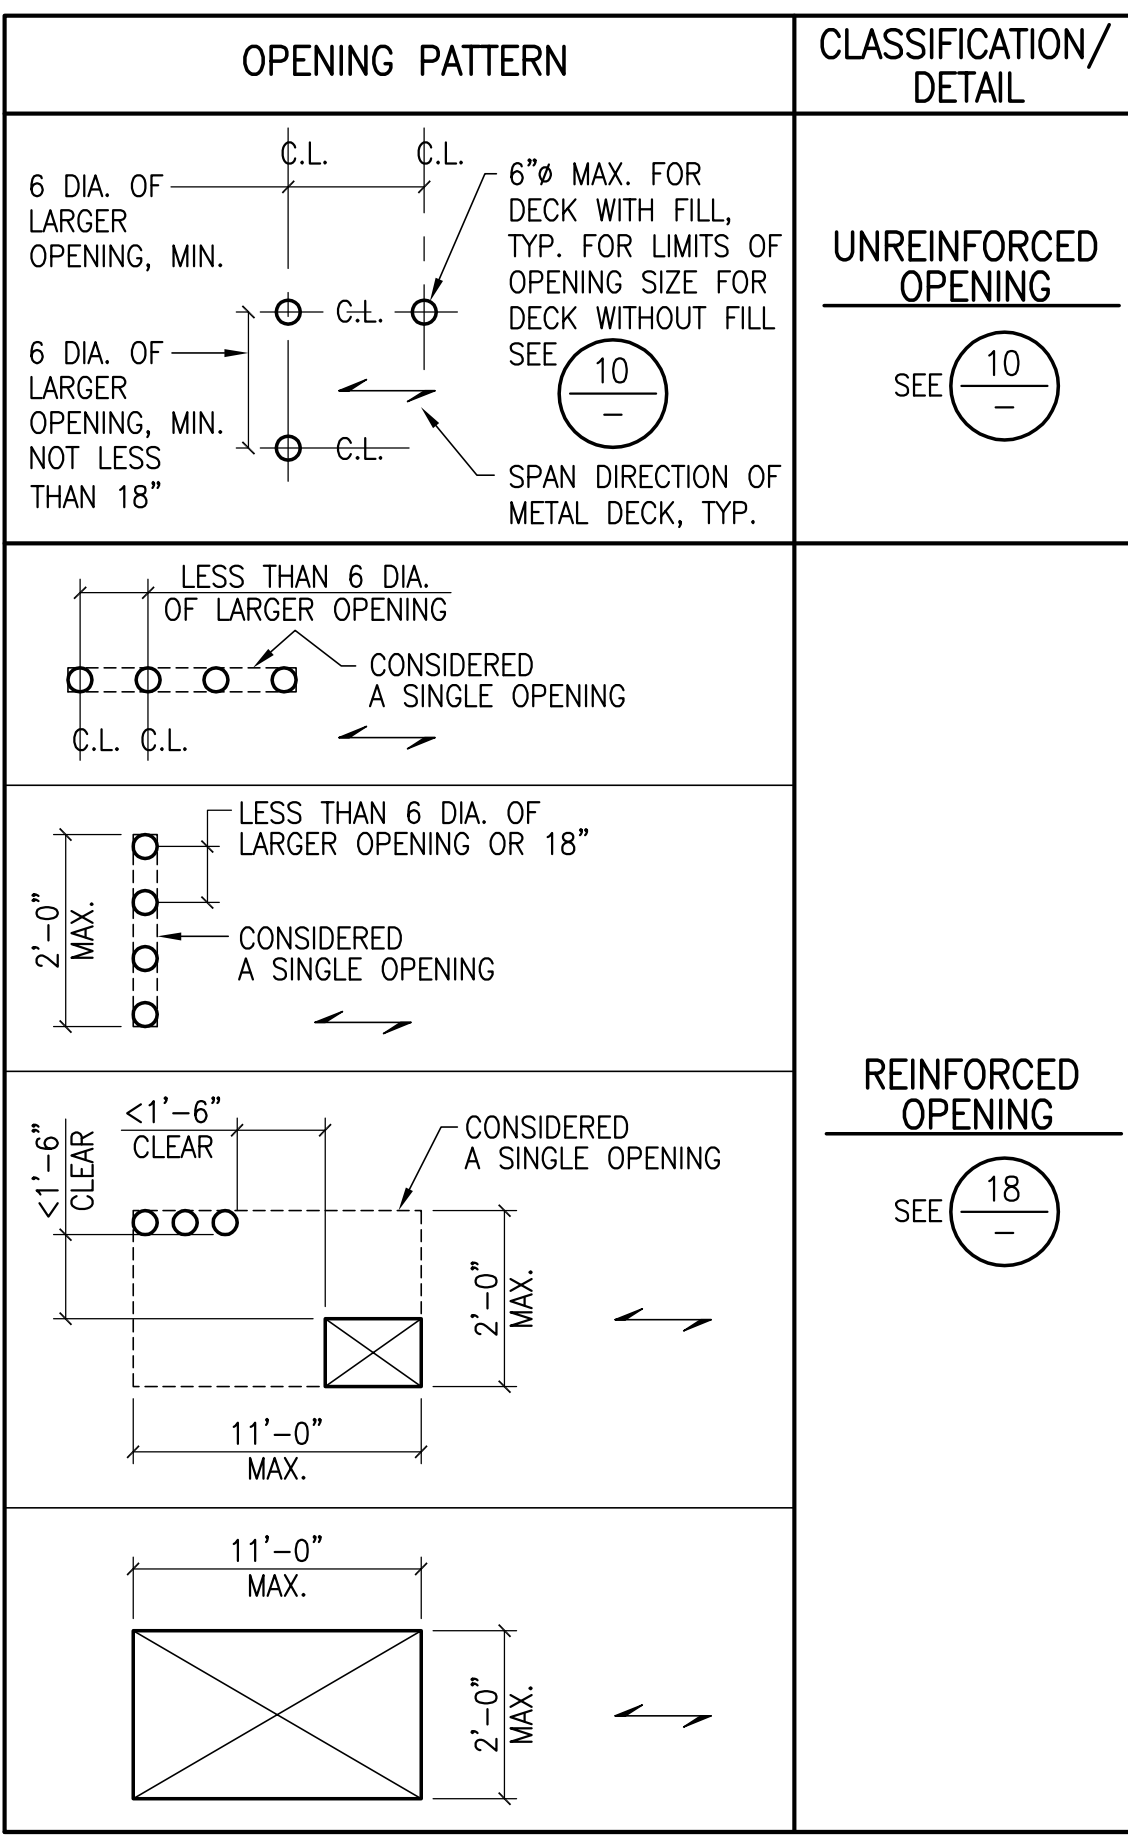


UNREINFORCED OPENING (SEE 10)

REINFORCED OPENING (SEE 18)

TYPICAL UNREINFORCED OPENING AT DECK WITHOUT CONCRETE FILL (10) S7.1

CLASSIFICATION OF OPENINGS IN DECK (14) S7.1


NOTE:
CHECK FIRST IF OPENING(S) MEET THE CRITERIA FOR UNREINFORCED. IF NOT, CHECK IF OPENING(S) MEET THE CRITERIA FOR REINFORCED. IF NOT, THEN OPENING(S) SHALL BE FRAMED.

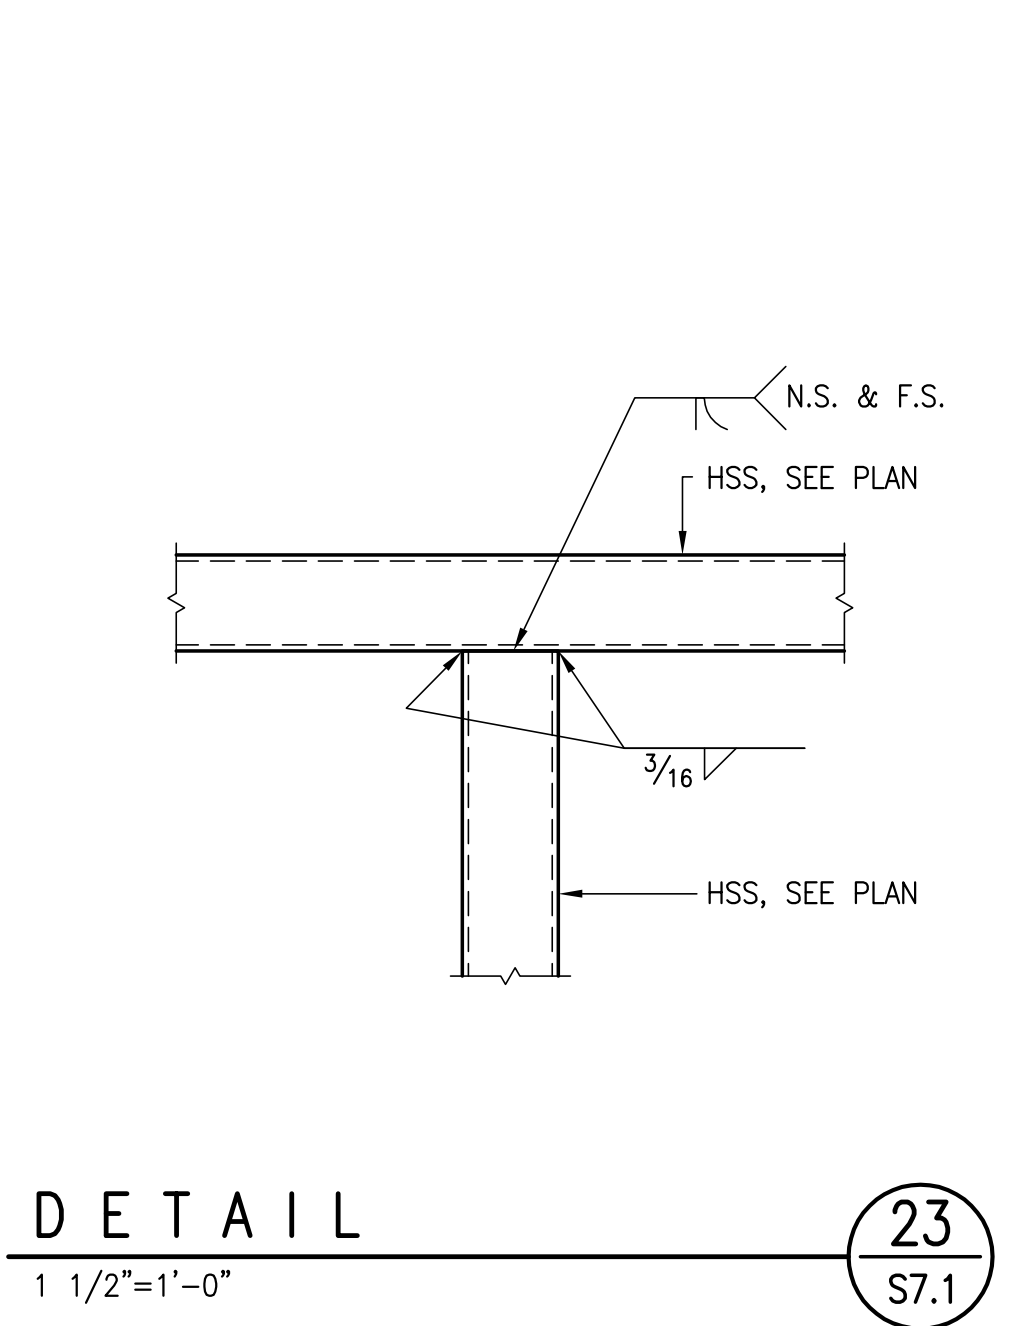

DETAIL 23 (S7.1)

TYPICAL EDGE OF DECK AT LARGE OVERHANGS (24) S7.1

* SHORING MAY BE USED IN LIEU OF L's.

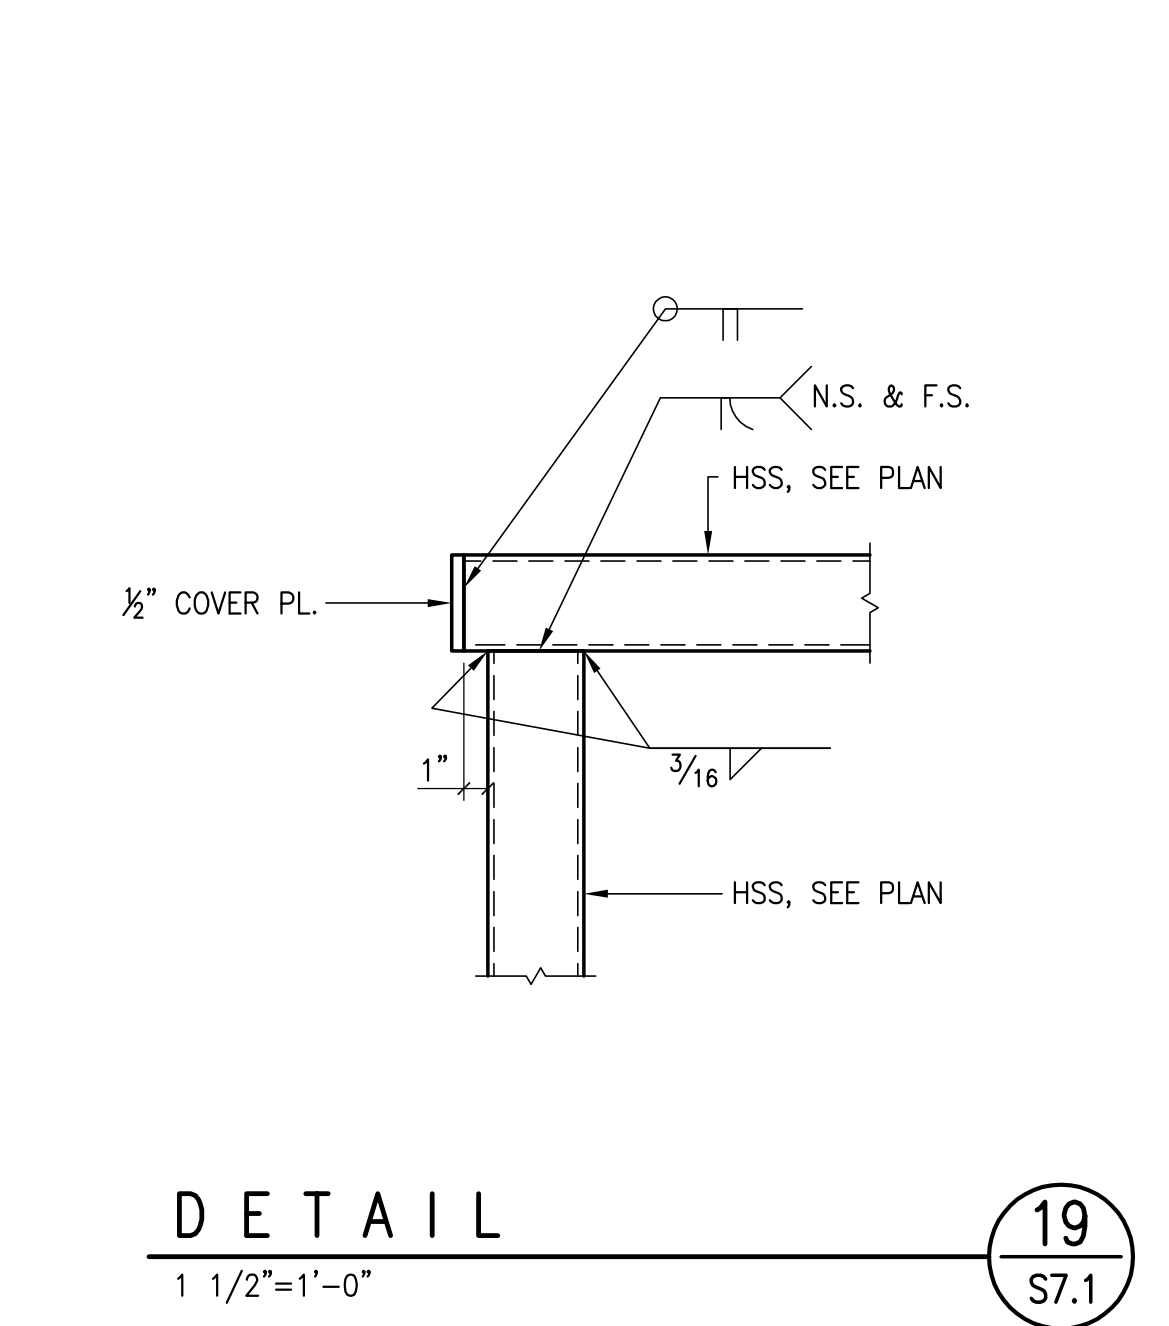


DETAIL 19 (S7.1)

TYPICAL EDGE OF DECK DETAIL (24) S7.1

DECK FLUTES PERPENDICULAR TO BEAM

WHEN OVERHANG EXCEEDS MAX., USE DETAIL 24

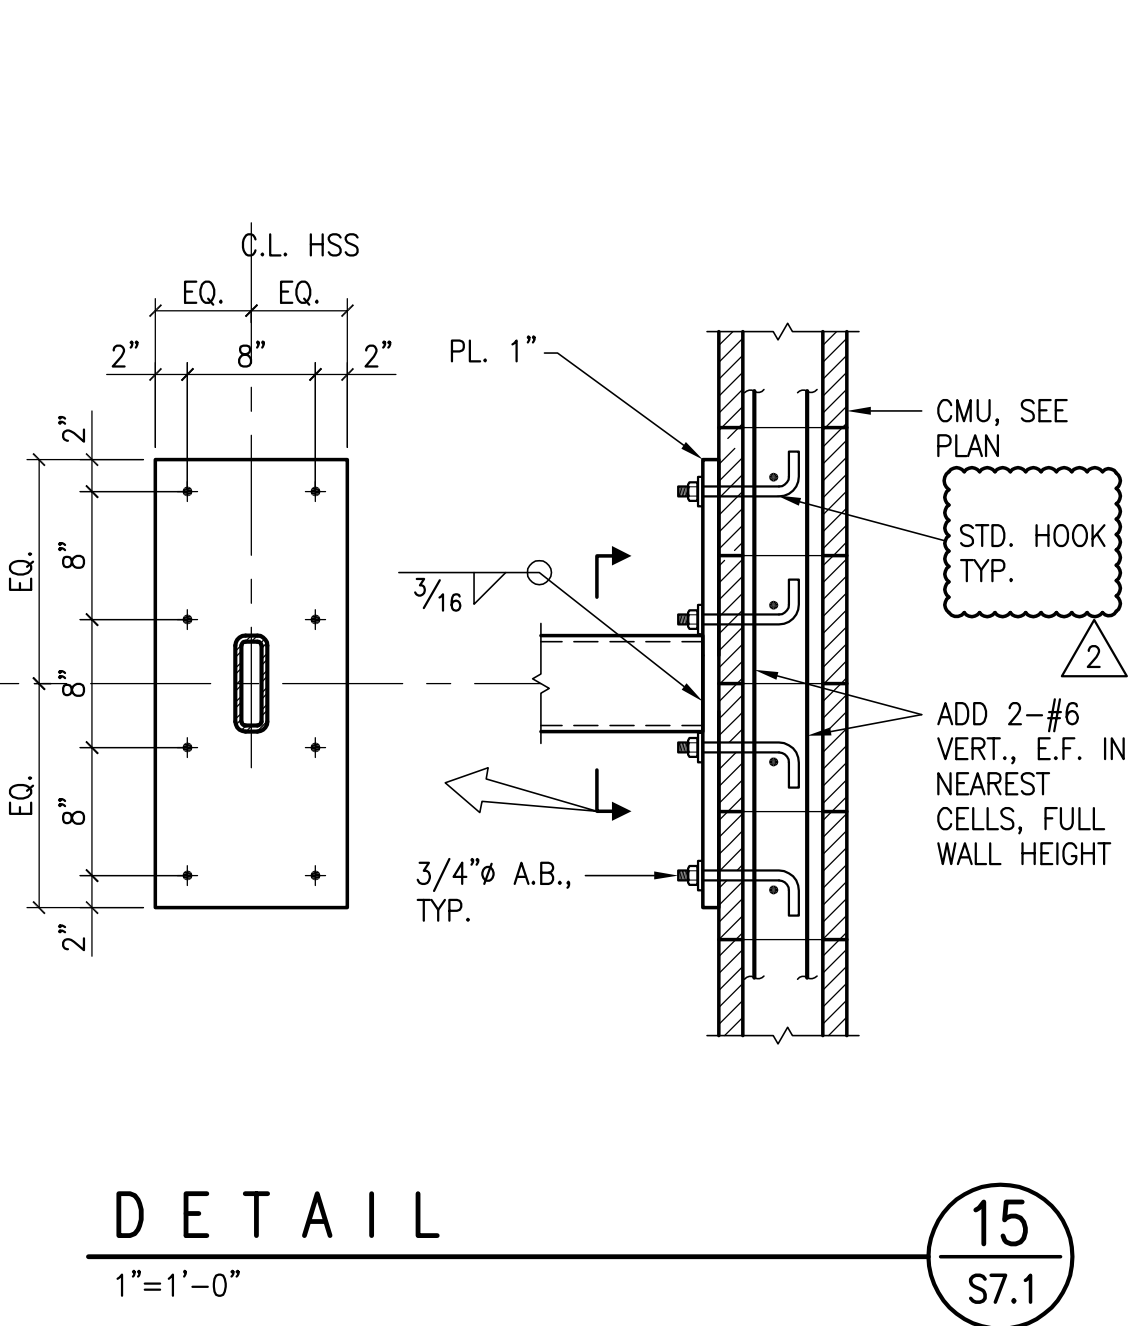


DETAIL 15 (S7.1)

METAL DECK PROFILES AND MINIMUM PROPERTIES (11) S7.1

EDGE ANGLE THICKNESS (GAGE)

DECK FLUTES PARALLEL TO BEAM (USE FOR FLUTES SKEWED RELATIVE TO BEAM) (16) S7.1

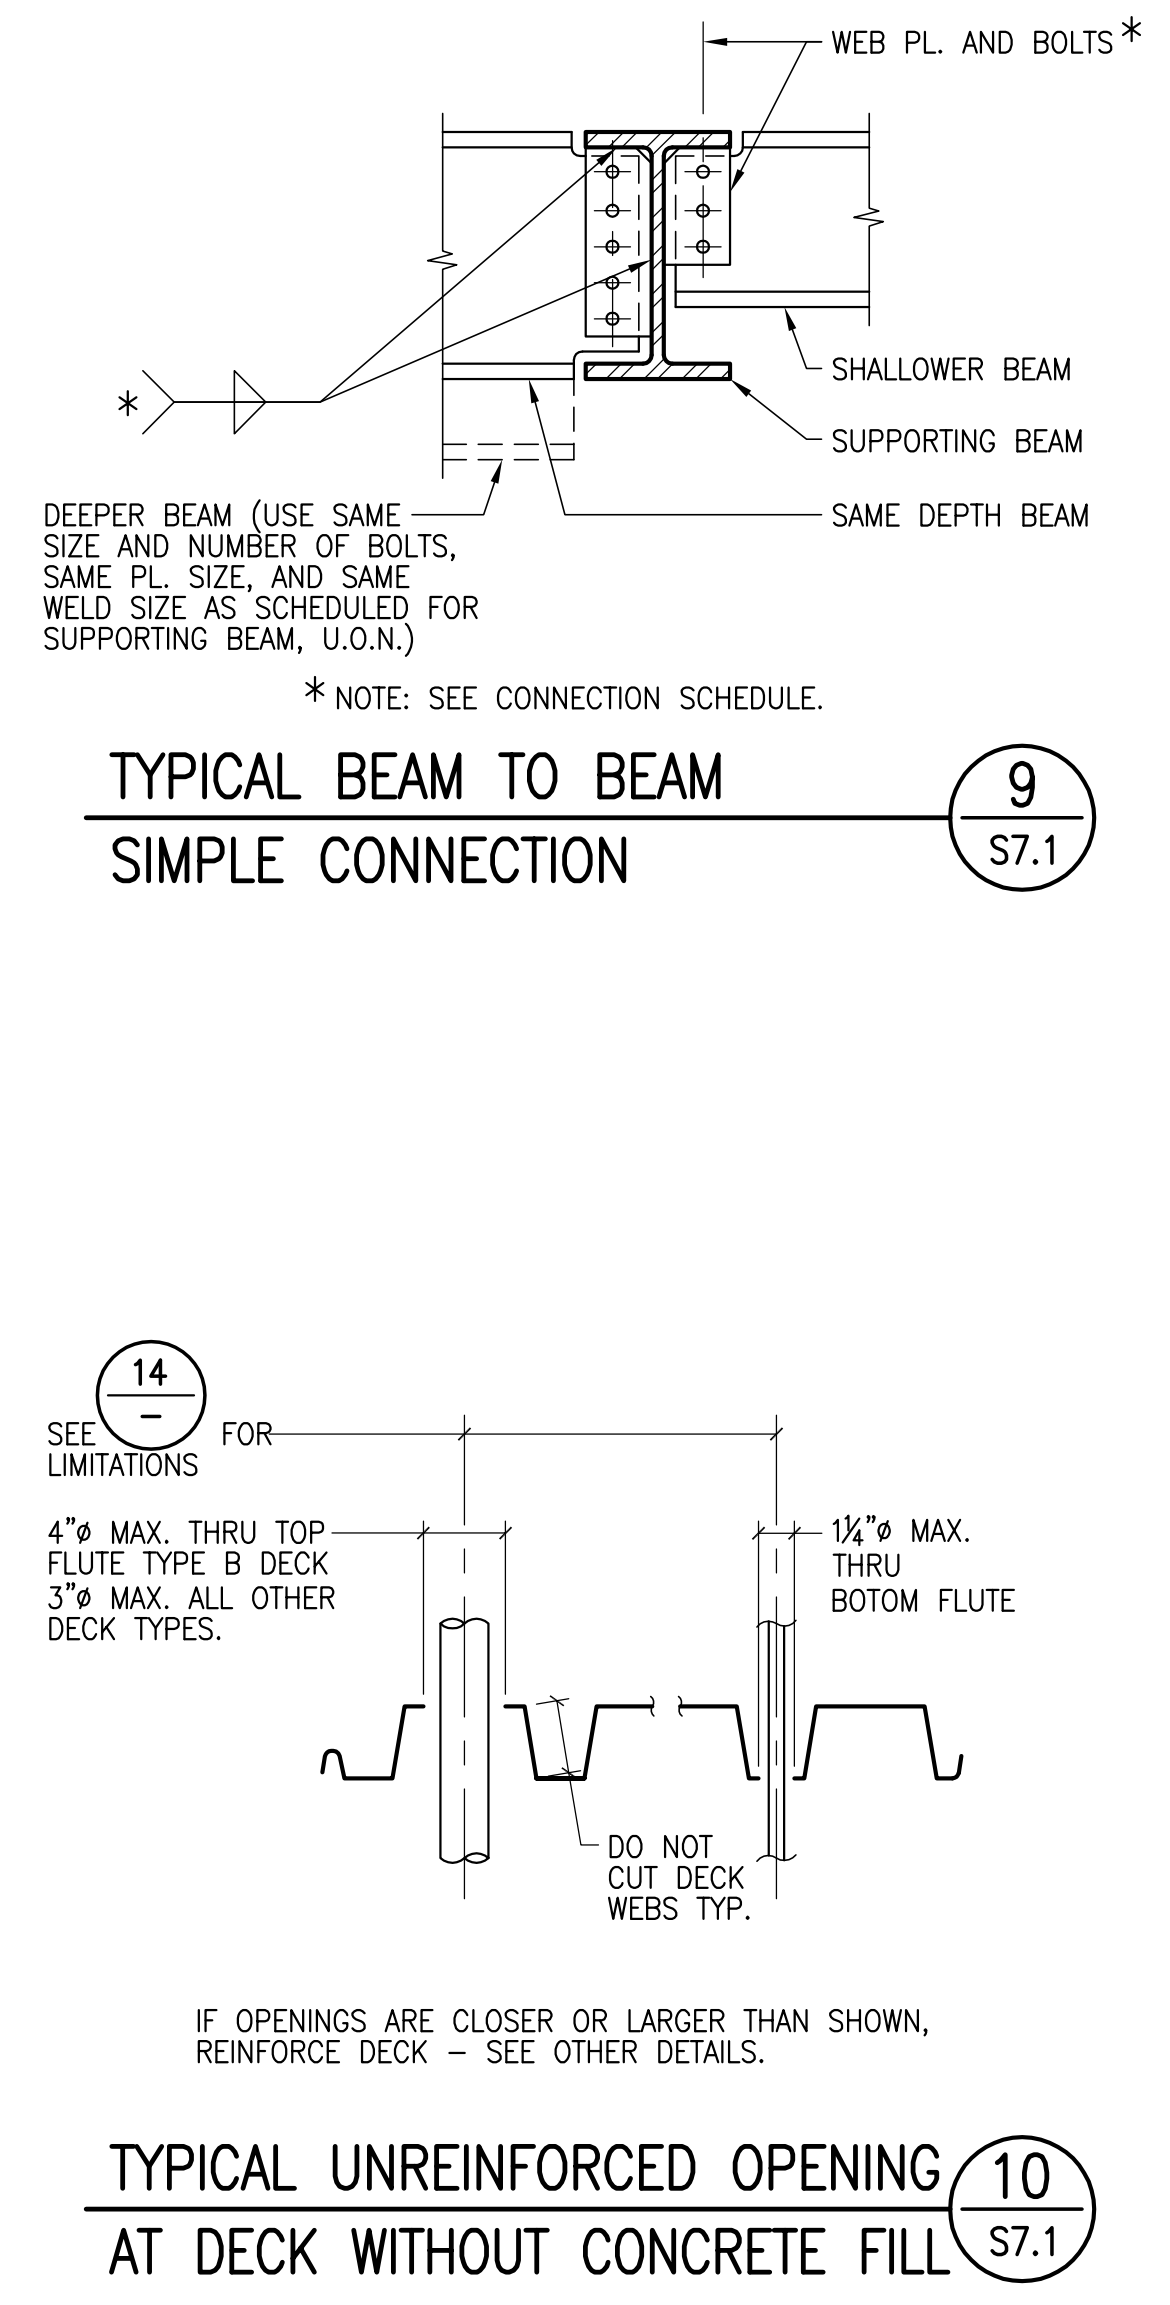


TYPICAL BEAM TO BEAM SIMPLE CONNECTION (9) S7.1

CLASSIFICATION OF OPENINGS IN DECK (14) S7.1

TYPICAL UNREINFORCED OPENING AT DECK WITHOUT CONCRETE FILL (10) S7.1

METAL DECK PROFILES AND MINIMUM PROPERTIES (11) S7.1

POOL BUILDING TIEBACK (12) S7.1

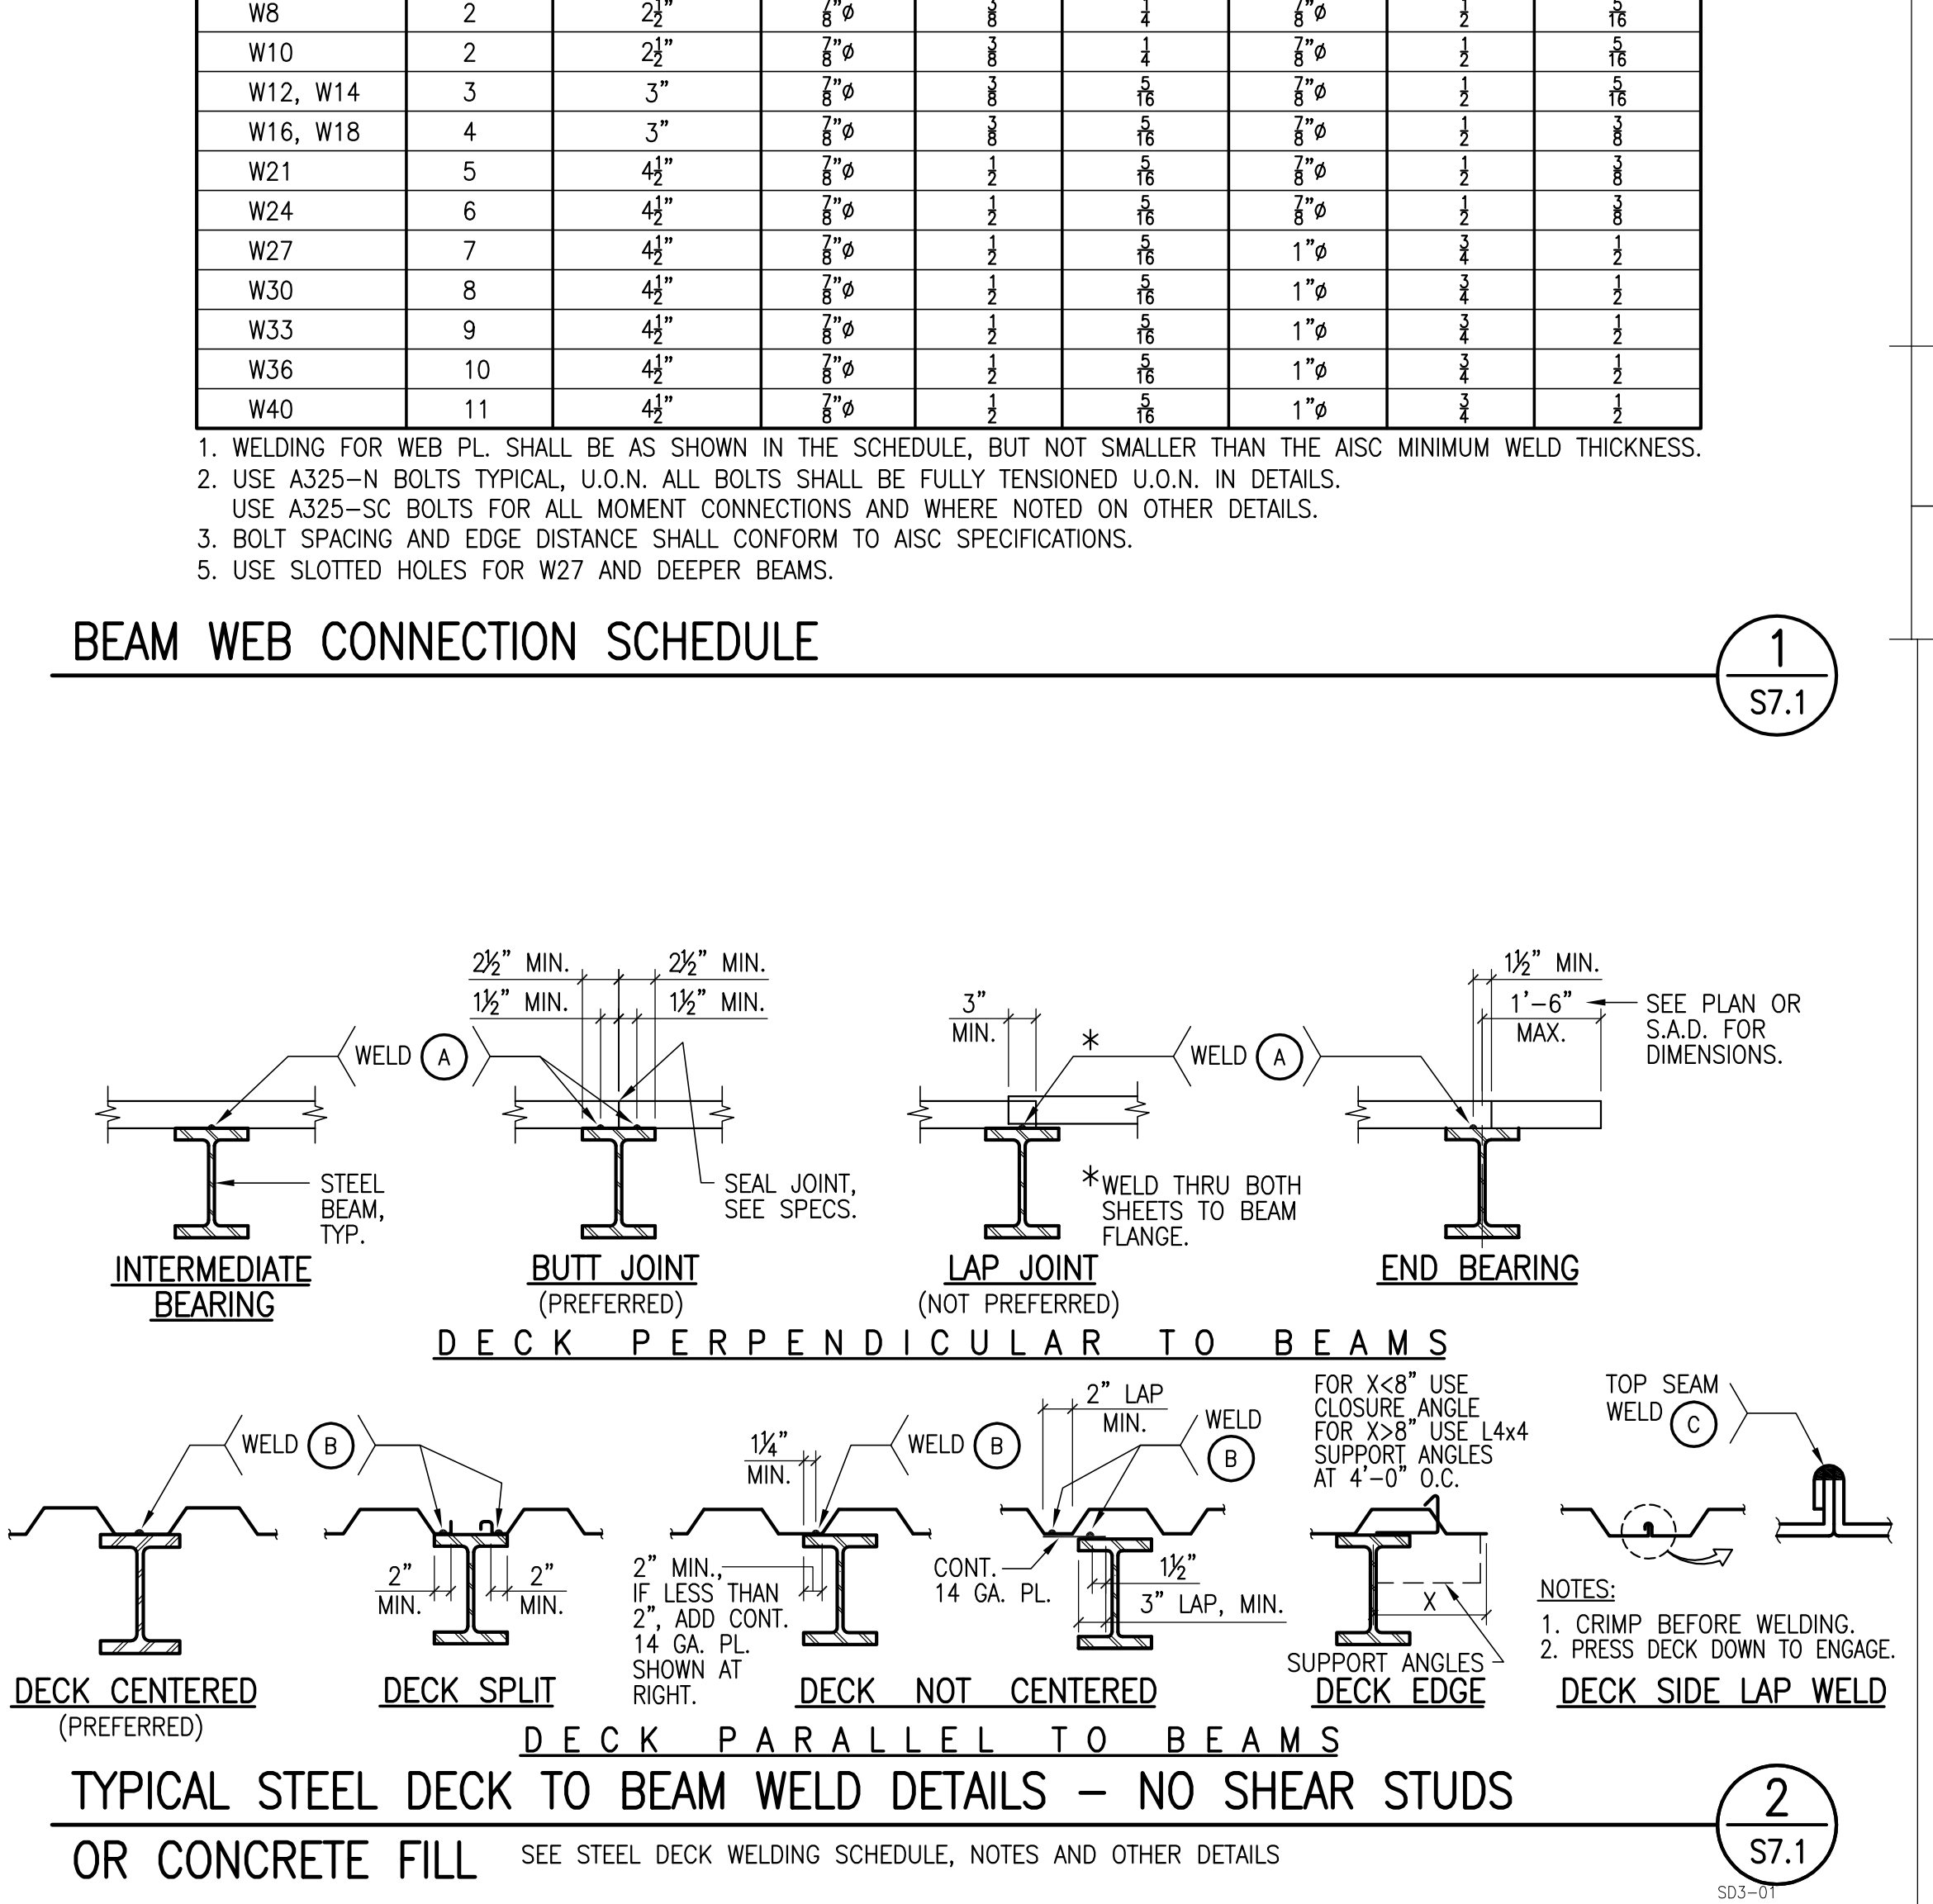

BEAM WEB CONNECTION SCHEDULE (1) S7.1

BEAM SIZE	NO. OF BOLTS (PER ROW)	MIN. TOP OF BEAM TO C.L. 1st BOLT	SINGLE ROW OF BOLTS			DOUBLE ROW OF BOLTS		
			BOLT DIAM.	WEB PL. THICKNESS	WEB PL. WELD	BOLT DIAM.	WEB PL. THICKNESS	WEB PL. WELD
W8	2	2 1/2"	3/8"	1/2"	1/2"	3/8"	1/2"	1/2"
W10	2	2 1/2"	3/8"	1/2"	1/2"	3/8"	1/2"	1/2"
W12, W14	3	3"	3/8"	1/2"	1/2"	3/8"	1/2"	1/2"
W16, W18	4	3"	3/8"	1/2"	1/2"	3/8"	1/2"	1/2"
W21	5	4 1/2"	3/8"	1/2"	1/2"	3/8"	1/2"	1/2"
W24	6	4 1/2"	3/8"	1/2"	1/2"	3/8"	1/2"	1/2"
W27	7	4 1/2"	3/8"	1/2"	1/2"	3/8"	1/2"	1/2"
W30	8	4 1/2"	3/8"	1/2"	1/2"	3/8"	1/2"	1/2"
W33	9	4 1/2"	3/8"	1/2"	1/2"	3/8"	1/2"	1/2"
W36	10	4 1/2"	3/8"	1/2"	1/2"	3/8"	1/2"	1/2"
W40	11	4 1/2"	3/8"	1/2"	1/2"	3/8"	1/2"	1/2"

BEAM WEB CONNECTION SCHEDULE (1) S7.1

TYPICAL STEEL DECK TO BEAM WELD DETAILS - NO SHEAR STUDS OR CONCRETE FILL (2) S7.1

STEEL DECK NOTES (3) S7.1

- SEE ROOF AND FLOOR FRAMING PLANS FOR EXTENT OF DECK TYPES. NOT ALL DECK TYPES ARE SHOWN.
- DECK SIDE LAPS SHALL BE CRIMPED TOGETHER AT WELD POINTS BEFORE MAKING TOP SEAM WELDS.
- SEE TYPICAL DETAILS ON THIS SHEET FOR REINFORCEMENT REQUIRED FOR OPENINGS IN THE DECK. SEE ARCHITECTURAL, MECHANICAL AND ELECTRICAL DRAWINGS FOR MAJOR OPENING SIZES AND LOCATIONS. OTHER OPENINGS ARE NOT SHOWN AND ARE SUBJECT TO REVIEW AND APPROVAL BY THE ARCHITECT AND STRUCTURAL ENGINEER.
- SEE ARCHITECTURAL AND/OR STRUCTURAL DRAWINGS FOR EDGE OF DECK DIMENSIONS.
- ALL BEAMS COVERED BY STEEL DECK ARE TO HAVE DECK WELDED TO IT.
- STEEL DECK AND STEEL MEMBER SURFACES COVERED BY STEEL DECK SHALL NOT BE PAINTED AND SHALL BE FREE OF MOISTURE, RUST, SCALE, DIRT, SAND AND OTHER MATERIALS THAT WILL INTERFERE WITH THE WELDING OPERATIONS. SEE SPECS.
- STEEL DECK CONTRACTOR SHALL PROVIDE AND INSTALL CLOSURE ANGLES, AND OTHER GAGE METAL SHAPES TO CLOSE ALL MISC. OPENINGS IN DECK AS NEEDED AROUND COLUMNS, VERTICAL DISCONTINUITIES, ETC.
- ALL PUDDLE WELDS ARE 3/4" OR EQUAL, REFER TO MANUFACTURER'S RECOMMENDATION.
- STEEL DECK W/O CONCRETE MAY REQUIRE LIGHT GAGE EDGE ANGLES OR CLOSURE ANGLE, ETC. REFER TO ARCHITECTURAL DRAWINGS FOR EXTENT.
- LAYOUT OF DECK SHALL PROVIDE SHEETS OF SUFFICIENT LENGTH TO SPAN AT LEAST THREE SPANS; ENDS SHALL TERMINATE OVER A SUPPORT PERPENDICULAR TO THE DECK SPAN, EXCEPT AT OPENINGS OR BUILDING EDGES WHERE DECKS MAY BE CANTILEVERED AS SHOWN. SEE SPECIFICATIONS FOR COMPLETE REQUIREMENTS.
- DO NOT PLACE CONDUITS OR PIPES IN CONCRETE FILL OVER METAL DECK.

STEEL DECK NOTES (3) S7.1

DECK AND FILL MARK (SEE PLAN)	DECK GAGE AND PROFILE TYPE (SEE PLAN)	DECK WELDS, SEE DETAIL(S) (2) S7.1						REMARKS
		WELD (A)		WELD (B)		WELD (C)		
		SIZE AND TYPE	# PER SHEET	SIZE AND TYPE	SPACING	SIZE AND TYPE	SPACING	
1	A (16 GA.)	3/4" P.W.	4	3/4" P.W.	12" O.C.	1 1/2" TSW	12" O.C.	

P.W. = PUDDLE WELD, TSW = TOP SEAM WELD

STEEL DECK AND FILL SCHEDULE (4) S7.1